

Your Project Calculations



Project Name: McNaughton Pub

S3D Model Link:

https://platform.skyciv.com/structural?preload_name=McNaughton%20Pub&preload_path=Shared%20Enterprise%20Folder/MT_Solar_Projects/8_2023

Public Model Link:

https://platform.skyciv.com/structural-viewer?project_id=1jq2QCxHg67Wh5hLpqUIUT81xgGtusi7lyRi4zaGL7q3y5c6op6lqahggyKYLx8R

Array Specification

Product:	Beam
Unique ID:	4P-19.75-6TOP-SD-45-L-4Hx12W-2754
Duty Classification:	SD
Module Width:	40.00 in
Module Length:	74.00in
Number of Rows:	4
Number of Columns:	12
Total Number of Modules:	48
Desired Tilt Angle:	65
Front Edge Clearance:	5
Total Array Height at Tilt:	17.16 ft
Total Frame Length:	74.25 ft
Frame Weight:	4120 lbs
Array Dimensions N/S:	13.50 ft
Array Dimensions E/W:	75.00 ft
Rail Length:	162.00 in
Rail Spacing:	3.08 ft
Rail Check:	Not Checked

Support Specifications


Pole Size:	6in Pipe Sch 80
Pole Length above Grade:	11.12 ft
Number of Poles:	4
Pole Spacing:	19.75 ft

Foundation Specifications

Foundation Type:	Square
Foundation Dimensions:	48 x 48 in
Foundation Depth (below grade):	Pile 1: 6.00 ft Pile 2: 6.25 ft Pile 3: 6.25 ft Pile 4: 6.00 ft
Foundation Volume:	14.519 y ³
Foundation Result:	PASSED
Mount Twist:	0.646733 kip

Site Info

Risk Category:	I
Exposure:	B
Soil Classification:	sand
Site Location:	Bridge Rd, Newbold, WI, USA
Wind Speed:	98 mph
Snow Load:	60 psf
Design Uplift Pressure:	0.015149 ksf
Design Downforce Pressure:	-0.015149 ksf
Design Snow Pressure:	0.003299 ksf

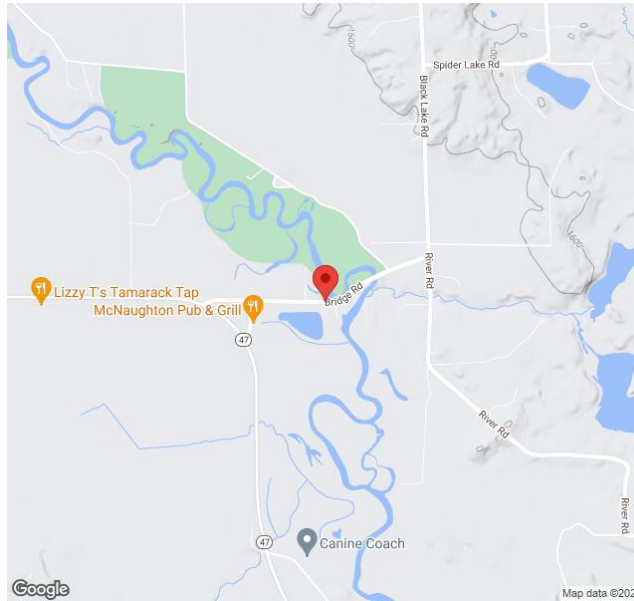

Design Disclaimer



This software should be used for preliminary designs and should not be used as a final design unless reviewed, verified and designed by a qualified structural engineer.



AutoDesigner Input

```
{"wind_speed_override":null,"snow_load_override":null,"direct_snow_load":false,"product_type":"Beam","project_id":"McNaughton Pub","site_address":"Bridge Rd, Newbold, WI, USA","module_width":40,"module_length":74,"number_rows":4,"number_columns":12,"pole_mount_section":"4_40","core_pipe_width":65,"core_pipe_section":"2_40","adjuster_section":"2_40","core_beam_height":65,"core_beam_section":"HSS3x2x1/8","main_pipe_section":"2_12GA","pole_spacing":15,"tilt_angle":65,"ground_clearance":5,"risk_category":"I","exposure_category":"B","frame_duty_override":"auto","pole_override":"auto","soil_type":"sand","customer_foundation_override":"48_Square","foundation_type":"Square","foundation_size":48,"check_rails":false}
```

Design Notes:


- AISC Deflection checks are set to L/1 due to structure design intent
- Foundation Design and Sizing is approximate only

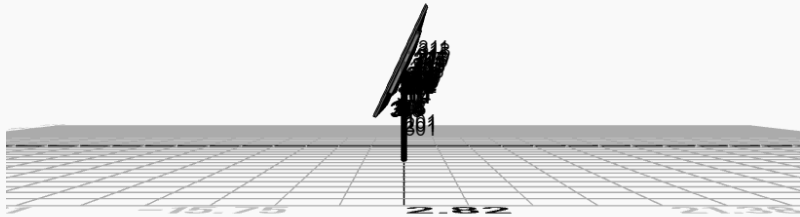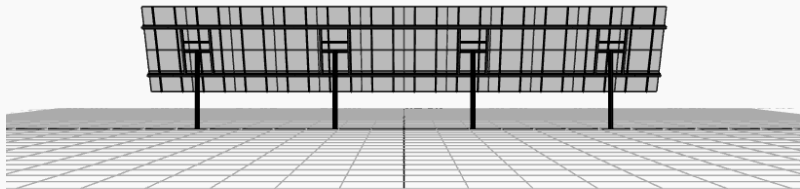

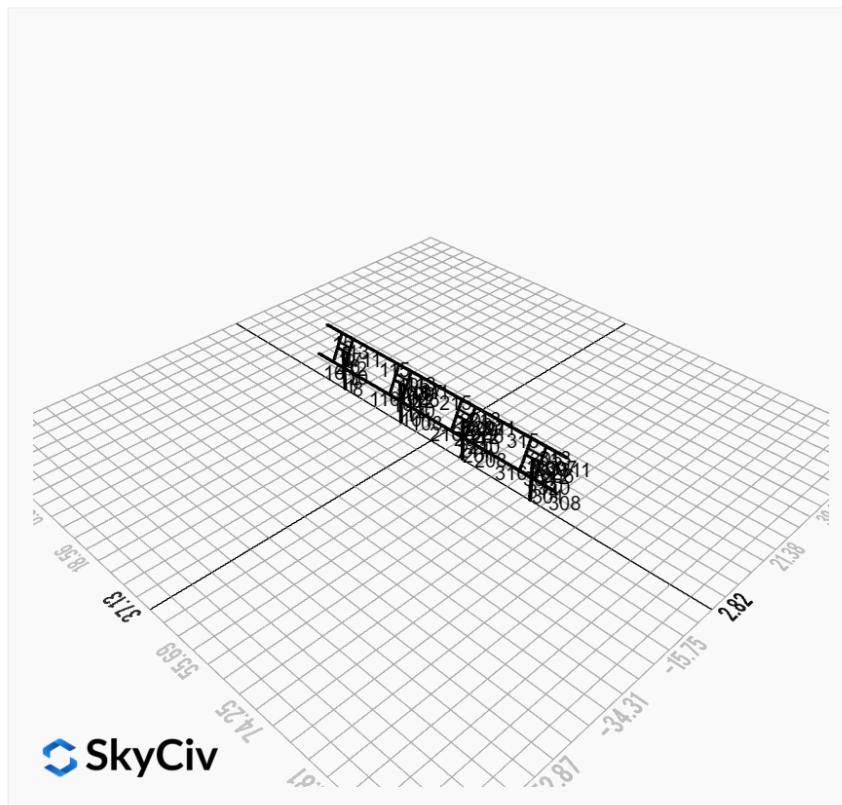
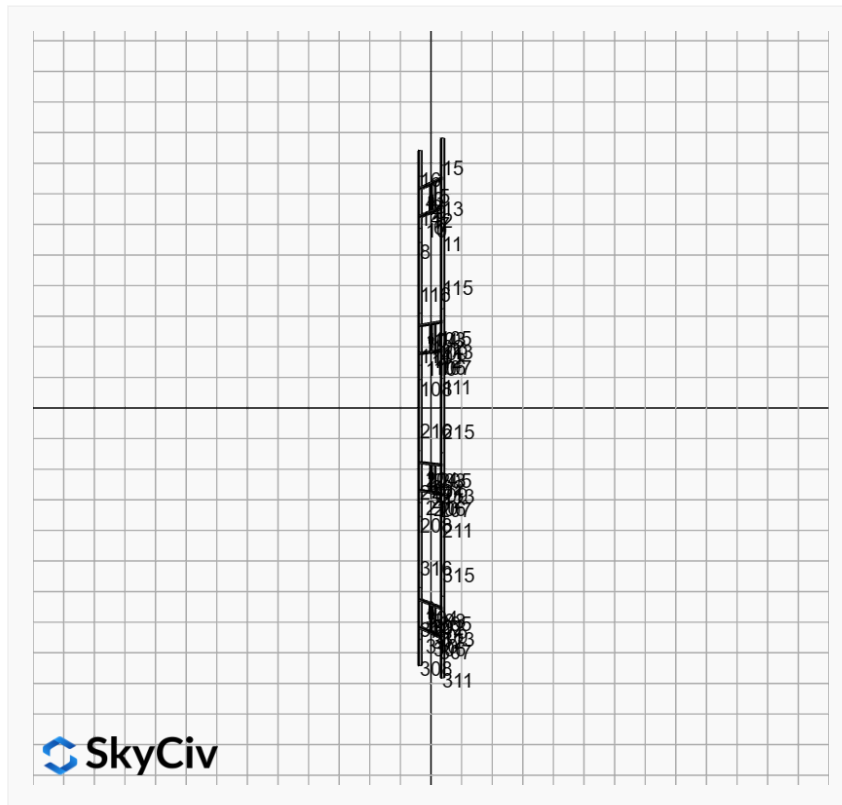




FEM Results (Envelope Worst Case for each member)


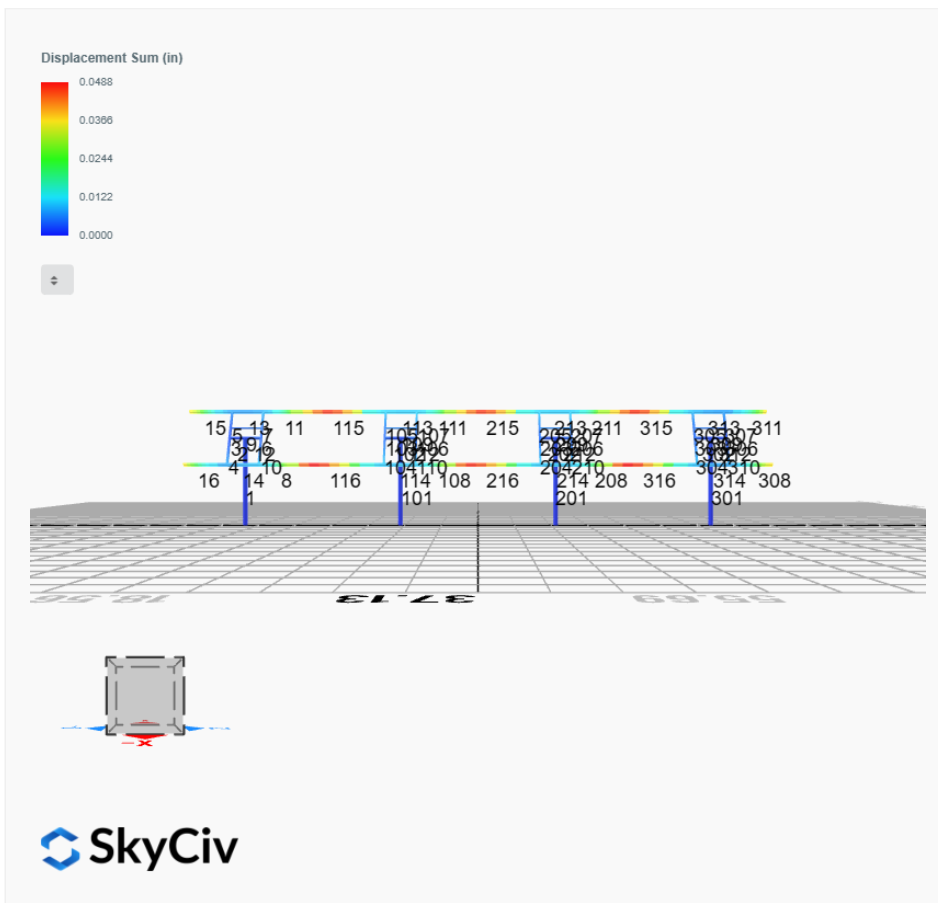


Top Bending Stress Z (ksi)


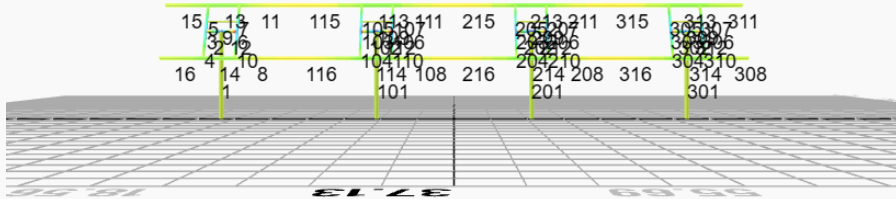


SkyCiv

Top Bending Stress Y (ksi)

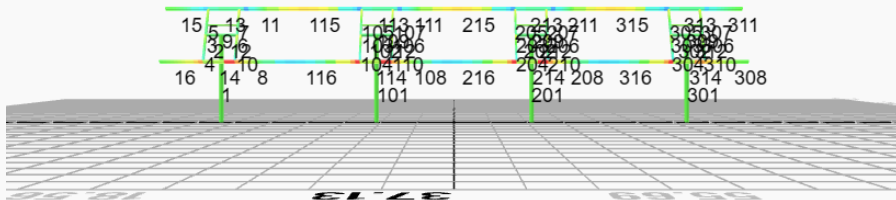

SkyCiv

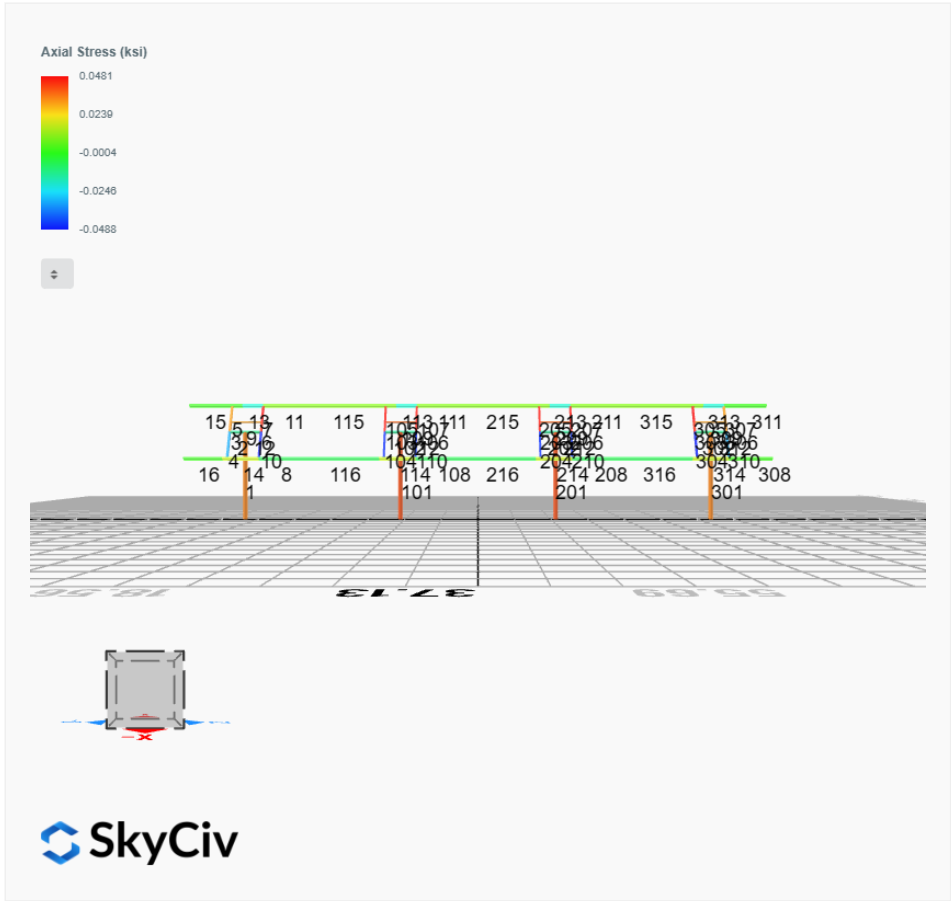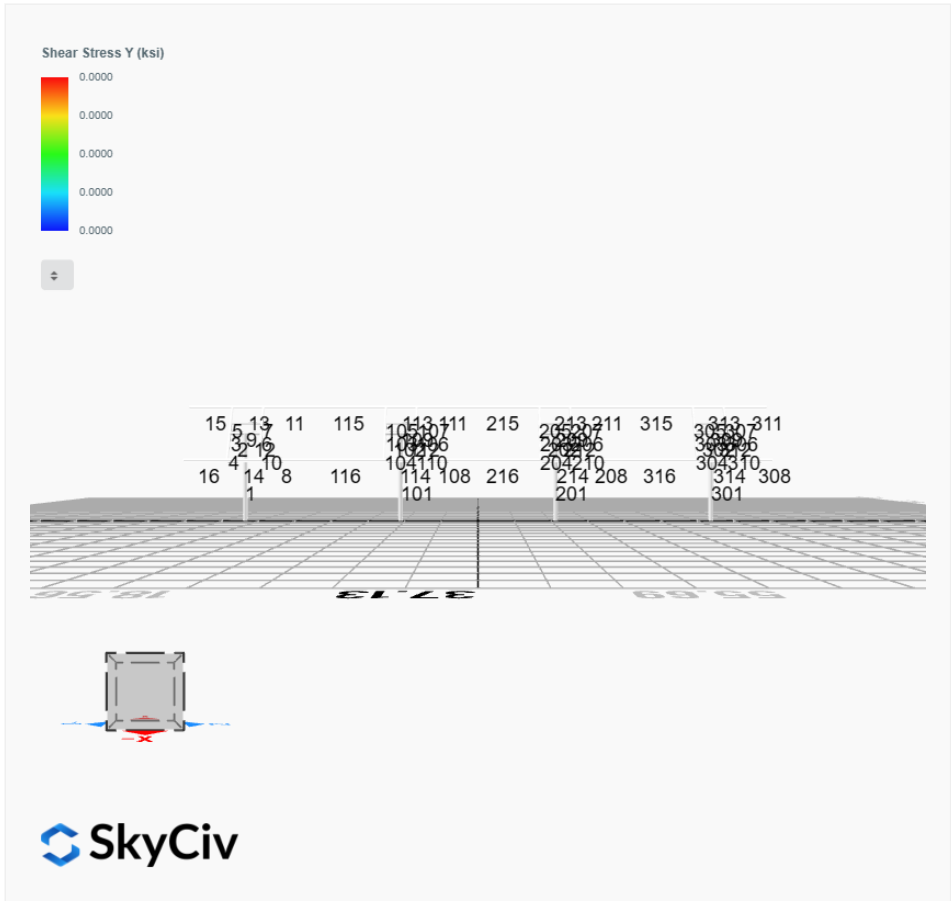

Reaction Forces for Foundation 1 (Node ID#1), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 2. D + L	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 3. D + (S or Lr or R)	0.0064	2.2223	0.0315	0.1103	-0.0225	-0.0558
ULS: 3. D + (S or Lr or R)	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0061	2.1407	0.0300	0.1052	-0.0215	-0.0527
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 5b. D + 0.7E	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0061	2.1407	0.0300	0.1052	-0.0215	-0.0527
ULS: 8. 0.6D + 0.7E	0.0031	1.1376	0.0154	0.0539	-0.0110	-0.0261
ULS: 5a. D + 0.6W_Wind downforce Case A only	-1.9528	2.7961	0.0728	0.2427	-0.3879	21.9775
ULS: 5a. D + 0.6W_Wind downforce Case B only	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 5a. D + 0.6W_Wind uplift Case A only	1.9620	0.9960	-0.0207	-0.0603	0.3449	-21.7173
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.4624	2.8158	0.0654	0.2199	-0.2987	16.4630
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0061	2.1407	0.0300	0.1052	-0.0215	-0.0527
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.4737	1.4657	-0.0047	-0.0074	0.2509	-16.3081
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0061	2.1407	0.0300	0.1052	-0.0215	-0.0527
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.4633	2.5711	0.0610	0.2045	-0.2955	16.4722
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.4728	1.2210	-0.0091	-0.0228	0.2541	-16.2989
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0052	1.8960	0.0256	0.0898	-0.0183	-0.0435
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-1.9548	2.0377	0.0626	0.2068	-0.3806	21.9949
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	0.0031	1.1376	0.0154	0.0539	-0.0110	-0.0261
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	1.9600	0.2376	-0.0310	-0.0962	0.3522	-21.6999
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.0031	1.1376	0.0154	0.0539	-0.0110	-0.0261

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.9386
Shear X	-3.2694
Shear Z	0.1132
Moment X	0.3760
Moment Y (Twist)	0.6468
Moment Z	37.1531

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	2.8158
Shear X	-1.9620
Shear Z	0.0728
Moment X	0.2427
Moment Y (Twist)	0.3879
Moment Z	21.9949

Reaction Forces for Foundation 2 (Node ID#101), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 2. D + L	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 3. D + (S or Lr or R)	-0.0064	2.4709	-0.0004	-0.0017	0.0020	0.0782
ULS: 3. D + (S or Lr or R)	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0061	2.3777	-0.0004	-0.0016	0.0019	0.0751
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 5b. D + 0.7E	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0061	2.3777	-0.0004	-0.0016	0.0019	0.0751
ULS: 8. 0.6D + 0.7E	-0.0031	1.2590	-0.0002	-0.0008	0.0010	0.0394
ULS: 5a. D + 0.6W_Wind downforce Case A only	-2.2176	3.1430	0.0096	0.0301	-0.0941	24.7935
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 5a. D + 0.6W_Wind uplift Case A only	2.2083	1.0537	-0.0098	-0.0312	0.0930	-24.2470
ULS: 5a. D + 0.6W_Wind uplift Case B only	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.6654	3.1612	0.0070	0.0220	-0.0699	18.6210
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0061	2.3777	-0.0004	-0.0016	0.0019	0.0751
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.6540	1.5942	-0.0075	-0.0240	0.0704	-18.1594
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0061	2.3777	-0.0004	-0.0016	0.0019	0.0751
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.6645	2.8818	0.0071	0.0223	-0.0702	18.6115
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.6549	1.3149	-0.0074	-0.0237	0.0701	-18.1689
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0052	2.0984	-0.0004	-0.0014	0.0016	0.0656
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-2.2155	2.3036	0.0097	0.0307	-0.0947	24.7673
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.0031	1.2590	-0.0002	-0.0008	0.0010	0.0394
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	2.2103	0.2144	-0.0096	-0.0307	0.0923	-24.2733
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	-0.0031	1.2590	-0.0002	-0.0008	0.0010	0.0394

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	4.4452
Shear X	-3.6928
Shear Z	-0.0167
Moment X	-0.0533
Moment Y (Twist)	0.1627
Moment Z	41.8951

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.1612
Shear X	-2.2176
Shear Z	-0.0098
Moment X	-0.0312
Moment Y (Twist)	0.0947
Moment Z	24.7935

Reaction Forces for Foundation 3 (Node ID#201), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 2. D + L	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 3. D + (S or Lr or R)	-0.0064	2.4709	0.0004	0.0017	-0.0020	0.0782
ULS: 3. D + (S or Lr or R)	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0061	2.3777	0.0004	0.0016	-0.0019	0.0751
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 5b. D + 0.7E	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0061	2.3777	0.0004	0.0016	-0.0019	0.0751
ULS: 8. 0.6D + 0.7E	-0.0031	1.2590	0.0002	0.0008	-0.0010	0.0394
ULS: 5a. D + 0.6W_Wind downforce Case A only	-2.2176	3.1430	-0.0096	-0.0302	0.0941	24.7935
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 5a. D + 0.6W_Wind uplift Case A only	2.2083	1.0537	0.0098	0.0312	-0.0930	-24.2470
ULS: 5a. D + 0.6W_Wind uplift Case B only	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.6654	3.1612	-0.0070	-0.0220	0.0699	18.6210
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0061	2.3777	0.0004	0.0016	-0.0019	0.0751
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.6540	1.5942	0.0075	0.0240	-0.0704	-18.1594
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0061	2.3777	0.0004	0.0016	-0.0019	0.0751

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.6645	2.8818	-0.0071	-0.0223	0.0702	18.6115
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.6549	1.3149	0.0074	0.0237	-0.0701	-18.1689
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0052	2.0984	0.0004	0.0014	-0.0016	0.0656
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-2.2155	2.3036	-0.0097	-0.0307	0.0947	24.7673
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.0031	1.2590	0.0002	0.0008	-0.0010	0.0394
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	2.2103	0.2144	0.0096	0.0307	-0.0923	-24.2733
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	-0.0031	1.2590	0.0002	0.0008	-0.0010	0.0394

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	4.4452
Shear X	-3.6929
Shear Z	0.0167
Moment X	0.0534
Moment Y (Twist)	0.1626
Moment Z	41.8953

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.1612
Shear X	-2.2176
Shear Z	0.0098
Moment X	0.0312
Moment Y (Twist)	0.0947
Moment Z	24.7935

Reaction Forces for Foundation 4 (Node ID#301), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 2. D + L	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 3. D + (S or Lr or R)	0.0064	2.2223	-0.0315	-0.1103	0.0225	-0.0558
ULS: 3. D + (S or Lr or R)	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0061	2.1407	-0.0300	-0.1052	0.0215	-0.0527
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 5b. D + 0.7E	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0061	2.1407	-0.0300	-0.1052	0.0215	-0.0527
ULS: 8. 0.6D + 0.7E	0.0031	1.1376	-0.0154	-0.0539	0.0110	-0.0261
ULS: 5a. D + 0.6W_Wind downforce Case A only	-1.9528	2.7961	-0.0728	-0.2427	0.3879	21.9775
ULS: 5a. D + 0.6W_Wind downforce Case B only	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 5a. D + 0.6W_Wind uplift Case A only	1.9620	0.9960	0.0207	0.0603	-0.3449	-21.7173
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.4624	2.8158	-0.0654	-0.2199	0.2987	16.4630
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0061	2.1407	-0.0300	-0.1052	0.0215	-0.0527
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.4737	1.4657	0.0047	0.0074	-0.2509	-16.3081
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0061	2.1407	-0.0300	-0.1052	0.0215	-0.0527
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.4633	2.5711	-0.0610	-0.2045	0.2955	16.4722
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.4728	1.2210	0.0091	0.0228	-0.2541	-16.2989
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0052	1.8960	-0.0256	-0.0898	0.0183	-0.0435
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-1.9548	2.0377	-0.0626	-0.2068	0.3806	21.9949
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	0.0031	1.1376	-0.0154	-0.0539	0.0110	-0.0261
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	1.9600	0.2376	0.0310	0.0962	-0.3522	-21.6999
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.0031	1.1376	-0.0154	-0.0539	0.0110	-0.0261

Worst Case Reactions LRFD

Worst Case Reactions ASD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module. Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.9386
Shear X	-3.2694
Shear Z	-0.1132
Moment X	-0.3761
Moment Y (Twist)	0.6467
Moment Z	37.1537

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module. Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	2.8158
Shear X	-1.9620
Shear Z	-0.0728
Moment X	-0.2427
Moment Y (Twist)	0.3879
Moment Z	21.9949

Project Details

Design Code: AISC 360-16 LRFD
Provision: LRFD
Country: United States




User Name: sales@mtsolar.us
Project Name: McNaughton Pub
Unit System: imperial



Design Input Information

Design Factors			
Φ_t	Φ_c	Φ_b	Φ_v
0.9	0.9	0.9	0.9

Design Materials			
ID	E (ksi)	F_y (ksi)	F_u (ksi)
1	29000	50	65

Section Dimensions								
								
ID	Name	d (in)	t_w (in)					
1	2in Pipe Sch 40	2.38	0.15					
4	4in Pipe Sch 40	4.50	0.24					
8	6in Pipe Sch 80	6.63	0.43					
								
ID	Name	d (in)	b (in)	t_w (in)	t_b (in)	r (in)		
15	HSS5x3x1/8	5.00	3.00	0.12	0.12	0.12		
								
ID	Name	d (in)	t_w (in)	b_f (in)	b_b (in)	t_f (in)	t_b (in)	r (in)
18	W6x9	5.90	0.17	3.94	3.94	0.21	0.21	0.25

Section Properties								
ID	Name	A (in ²)	J (in ⁴)	I_{yp} (in ⁴)	I_{zp} (in ⁴)	I_w (in ⁶)	S_{yp} (in ³)	S_{zp} (in ³)
1	2in Pipe Sch 40	1.07	1.33	0.67	0.67	0.00	0.76	0.76
4	4in Pipe Sch 40	3.17	14.47	7.23	7.23	0.00	4.31	4.31

8	6in Pipe Sch 80	8.40	80.98	40.49	40.49	0.00	16.60	16.60
15	HSS5x3x1/8	1.77	6.02	2.75	6.03	152.35	2.07	2.93
18	W6x9	2.68	0.04	2.20	16.40	17.70	1.72	6.23

Member Properties									
Member ID	Section ID	K _z L (ft)	K _y L (ft)	L _b (ft)	C _b	L S T	L S C	L D	
1	8	23.35	23.35	11.12	-	300	200	1	
2	4	2.00	1.30	2.00	-	300	200	1	
3	15	0.92	0.92	1.42	1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.18,1.18,1.17,1.18,1.18,1.16,1.18,1.18,1.17,1.18,1.18,1.17,1.18	300	200	1	
4	15	2.44	2.44	3.75	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.65,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
5	15	1.52	1.52	2.33	1.68,1.68,1.68,1.67,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
6	15	0.92	0.92	1.42	1.19,1.19,1.19,1.19,1.19,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19,1.18,1.19	300	200	1	
7	15	1.52	1.52	2.33	1.68,1.67,1.68,1.67,1.67,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.68,1.67,1.68	300	200	1	
8	18	1.33	1.33	2.05	1.74,1.74,1.74,1.74,1.74,1.74,1.70,1.74,1.68,1.74,1.70,1.74,1.68,1.74,1.70,1.74,1.64,1.74,1.70,1.74,1.66,1.74,1.69,1.74,1.68,1.74	300	200	1	
9	1	2.60	2.60	4.00	-	300	200	1	
10	15	2.44	2.44	3.75	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
11	18	1.33	1.33	2.05	1.80,1.80,1.80,1.80,1.80,1.80,2.00,1.80,2.06,1.80,2.00,1.80,2.06,1.80,1.95,1.80,2.09,1.80,1.96,1.80,2.08,1.80,2.01,1.80,2.06,1.80	300	200	1	
12	4	1.30	1.30	2.00	-	300	200	1	
13	18	4.88	4.00	7.50	1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.09,1.10,1.08,1.10,1.09,1.10,1.08,1.10,1.09,1.10,1.06,1.10,1.09,1.10,1.07,1.10,1.09,1.10,1.08,1.10	300	200	1	
14	18	4.88	4.00	7.50	1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.10,1.09,1.10,1.10,1.10,1.09,1.10,1.10,1.10,1.10,1.10	300	200	1	
15	18	7.88	7.88	3.75	2.33,2.33	300	200	1	
16	18	7.88	7.88	3.75	2.33,2.33	300	200	1	
101	8	23.35	23.35	11.12	-	300	200	1	
102	4	1.30	1.30	2.00	-	300	200	1	
103	15	0.92	0.92	1.42	1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.18,1.18,1.17,1.18,1.18,1.18,1.17,1.18,1.18,1.17,1.18,1.18,1.17,1.18,1.18,1.18	300	200	1	
104	15	2.44	2.44	3.75	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
105	15	1.52	1.52	2.33	1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.67,1.67	300	200	1	
106	15	0.92	0.92	1.42	1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.18,1.18,1.17,1.18,1.18,1.18,1.18,1.18	300	200	1	
107	15	1.52	1.52	2.33	1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.67,1.67	300	200	1	

						0	0	
108	18	1.33	1.33	2.0 5	2.09,2.09,2.09,2.09,2.09,2.09,2.07,2.09,2.07,2.09,2.07,2.09,2.07,2.09,2.08,2.09,2.01,2.09,2.0 7,2.09,2.06,2.09,2.07,2.09,2.07,2.09	3 0 0	2 0 0	1
109	1	2.60	2.60	4.0 0	-	3 0 0	2 0 0	1
110	15	2.44	2.44	3.7 5	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.6 7,1.68,1.66,1.68,1.67,1.68,1.66,1.68	3 0 0	2 0 0	1
111	18	1.33	1.33	2.0 5	2.08,2.08,2.08,2.08,2.08,2.08,1.89,2.08,1.73,2.08,1.89,2.08,1.74,2.08,1.98,2.08,1.53,2.08,1.9 5,2.08,1.62,2.08,1.87,2.08,1.77,2.08	3 0 0	2 0 0	1
112	4	1.30	1.30	2.0 0	-	3 0 0	2 0 0	1
113	18	4.88	4.00	7.5 0	1.05,1.05,1.05,1.05,1.05,1.05,1.06,1.05,1.07,1.05,1.06,1.05,1.07,1.05,1.06,1.05,1.10,1.05,1.0 6,1.05,1.08,1.05,1.06,1.05,1.07,1.05	3 0 0	2 0 0	1
114	18	4.88	4.00	7.5 0	1.04,1.04,1.04,1.04,1.04,1.04,1.05,1.04,1.06,1.04,1.05,1.04,1.06,1.04,1.05,1.04,1.07,1.04,1.0 5,1.04,1.06,1.04,1.05,1.04,1.06,1.04	3 0 0	2 0 0	1
115	18	6.63	6.63	10. 20	1.15,1.15,1.15,1.15,1.15,1.15,1.12,1.15,1.11,1.15,1.12,1.15,1.11,1.15,1.13,1.15,1.10,1.15,1.1 3,1.15,1.10,1.15,1.12,1.15,1.11,1.15	3 0 0	2 0 0	1
116	18	6.63	6.63	10. 20	1.15,1.15,1.15,1.15,1.15,1.15,1.15,1.15,1.14,1.15,1.15,1.15,1.15,1.15,1.15,1.14,1.15,1.1 5,1.15,1.14,1.15,1.15,1.15,1.15	3 0 0	2 0 0	1
201	8	23.3 5	23.3 5	11. 12	-	3 0 0	2 0 0	1
202	4	1.30	1.30	2.0 0	-	3 0 0	2 0 0	1
203	15	0.92	0.92	1.4 2	1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.1 8,1.18,1.18,1.18,1.18,1.18,1.18	3 0 0	2 0 0	1
204	15	2.44	2.44	3.7 5	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.6 7,1.68,1.66,1.68,1.67,1.68,1.66,1.68	3 0 0	2 0 0	1
205	15	1.52	1.52	2.3 3	1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.6 7,1.67,1.66,1.67,1.67,1.67,1.67,1.67	3 0 0	2 0 0	1
206	15	0.92	0.92	1.4 2	1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.18,1.18,1.17,1.18,1.18,1.17,1.18,1.1 8,1.18,1.17,1.18,1.18,1.18,1.18,1.18	3 0 0	2 0 0	1
207	15	1.52	1.52	2.3 3	1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.67,1.67,1.66,1.67,1.6 7,1.67,1.66,1.67,1.67,1.67,1.67,1.67	3 0 0	2 0 0	1
208	18	1.33	1.33	2.0 5	2.08,2.08,2.08,2.08,2.08,2.08,2.06,2.08,2.03,2.08,2.06,2.08,2.04,2.08,2.07,2.08,1.89,2.08,2.0 6,2.08,1.96,2.08,2.06,2.08,2.05,2.08	3 0 0	2 0 0	1
209	1	2.60	2.60	4.0 0	-	3 0 0	2 0 0	1
210	15	2.44	2.44	3.7 5	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.6 7,1.68,1.66,1.68,1.67,1.68,1.66,1.68	3 0 0	2 0 0	1
211	18	1.33	1.33	2.0 5	2.07,2.07,2.07,2.07,2.07,2.07,1.69,2.07,1.56,2.07,1.69,2.07,1.57,2.07,1.76,2.07,1.39,2.07,1.7 4,2.07,1.47,2.07,1.68,2.07,1.59,2.07	3 0 0	2 0 0	1
212	4	1.30	1.30	2.0 0	-	3 0 0	2 0 0	1
213	18	4.88	4.00	7.5 0	1.05,1.05,1.05,1.05,1.05,1.05,1.06,1.05,1.07,1.05,1.06,1.05,1.07,1.05,1.06,1.05,1.10,1.05,1.0 6,1.05,1.08,1.05,1.06,1.05,1.07,1.05	3 0 0	2 0 0	1
214	18	4.88	4.00	7.5 0	1.04,1.04,1.04,1.04,1.04,1.04,1.05,1.04,1.06,1.04,1.05,1.04,1.06,1.04,1.05,1.04,1.07,1.04,1.0 5,1.04,1.06,1.04,1.05,1.04,1.06,1.04	3 0 0	2 0 0	1
215	18	6.63	6.63	10. 20	1.16,1.16,1.16,1.16,1.16,1.16,1.14,1.16,1.13,1.16,1.14,1.16,1.13,1.16,1.14,1.16,1.11,1.16,1.1 4,1.16,1.12,1.16,1.13,1.16,1.13,1.16	3 0 0	2 0 0	1
216	18	6.63	6.63	10. 20	1.16,1.16,1.16,1.16,1.16,1.16,1.15,1.16,1.15,1.16,1.15,1.16,1.15,1.16,1.15,1.16,1.14,1.16,1.1 5,1.16,1.14,1.16,1.15,1.16,1.15,1.16	3 0 0	2 0 0	1
301	8	23.3 5	23.3 5	11. 12	-	3 0 0	2 0 0	1

Member Design Capacity



103	79.65	74.02	10.99	4.60	29.14	16.61
104	79.65	72.01	10.99	4.60	29.14	16.61
105	79.65	73.44	10.99	4.60	29.14	16.61
106	79.65	74.02	10.99	4.60	29.14	16.61
107	79.65	73.44	10.99	4.60	29.14	16.61
108	120.60	117.88	23.36	6.45	30.09	45.74
109	48.35	43.11	2.85	2.85	14.51	14.51
110	79.65	72.01	10.99	4.60	29.14	16.61
111	120.60	117.88	23.36	6.45	30.09	45.74
112	142.83	141.72	16.17	16.17	42.85	42.85
113	120.60	98.23	18.49	6.45	30.09	45.74
114	120.60	98.23	18.31	6.45	30.09	45.74
115	120.60	68.63	15.03	6.45	30.09	45.74
116	120.60	68.63	15.57	6.45	30.09	45.74
201	378.22	116.54	62.23	62.23	113.47	113.47
202	142.83	141.72	16.17	16.17	42.85	42.85
203	79.65	74.02	10.99	4.60	29.14	16.61
204	79.65	72.01	10.99	4.60	29.14	16.61
205	79.65	73.44	10.99	4.60	29.14	16.61
206	79.65	74.02	10.99	4.60	29.14	16.61
207	79.65	73.44	10.99	4.60	29.14	16.61
208	120.60	117.88	23.36	6.45	30.09	45.74
209	48.35	43.11	2.85	2.85	14.51	14.51
210	79.65	72.01	10.99	4.60	29.14	16.61
211	120.60	117.88	23.36	6.45	30.09	45.74
212	142.83	141.72	16.17	16.17	42.85	42.85
213	120.60	98.23	18.49	6.45	30.09	45.74
214	120.60	98.23	18.31	6.45	30.09	45.74
215	120.60	68.63	15.16	6.45	30.09	45.74
216	120.60	68.63	15.57	6.45	30.09	45.74
301	378.22	116.54	62.23	62.23	113.47	113.47
302	142.83	141.72	16.17	16.17	42.85	42.85
303	79.65	74.02	10.99	4.60	29.14	16.61
304	79.65	72.01	10.99	4.60	29.14	16.61
305	79.65	73.44	10.99	4.60	29.14	16.61
306	79.65	74.02	10.99	4.60	29.14	16.61
307	79.65	73.44	10.99	4.60	29.14	16.61
308	120.60	54.44	23.36	6.45	30.09	45.74
309	48.35	43.11	2.85	2.85	14.51	14.51
310	79.65	72.01	10.99	4.60	29.14	16.61
311	120.60	54.44	23.36	6.45	30.09	45.74
312	142.83	140.22	16.17	16.17	42.85	42.85
313	120.60	98.23	18.66	6.45	30.09	45.74
314	120.60	98.23	19.19	6.45	30.09	45.74
315	120.60	68.63	15.44	6.45	30.09	45.74
316	120.60	68.63	15.30	6.45	30.09	45.74

Design Ratio


Member ID	P	M _z	M _y	V _y	V _z	(P,M _z ,M _y)	Worst LC	KL/r	δ	Status
1	0.034	0.597	0.014	0.029	0.001	0.620	#13	0.638	Not Required	Pass
2	0.002	0.141	0.176	0.037	0.035	0.318	#13	0.053	Not Required	Pass
3	0.007	0.349	0.055	0.034	0.005	0.400	#13	0.044	Not Required	Pass

4	0.006	0.350	0.140	0.035	0.018	0.450	#13	0.078	Not Required	Pass
5	0.006	0.216	0.134	0.035	0.019	0.239	#13	0.073	Not Required	Pass
6	0.008	0.419	0.093	0.043	0.012	0.502	#13	0.044	Not Required	Pass
7	0.008	0.260	0.191	0.042	0.028	0.297	#13	0.073	Not Required	Pass
8	0.001	0.048	0.070	0.025	0.008	0.080	#13	0.088	Not Required	Pass
9	0.006	0.030	0.052	0.002	0.001	0.069	#13	0.198	Not Required	Pass
10	0.008	0.401	0.187	0.040	0.024	0.483	#13	0.078	Not Required	Pass
11	0.001	0.043	0.071	0.026	0.008	0.077	#15	0.088	Not Required	Pass
12	0.001	0.195	0.216	0.046	0.042	0.412	#13	0.034	Not Required	Pass
13	0.003	0.112	0.183	0.034	0.010	0.239	#13	0.265	Not Required	Pass
14	0.003	0.108	0.182	0.032	0.010	0.224	#21	0.177	Not Required	Pass
15	0.000	0.038	0.064	0.016	0.005	0.092	#13	Not Required	Not Required	Pass
16	0.000	0.038	0.064	0.016	0.005	0.092	#13	Not Required	Not Required	Pass
101	0.038	0.673	0.002	0.033	0.000	0.693	#13	0.638	Not Required	Pass
102	0.002	0.187	0.217	0.047	0.042	0.405	#13	0.034	Not Required	Pass
103	0.008	0.421	0.083	0.042	0.009	0.497	#13	0.044	Not Required	Pass
104	0.008	0.433	0.183	0.043	0.023	0.551	#13	0.078	Not Required	Pass
105	0.008	0.261	0.189	0.042	0.027	0.300	#13	0.073	Not Required	Pass
106	0.008	0.440	0.084	0.044	0.010	0.510	#13	0.044	Not Required	Pass
107	0.008	0.273	0.183	0.044	0.026	0.311	#13	0.073	Not Required	Pass
108	0.002	0.036	0.066	0.026	0.008	0.079	#21	0.088	Not Required	Pass
109	0.007	0.019	0.045	0.001	0.000	0.066	#13	0.198	Not Required	Pass
110	0.008	0.438	0.176	0.044	0.022	0.540	#13	0.078	Not Required	Pass
111	0.001	0.044	0.067	0.026	0.008	0.077	#21	0.088	Not Required	Pass
112	0.002	0.195	0.227	0.048	0.044	0.423	#13	0.034	Not Required	Pass
113	0.003	0.106	0.185	0.033	0.010	0.251	#13	0.265	Not Required	Pass
114	0.004	0.123	0.184	0.034	0.010	0.271	#13	0.265	Not Required	Pass
115	0.002	0.134	0.103	0.025	0.008	0.225	#13	0.439	Not Required	Pass
116	0.001	0.133	0.104	0.026	0.008	0.221	#13	0.439	Not Required	Pass
201	0.038	0.673	0.002	0.033	0.000	0.693	#13	0.638	Not Required	Pass
202	0.002	0.195	0.227	0.048	0.044	0.423	#13	0.034	Not Required	Pass
203	0.008	0.440	0.084	0.044	0.010	0.510	#13	0.044	Not Required	Pass
204	0.008	0.438	0.176	0.044	0.022	0.540	#13	0.078	Not Required	Pass
205	0.008	0.273	0.183	0.044	0.026	0.311	#13	0.073	Not Required	Pass
206	0.008	0.421	0.083	0.042	0.009	0.497	#13	0.044	Not Required	Pass
207	0.008	0.261	0.189	0.042	0.027	0.300	#13	0.073	Not Required	Pass
208	0.001	0.041	0.072	0.026	0.008	0.084	#13	0.088	Not Required	Pass
209	0.007	0.019	0.045	0.001	0.000	0.066	#13	0.198	Not Required	Pass
210	0.008	0.433	0.183	0.043	0.023	0.551	#13	0.078	Not Required	Pass
211	0.001	0.049	0.073	0.025	0.008	0.078	#21	0.088	Not Required	Pass
212	0.002	0.187	0.217	0.047	0.042	0.405	#13	0.034	Not Required	Pass
213	0.003	0.106	0.185	0.033	0.010	0.251	#13	0.265	Not Required	Pass
214	0.004	0.123	0.184	0.034	0.010	0.271	#13	0.265	Not Required	Pass
215	0.002	0.130	0.103	0.026	0.008	0.219	#13	0.439	Not Required	Pass
216	0.002	0.119	0.104	0.026	0.008	0.208	#13	0.439	Not Required	Pass
301	0.034	0.597	0.014	0.029	0.001	0.620	#13	0.638	Not Required	Pass
302	0.001	0.195	0.216	0.046	0.042	0.412	#13	0.034	Not Required	Pass
303	0.008	0.419	0.093	0.043	0.012	0.502	#13	0.044	Not Required	Pass
304	0.008	0.401	0.187	0.040	0.024	0.483	#13	0.078	Not Required	Pass
305	0.008	0.260	0.191	0.042	0.028	0.297	#13	0.073	Not Required	Pass
306	0.007	0.349	0.055	0.034	0.005	0.400	#13	0.044	Not Required	Pass
307	0.006	0.216	0.134	0.035	0.019	0.239	#13	0.073	Not Required	Pass
308	0.000	0.038	0.064	0.016	0.005	0.092	#13	Not Required	Not Required	Pass
309	0.006	0.030	0.052	0.002	0.001	0.069	#13	0.198	Not Required	Pass

309	0.000	0.030	0.032	0.002	0.001	0.005	#13	0.130	Not Required	Pass
310	0.006	0.350	0.140	0.035	0.018	0.450	#13	0.078	Not Required	Pass
311	0.000	0.038	0.064	0.016	0.005	0.092	#13	Not Required	Not Required	Pass
312	0.002	0.141	0.176	0.037	0.035	0.318	#13	0.053	Not Required	Pass
313	0.003	0.111	0.183	0.034	0.010	0.239	#13	0.177	Not Required	Pass
314	0.003	0.108	0.182	0.032	0.010	0.224	#21	0.265	Not Required	Pass
315	0.002	0.137	0.103	0.026	0.008	0.222	#13	0.439	Not Required	Pass
316	0.001	0.136	0.104	0.025	0.008	0.223	#13	0.439	Not Required	Pass

Definitions

Φ_t	Safety factor for tensile
Φ_c	Safety factor for compression
Φ_b	Safety factor for flexure
Φ_v	Safety factor for shear
E	Modulus of elasticity
F_y	Specified minimum yield stress
F_u	Specified minimum tensile strength
A	Cross-sectional area
J	Torsional constant
I_{yp}	Moment of inertia about the Y axes
I_{zp}	Moment of inertia about the Z axes
I_w	Warping constant
S_{yp}	Plastic section modulus about the Y axis
S_{zp}	Plastic section modulus about the Z axis
KL	Effective length
C_b	Buckling modification factor (from all load combinations)
L_b	Length between braced points
LST	Limited slenderness for tension
LSC	Limited slenderness for compression
LD	Limited deflection
P_n	Nominal axial strength (tension/compression)
M_n	Nominal flexural strength (about Z/Y axis)
V_n	Nominal shear strength (along Z/Y axis)
P	Design ratio in case of axial force
M_z	Design ratio in case of bending about Z axis
M_y	Design ratio in case of bending about Y axis
V_y	Design ratio in case of shear along Y axis
V_z	Design ratio in case of shear along Z axis
(P, M_z , M_y)	Design ratio in case of axial force and bending action
KL/r	Design ratio in case of section slenderness
δ	Design ratio in case of member deflection
OK	Capacity is provided
NG	Capacity is not provided

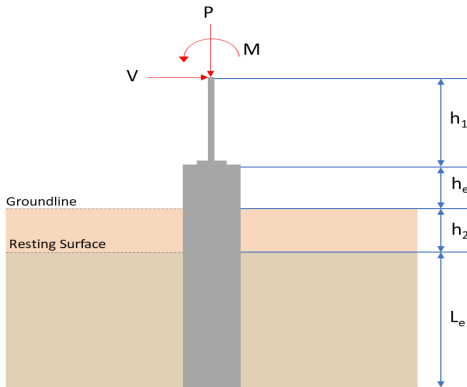REFERENCES	CALCULATIONS	RESULTS																										
	SkyCiv Foundation Design Pile Foundation Design Information : Design code : IBC 2021 (International Building Code) Unit System : Imperial																											
	Pile Input  Geometry Pile shape: rectangular b = 48 in - Pile width D = 48 in - Pile depth L = 6 ft - Total pile length h1 = 0 ft - Lateral load height from the top of the pile, h2 = 0 ft - Depth to resisting surface he = 0 ft - Length of pile above the ground Tabulation of Soil Parameters <table><tr><th>Layer</th><th>Label</th><th>Allowable Bearing Pressure (qa) (psf)</th><th>Allowable Lateral Pressure (R) (psf/ft)</th></tr><tr><td>1</td><td>Sand, silty sand, clayey sand, silty gravel & clayey gravel</td><td>2000.000</td><td>150.000</td></tr></table> Tabulation of Loads <table><tr><th>Load Component</th><th>ASD</th><th>LRFD</th></tr><tr><td>P (kip)</td><td>2.816</td><td>3.939</td></tr><tr><td>Vx (kip)</td><td>-1.962</td><td>-3.269</td></tr><tr><td>Vz (kip)</td><td>0.073</td><td>0.113</td></tr><tr><td>Mx (kipft)</td><td>0.243</td><td>0.376</td></tr><tr><td>Mz (kipft)</td><td>21.995</td><td>37.153</td></tr></table> Material Properties f'ck = 2.5 ksi - Concrete strength,	Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	P (kip)	2.816	3.939	Vx (kip)	-1.962	-3.269	Vz (kip)	0.073	0.113	Mx (kipft)	0.243	0.376	Mz (kipft)	21.995	37.153	
Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
P (kip)	2.816	3.939																										
Vx (kip)	-1.962	-3.269																										
Vz (kip)	0.073	0.113																										
Mx (kipft)	0.243	0.376																										
Mz (kipft)	21.995	37.153																										
	Required depth to resist lateral loads (ASD) H - Point of application of the lateral load $H = h_1 + h_2 + h_e$ $H = (0\text{ ft}) + (0\text{ ft}) + (0\text{ ft})$ $H = 0\text{ ft}$ Considering x-direction: Ho - Lateral force per length of pile, $H_o = \frac{V_x}{1.57 D}$ $H_o = \frac{(-1.962\text{ kip})}{1.57 \times (48\text{ in})}$ $H_o = -0.31242\text{ kip/ft}$ Mo - Moment per length of pile, $M_o = \frac{M_z + (V_x H)}{1.57 D}$																											

	$M_o = \frac{(21.995 \text{ kipft}) + ((-1.962 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 3.5024 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,x} = 5.5965 \text{ ft}$ - Required depth in x-direction, Considering z-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_z}{1.57 b}$ $H_o = \frac{(0.073 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = 0.011624 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{1.57 b}$ $M_o = \frac{(0.243 \text{ kipft}) + ((0.073 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 0.038694 \text{ kipft/ft}$ Required depth of embedment in earth: $L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,z} = 1.6162 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$ $L_{e,req} = \text{MAX}[(5.5965 \text{ ft}), (1.6162 \text{ ft})]$ $L_{e,req} = 5.596 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_e - h_2$ $L_e = (6 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 6 \text{ ft}$ <i>Ratio</i> - Embedded depth $\text{Ratio} = \frac{L_{e,req}}{L_e}$ $\text{Ratio} = \frac{(5.596 \text{ ft})}{(6 \text{ ft})}$ $\text{Ratio} = 0.93267$	Status: PASS Ratio: 0.930
	End-bearing Capacity (ASD) A - Pile cross-section area $A = b D$ $A = (48 \text{ in}) \times (48 \text{ in})$ $A = 16 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(2.816 \text{ kip})}{(16 \text{ ft}^2)}$ $q = 0.176 \text{ kips/ft}^2$	


	$q = 0.176 \text{ kip/ft}$	
	Check bearing capacity ratio: Ratio - Capacity $Ratio = \frac{q}{q_a}$ $Ratio = \frac{(0.176 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $Ratio = 0.088$	Status: PASS Ratio: 0.090
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(6 \text{ ft})}{(48 \text{ in})}$ $L/D = 1.5$ Since $L/D \leq 10$, Pile is short. Considering x-direction: $H_o = -0.31242 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 3.5024 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (3.5024 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (3.5024 \text{ kipft/ft})) + (4 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))}$ $a = 4.1315 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 [(4 \times (3.5024 \text{ kipft/ft})) + (3 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))]^2}{(6 \text{ ft})^3 [(3 \times (3.5024 \text{ kipft/ft})) + (2 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))]}$ $p = 0.21679 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (3.5024 \text{ kipft/ft})) + ((-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))]}{(6 \text{ ft})^2}$ $s = 0.85504 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.1315 \text{ ft})}{2}$ $p_a = 0.30986 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $Ratio = \frac{p}{p_a}$ $Ratio = \frac{(0.21679 \text{ kip/ft}^2)}{(0.30986 \text{ kip/ft}^2)}$ $Ratio = 0.69964$ p_s - Allowable lateral soil pressure at depth L_e,	Status: PASS Ratio: 0.700

	$p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6 \text{ ft})$ $p_s = 0.9 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(0.85504 \text{ kip/ft}^2)}{(0.9 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.95005$	Status: PASS Ratio: 0.950
	Considering z-direction: $H_o = 0.011624 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 0.038694 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.038694 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (0.011624 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (0.038694 \text{ kipft/ft})) + (4 \times (0.011624 \text{ kip/ft}) \times (6 \text{ ft}))}$ $a = 4.2729 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 \times [(4 \times (0.038694 \text{ kipft/ft})) + (3 \times (0.011624 \text{ kip/ft}) \times (6 \text{ ft}))]^2}{(6 \text{ ft})^3 \times [(3 \times (0.038694 \text{ kipft/ft})) + (2 \times (0.011624 \text{ kip/ft}) \times (6 \text{ ft}))]}$ $p = 0.010801 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (0.038694 \text{ kipft/ft})) + ((0.011624 \text{ kip/ft}) \times (6 \text{ ft}))]}{(6 \text{ ft})^2}$ $s = 0.024522 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.2729 \text{ ft})}{2}$ $p_a = 0.32047 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(0.010801 \text{ kip/ft}^2)}{(0.32047 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.033705$ p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6 \text{ ft})$ $p_s = 0.9 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$	Status: PASS Ratio: 0.030

$$Ratio = \frac{(0.024522 \text{ kip/ft}^2)}{(0.9 \text{ kip/ft}^2)}$$

$$Ratio = 0.027247$$

Status: **PASS**
Ratio: **0.030**

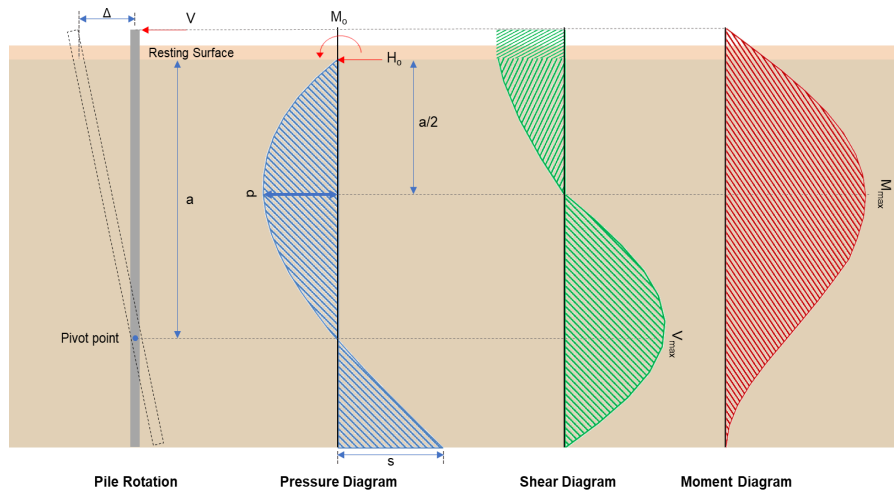

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-3.269 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.52054 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_x H)}{1.57 D}$$

$$M_o = \frac{(37.153 \text{ kipft}) + ((-3.269 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 5.9161 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(5.9161 \text{ kipft/ft})}{(-0.52054 \text{ kip/ft})}$$

$$E = 11.365 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (5.9161 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (-0.52054 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (5.9161 \text{ kipft/ft})) + (4 \times (-0.52054 \text{ kip/ft}) \times (6 \text{ ft}))}$$

$$a = 4.1302 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.52054 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (11.365 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.1302 \text{ ft})}{(6 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (11.365 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.1302 \text{ ft})}{(6 \text{ ft})} \right)^3 \right] \right]$$


$$V_{max} = 8.3531 \text{ kip}$$

	M_{max} - Max bending moment located at depth $a/2$, $M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$ $M_{max} = ((-0.52054 \text{ kip/ft}) \times (48 \text{ in}) \times (6 \text{ ft})) \times \left[\left(\frac{(11.365 \text{ ft})}{(6 \text{ ft})} + \frac{(4.1302 \text{ ft})}{2 \times (6 \text{ ft})} \right) - \left[\left(\frac{4 \times (11.365 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.1302 \text{ ft})}{2 \times (6 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (11.365 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.1302 \text{ ft})}{2 \times (6 \text{ ft})} \right)^4 \right] \right]$ $M_{max} = 23.924 \text{ kipft}$	
	Shear force and Bending moment (z-direction, LRFD) H_o - Lateral force per length of pile, $H_o = \frac{V_z}{1.57 b}$ $H_o = \frac{(0.113 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = 0.017994 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{1.57 b}$ $M_o = \frac{(0.376 \text{ kipft}) + ((0.113 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 0.059873 \text{ kipft/ft}$ E - Distance from lateral load to resisting surface, $E = \frac{M_o}{H_o}$ $E = \frac{(0.059873 \text{ kipft/ft})}{(0.017994 \text{ kip/ft})}$ $E = 3.3274 \text{ ft}$ a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.059873 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (0.017994 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (0.059873 \text{ kipft/ft})) + (4 \times (0.017994 \text{ kip/ft}) \times (6 \text{ ft}))}$ $a = 4.2729 \text{ ft}$ V_{max} - Max shear force located at depth a, $V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$ $V_{max} = ((0.017994 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.2729 \text{ ft})}{(6 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.2729 \text{ ft})}{(6 \text{ ft})} \right)^3 \right] \right]$ $V_{max} = 0.11851 \text{ kip}$ M_{max} - Max bending moment located at depth $a/2$, $M_{max} = (H_o b L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$ $M_{max} = ((0.017994 \text{ kip/ft}) \times (48 \text{ in}) \times (6 \text{ ft})) \times \left[\left(\frac{(3.3274 \text{ ft})}{(6 \text{ ft})} + \frac{(4.2729 \text{ ft})}{2 \times (6 \text{ ft})} \right) - \left[\left(\frac{4 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.2729 \text{ ft})}{2 \times (6 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.2729 \text{ ft})}{2 \times (6 \text{ ft})} \right)^4 \right] \right]$	

	Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.80 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.80 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2)) \right]$ $\phi P_N = 2675.2 \text{ kip}$ Ratio - Capacity $\text{Ratio} = \frac{P}{\phi P_N}$ $\text{Ratio} = \frac{(3.939 \text{ kip})}{(2675.2 \text{ kip})}$ $\text{Ratio} = 0.0014724$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 48 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (48 \text{ in})$ $d = 38.4 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.64282$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,max} = 296.21 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 3.939 \text{ kip} \rightarrow 3939 \text{ lbf}$, $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(3939 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,a} = 119.01 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,b} = 348.89 \text{ kip}$ V_c - Governing shear strength of concrete $V_c = MIN [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = MIN [(296.21 \text{ kip}), (119.01 \text{ kip}), (348.89 \text{ kip})]$ $V_c = 119.01 \text{ kip}$	

22.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{s,a} = 737.28 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{tes}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ 22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{ysk} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 50.894 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(737.28 \text{ kip}), (50.894 \text{ kip})]$ $V_s = 50.894 \text{ kip}$ 22.5.1.1 ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((119.01 \text{ kip}) + (50.894 \text{ kip}))$ $\phi V_n = 110.44 \text{ kip}$ Considering x-direction: $V_{max} = 8.3531 \text{ kip}$ - Maximum shear force in the x-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(8.3531 \text{ kip})}{(110.44 \text{ kip})}$ $Ratio = 0.075636$ Considering z-direction: $V_{max} = 0.11851 \text{ kip}$ - Maximum shear force in the z-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(0.11851 \text{ kip})}{(110.44 \text{ kip})}$ $Ratio = 0.0010731$	Status: PASS Ratio: 0.080 Status: PASS Ratio: 0.000
	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{b D^3}{6}$ $S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$ $S_m = 18432 \text{ in}^3$	

14.5.2.1b	$\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ ksi}} \times 18432.001 \text{ in}^3$ $\phi M_{n,1} = 249.600 \text{ kipft}$ $\phi M_{n,2}$ $\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$ $\phi M_{n,2} = 2121.6 \text{ kipft}$ Therefore, ϕM_n - Allowable flexural strength, $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$ $\phi M_n = 249.6 \text{ kipft}$ Considering x-direction: $M_{max} = 23.924 \text{ kipft}$ - Maximum moment in the x-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(23.924 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.095848$	Status: PASS Ratio: 0.100
	Considering z-direction: $M_{max} = 0.31696 \text{ kipft}$ - Maximum moment in the z-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(0.31696 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.0012699$	Status: PASS Ratio: 0.000

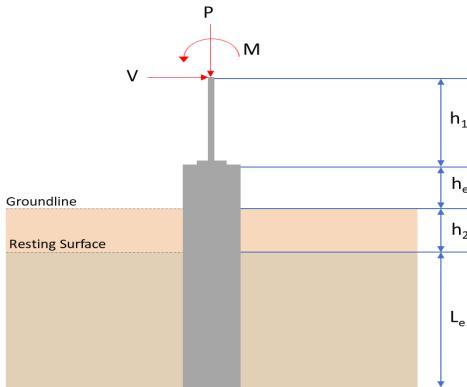REFERENCES	CALCULATIONS	RESULTS																										
	SkyCiv Foundation Design Pile Foundation Design Information : Design code : IBC 2021 (International Building Code) Unit System : Imperial																											
	Pile Input  Geometry Pile shape: rectangular b = 48 in - Pile width D = 48 in - Pile depth L = 6 ft - Total pile length h1 = 0 ft - Lateral load height from the top of the pile, h2 = 0 ft - Depth to resisting surface he = 0 ft - Length of pile above the ground Tabulation of Soil Parameters <table><tr><th>Layer</th><th>Label</th><th>Allowable Bearing Pressure (qa) (psf)</th><th>Allowable Lateral Pressure (R) (psf/ft)</th></tr><tr><td>1</td><td>Sand, silty sand, clayey sand, silty gravel & clayey gravel</td><td>2000.000</td><td>150.000</td></tr></table> Tabulation of Loads <table><tr><th>Load Component</th><th>ASD</th><th>LRFD</th></tr><tr><td>P (kip)</td><td>2.816</td><td>3.939</td></tr><tr><td>Vx (kip)</td><td>-1.962</td><td>-3.269</td></tr><tr><td>Vz (kip)</td><td>-0.073</td><td>-0.113</td></tr><tr><td>Mx (kipft)</td><td>-0.243</td><td>-0.376</td></tr><tr><td>Mz (kipft)</td><td>21.995</td><td>37.154</td></tr></table> Material Properties f'ck = 2.5 ksi - Concrete strength,	Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	P (kip)	2.816	3.939	Vx (kip)	-1.962	-3.269	Vz (kip)	-0.073	-0.113	Mx (kipft)	-0.243	-0.376	Mz (kipft)	21.995	37.154	
Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
P (kip)	2.816	3.939																										
Vx (kip)	-1.962	-3.269																										
Vz (kip)	-0.073	-0.113																										
Mx (kipft)	-0.243	-0.376																										
Mz (kipft)	21.995	37.154																										
	Required depth to resist lateral loads (ASD) H - Point of application of the lateral load $H = h_1 + h_2 + h_e$ $H = (0\text{ ft}) + (0\text{ ft}) + (0\text{ ft})$ $H = 0\text{ ft}$ Considering x-direction: Ho - Lateral force per length of pile, $H_o = \frac{V_x}{1.57\text{ }D}$ $H_o = \frac{(-1.962\text{ kip})}{1.57 \times (48\text{ in})}$ $H_o = -0.31242\text{ kip/ft}$ Mo - Moment per length of pile, $M_o = \frac{M_z + (V_x\text{ }H)}{1.57\text{ }D}$																											

	$M_o = \frac{(21.995 \text{ kipft}) + ((-1.962 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 3.5024 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,x} = 5.5965 \text{ ft}$ - Required depth in x-direction, Considering z-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_z}{1.57 b}$ $H_o = \frac{(-0.073 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = -0.011624 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{1.57 b}$ $M_o = \frac{(0.243 \text{ kipft}) + ((-0.073 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 0.038694 \text{ kipft/ft}$ Required depth of embedment in earth: $L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,z} = 1.2986 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = MAX[L_{e,x}, L_{e,z}]$ $L_{e,req} = MAX[(5.5965 \text{ ft}), (1.2986 \text{ ft})]$ $L_{e,req} = 5.596 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_e - h_2$ $L_e = (6 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 6 \text{ ft}$ <i>Ratio</i> - Embedded depth $Ratio = \frac{L_{e,req}}{L_e}$ $Ratio = \frac{(5.596 \text{ ft})}{(6 \text{ ft})}$ $Ratio = 0.93267$	Status: PASS Ratio: 0.930
	End-bearing Capacity (ASD) A - Pile cross-section area $A = b D$ $A = (48 \text{ in}) \times (48 \text{ in})$ $A = 16 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(2.816 \text{ kip})}{(16 \text{ ft}^2)}$ $q = 0.176 \text{ kips/ft}^2$	


	$q = 0.176 \text{ kip/ft}$	
	Check bearing capacity ratio: Ratio - Capacity $Ratio = \frac{q}{q_a}$ $Ratio = \frac{(0.176 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $Ratio = 0.088$	Status: PASS Ratio: 0.090
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(6 \text{ ft})}{(48 \text{ in})}$ $L/D = 1.5$ Since $L/D \leq 10$, Pile is short. Considering x-direction: $H_o = -0.31242 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 3.5024 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (3.5024 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (3.5024 \text{ kipft/ft})) + (4 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))}$ $a = 4.1315 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 [(4 \times (3.5024 \text{ kipft/ft})) + (3 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))]^2}{(6 \text{ ft})^3 [(3 \times (3.5024 \text{ kipft/ft})) + (2 \times (-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))]}$ $p = 0.21679 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (3.5024 \text{ kipft/ft})) + ((-0.31242 \text{ kip/ft}) \times (6 \text{ ft}))]}{(6 \text{ ft})^2}$ $s = 0.85504 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.1315 \text{ ft})}{2}$ $p_a = 0.30986 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $Ratio = \frac{p}{p_a}$ $Ratio = \frac{(0.21679 \text{ kip/ft}^2)}{(0.30986 \text{ kip/ft}^2)}$ $Ratio = 0.69964$ p_s - Allowable lateral soil pressure at depth L_e,	Status: PASS Ratio: 0.700

	$p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6 \text{ ft})$ $p_s = 0.9 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(0.85504 \text{ kip/ft}^2)}{(0.9 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.95005$	Status: PASS Ratio: 0.950
	Considering z-direction: $H_o = -0.011624 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 0.038694 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.038694 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (-0.011624 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (0.038694 \text{ kipft/ft})) + (4 \times (-0.011624 \text{ kip/ft}) \times (6 \text{ ft}))}$ $a = 4.2729 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 \times [(4 \times (0.038694 \text{ kipft/ft})) + (3 \times (-0.011624 \text{ kip/ft}) \times (6 \text{ ft}))]^2}{(6 \text{ ft})^3 \times [(3 \times (0.038694 \text{ kipft/ft})) + (2 \times (-0.011624 \text{ kip/ft}) \times (6 \text{ ft}))]}$ $p = -0.0026396 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (0.038694 \text{ kipft/ft})) + ((-0.011624 \text{ kip/ft}) \times (6 \text{ ft}))]}{(6 \text{ ft})^2}$ $s = 0.0012739 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.2729 \text{ ft})}{2}$ $p_a = 0.32047 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(-0.0026396 \text{ kip/ft}^2)}{(0.32047 \text{ kip/ft}^2)}$ $\text{Ratio} = -0.0082366$ p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6 \text{ ft})$ $p_s = 0.9 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$	Status: PASS Ratio: -0.010

$$Ratio = \frac{(0.0012739 \text{ kip/ft}^2)}{(0.9 \text{ kip/ft}^2)}$$

$$Ratio = 0.0014154$$

Status: **PASS**
Ratio: **0.000**

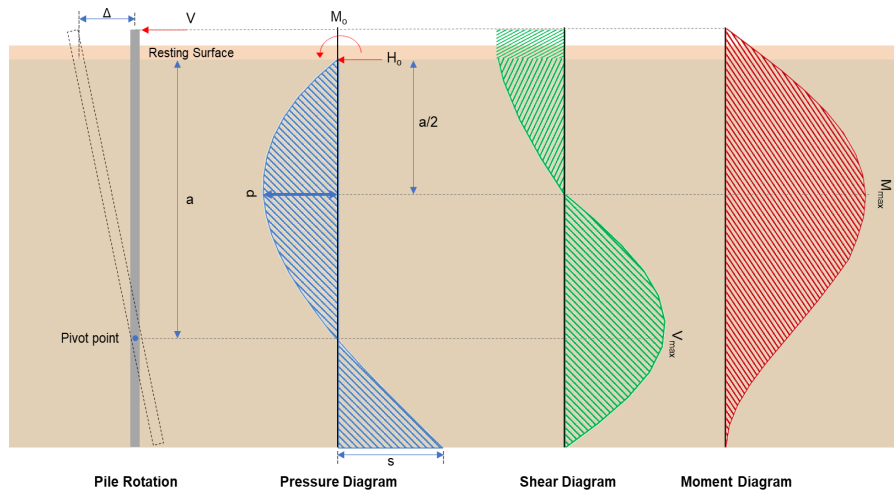

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-3.269 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.52054 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_x H)}{1.57 D}$$

$$M_o = \frac{(37.154 \text{ kipft}) + ((-3.269 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 5.9162 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(5.9162 \text{ kipft/ft})}{(-0.52054 \text{ kip/ft})}$$

$$E = 11.366 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (5.9162 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (-0.52054 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (5.9162 \text{ kipft/ft})) + (4 \times (-0.52054 \text{ kip/ft}) \times (6 \text{ ft}))}$$

$$a = 4.1302 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.52054 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (11.366 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.1302 \text{ ft})}{(6 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (11.366 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.1302 \text{ ft})}{(6 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 8.3533 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.52054 \text{ kip/ft}) \times (48 \text{ in}) \times (6 \text{ ft})) \times \left[\left(\frac{(11.366 \text{ ft})}{(6 \text{ ft})} + \frac{(4.1302 \text{ ft})}{2 \times (6 \text{ ft})} \right) - \left[\left(\frac{4 \times (11.366 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.1302 \text{ ft})}{2 \times (6 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (11.366 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.1302 \text{ ft})}{2 \times (6 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 23.924 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.113 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.017994 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.376 \text{ kipft}) + ((-0.113 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.059873 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.059873 \text{ kipft/ft})}{(-0.017994 \text{ kip/ft})}$$

$$E = 3.3274 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.059873 \text{ kipft/ft}) \times (6 \text{ ft})) + (3 \times (-0.017994 \text{ kip/ft}) \times (6 \text{ ft})^2)}{(6 \times (0.059873 \text{ kipft/ft})) + (4 \times (-0.017994 \text{ kip/ft}) \times (6 \text{ ft}))}$$

$$a = 4.2729 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.017994 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.2729 \text{ ft})}{(6 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.2729 \text{ ft})}{(6 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.11851 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o b L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$


$$M_{max} = ((-0.017994 \text{ kip/ft}) \times (48 \text{ in}) \times (6 \text{ ft})) \times \left[\left(\frac{(3.3274 \text{ ft})}{(6 \text{ ft})} + \frac{(4.2729 \text{ ft})}{2 \times (6 \text{ ft})} \right) - \left[\left(\frac{4 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 3 \right) \times \left(\frac{(4.2729 \text{ ft})}{2 \times (6 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.3274 \text{ ft})}{(6 \text{ ft})} + 2 \right) \times \left(\frac{(4.2729 \text{ ft})}{2 \times (6 \text{ ft})} \right)^4 \right] \right]$$

		$M_{max} = 0.31696 \text{ kipft}$	
		Minimum Reinforcement Check (LRFD) Parameters: $f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength, $f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength, $\phi = 0.65$ - Reduction factor for axial strength, $\alpha = 0.8$ - Alpha factor for axial strength, $A_g = 2304 \text{ in}^2$ - Gross area of concrete, Longitudinal reinforcement: Required reinforcement due to axial load, $A_{st,required}$ $A_{st,required}$ $A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$ $A_{st,required} = \text{Min} \left[\frac{\frac{(3.939 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$ $A_{st,required} = -84.465 \text{ in}^2$ A_{min} - Governing minimum reinforcement area, $A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$ $A_{min} = \text{Max} [(-84.465 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$ $A_{min} = 4.1472 \text{ in}^2$ n_{rebar} - Required number of reinforcement, $n_{rebar} = \frac{A_{min}}{A_{rebar}}$ $n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$ $n_{rebar} = 14$ A_{st} - Actual total reinforcement area, $A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$ $A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$ $A_{st} = 4.2951 \text{ in}^2$ Ratio - Capacity $\text{Ratio} = \frac{A_{min}}{A_{st}}$ $\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$ $\text{Ratio} = 0.96556$ 25.2.3 s_{rebar} - Minimum spacing of reinforcement, $s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$ $s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$ $s_{rebar} = 1.5 \text{ in}$ Ties: 25.7.2.2 Since longitudinal reinforcement is $\leq \text{No. } 10\phi$: Use #3(0.375 in) 25.7.2.1 s_{ties} - Maximum spacing of ties, $s_{ties} = \text{Min} [(16 d_{bar}), (48 d_{ties}), \text{Min}(D, b)]$ $s_{ties} = \text{Min} [(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), \text{Min}((48 \text{ in}), (48 \text{ in}))]$ $s_{ties} = 10 \text{ in}$ Summary: Main reinforcement: 14 - #5 (0.625 in)	Status: PASS Ratio: 0.970

	Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.80 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.80 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2)) \right]$ $\phi P_N = 2675.2 \text{ kip}$ Ratio - Capacity $\text{Ratio} = \frac{P}{\phi P_N}$ $\text{Ratio} = \frac{(3.939 \text{ kip})}{(2675.2 \text{ kip})}$ $\text{Ratio} = 0.0014724$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 48 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (48 \text{ in})$ $d = 38.4 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.64282$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,max} = 296.21 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 3.939 \text{ kip} \rightarrow 3939 \text{ lbf}$, $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(3939 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,a} = 119.01 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,b} = 348.89 \text{ kip}$ V_c - Governing shear strength of concrete $V_c = \text{Min} [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = \text{Min} [(296.21 \text{ kip}), (119.01 \text{ kip}), (348.89 \text{ kip})]$ $V_c = 119.01 \text{ kip}$	

22.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{s,a} = 737.28 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{tes}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ 22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{ysk} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 50.894 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(737.28 \text{ kip}), (50.894 \text{ kip})]$ $V_s = 50.894 \text{ kip}$ 22.5.1.1 ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((119.01 \text{ kip}) + (50.894 \text{ kip}))$ $\phi V_n = 110.44 \text{ kip}$ Considering x-direction: $V_{max} = 8.3533 \text{ kip}$ - Maximum shear force in the x-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(8.3533 \text{ kip})}{(110.44 \text{ kip})}$ $Ratio = 0.075638$ Considering z-direction: $V_{max} = 0.11851 \text{ kip}$ - Maximum shear force in the z-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(0.11851 \text{ kip})}{(110.44 \text{ kip})}$ $Ratio = 0.0010731$	Status: PASS Ratio: 0.080 Status: PASS Ratio: 0.000
	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{b D^3}{6}$ $S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$ $S_m = 18432 \text{ in}^3$	

14.5.2.1b	$\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ ksi}} \times 18432.001 \text{ in}^3$ $\phi M_{n,1} = 249.600 \text{ kipft}$ $\phi M_{n,2}$ $\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$ $\phi M_{n,2} = 2121.6 \text{ kipft}$ Therefore, ϕM_n - Allowable flexural strength, $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$ $\phi M_n = 249.6 \text{ kipft}$ Considering x-direction: $M_{max} = 23.924 \text{ kipft}$ - Maximum moment in the x-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(23.924 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.09585$	Status: PASS Ratio: 0.100
	Considering z-direction: $M_{max} = 0.31696 \text{ kipft}$ - Maximum moment in the z-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(0.31696 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.0012699$	Status: PASS Ratio: 0.000

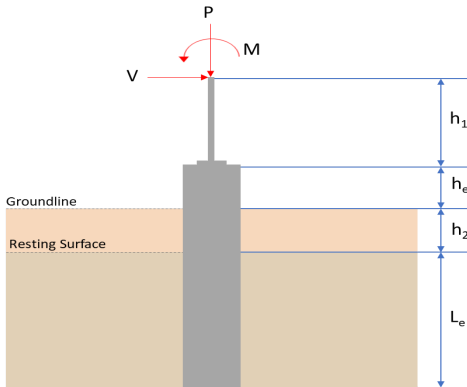REFERENCES	CALCULATIONS	RESULTS																										
	SkyCiv Foundation Design Pile Foundation Design Information : Design code : IBC 2021 (International Building Code) Unit System : Imperial																											
	Pile Input  Geometry Pile shape: rectangular b = 48 in - Pile width D = 48 in - Pile depth L = 6.25 ft - Total pile length h1 = 0 ft - Lateral load height from the top of the pile, h2 = 0 ft - Depth to resisting surface he = 0 ft - Length of pile above the ground Tabulation of Soil Parameters <table><tr><th>Layer</th><th>Label</th><th>Allowable Bearing Pressure (qa) (psf)</th><th>Allowable Lateral Pressure (R) (psf/ft)</th></tr><tr><td>1</td><td>Sand, silty sand, clayey sand, silty gravel & clayey gravel</td><td>2000.000</td><td>150.000</td></tr></table> Tabulation of Loads <table><tr><th>Load Component</th><th>ASD</th><th>LRFD</th></tr><tr><td>P (kip)</td><td>3.161</td><td>4.445</td></tr><tr><td>Vx (kip)</td><td>-2.218</td><td>-3.693</td></tr><tr><td>Vz (kip)</td><td>-0.010</td><td>-0.017</td></tr><tr><td>Mx (kipft)</td><td>-0.031</td><td>-0.053</td></tr><tr><td>Mz (kipft)</td><td>24.794</td><td>41.895</td></tr></table> Material Properties f'ck = 2.5 ksi - Concrete strength,	Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	P (kip)	3.161	4.445	Vx (kip)	-2.218	-3.693	Vz (kip)	-0.010	-0.017	Mx (kipft)	-0.031	-0.053	Mz (kipft)	24.794	41.895	
Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
P (kip)	3.161	4.445																										
Vx (kip)	-2.218	-3.693																										
Vz (kip)	-0.010	-0.017																										
Mx (kipft)	-0.031	-0.053																										
Mz (kipft)	24.794	41.895																										
	Required depth to resist lateral loads (ASD) H - Point of application of the lateral load $H = h_1 + h_2 + h_e$ $H = (0\text{ ft}) + (0\text{ ft}) + (0\text{ ft})$ $H = 0\text{ ft}$ Considering x-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_x}{1.57\text{ }D}$ $H_o = \frac{(-2.218\text{ kip})}{1.57 \times (48\text{ in})}$ $H_o = -0.35318\text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_z + (V_x\text{ }H)}{1.57\text{ }D}$																											

	$M_o = \frac{(24.794 \text{ kipft}) + ((-2.218 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 3.9481 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,x} = 5.7822 \text{ ft}$ - Required depth in x-direction, Considering z-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_z}{1.57 b}$ $H_o = \frac{(-0.01 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = -0.0015924 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{1.57 b}$ $M_o = \frac{(0.031 \text{ kipft}) + ((-0.01 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 0.0049363 \text{ kipft/ft}$ Required depth of embedment in earth: $L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,z} = 0.69057 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$ $L_{e,req} = \text{MAX}[(5.7822 \text{ ft}), (0.69057 \text{ ft})]$ $L_{e,req} = 5.782 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_e - h_2$ $L_e = (6.25 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 6.25 \text{ ft}$ Ratio - Embedded depth $\text{Ratio} = \frac{L_{e,req}}{L_e}$ $\text{Ratio} = \frac{(5.782 \text{ ft})}{(6.25 \text{ ft})}$ $\text{Ratio} = 0.92512$	Status: PASS Ratio: 0.930
	End-bearing Capacity (ASD) A - Pile cross-section area $A = b D$ $A = (48 \text{ in}) \times (48 \text{ in})$ $A = 16 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(3.161 \text{ kip})}{(16 \text{ ft}^2)}$ $q = 0.19756 \text{ kips/ft}^2$	


	$q = 0.19756 \text{ kip/ft}^2$	
	Check bearing capacity ratio: Ratio - Capacity $Ratio = \frac{q}{q_a}$ $Ratio = \frac{(0.19756 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $Ratio = 0.098781$	Status: PASS Ratio: 0.100
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(6.25 \text{ ft})}{(48 \text{ in})}$ $L/D = 1.5625$ Since $L/D \leq 10$, Pile is short. Considering x-direction: $H_o = -0.35318 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 3.9481 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (3.9481 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (3.9481 \text{ kipft/ft})) + (4 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))}$ $a = 4.3081 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 [(4 \times (3.9481 \text{ kipft/ft})) + (3 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))]^2}{(6.25 \text{ ft})^2 [(3 \times (3.9481 \text{ kipft/ft})) + (2 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))]}$ $p = 0.21732 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (3.9481 \text{ kipft/ft})) + ((-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))]}{(6.25 \text{ ft})^2}$ $s = 0.8738 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.3081 \text{ ft})}{2}$ $p_a = 0.32311 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $Ratio = \frac{p}{p_a}$ $Ratio = \frac{(0.21732 \text{ kip/ft}^2)}{(0.32311 \text{ kip/ft}^2)}$ $Ratio = 0.67259$ p_s - Allowable lateral soil pressure at depth L_e,	Status: PASS Ratio: 0.670

	$p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6.25 \text{ ft})$ $p_s = 0.9375 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(0.8738 \text{ kip/ft}^2)}{(0.9375 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.93205$	Status: PASS Ratio: 0.930
	Considering z-direction: $H_o = -0.0015924 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 0.0049363 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.0049363 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (-0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (0.0049363 \text{ kipft/ft})) + (4 \times (-0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))}$ $a = 4.4653 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 \times [(4 \times (0.0049363 \text{ kipft/ft})) + (3 \times (-0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))]^2}{(6.25 \text{ ft})^3 \times [(3 \times (0.0049363 \text{ kipft/ft})) + (2 \times (-0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))]}$ $p = -0.00038525 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (0.0049363 \text{ kipft/ft})) + ((-0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))]}{(6.25 \text{ ft})^2}$ $s = -0.000012229 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.4653 \text{ ft})}{2}$ $p_a = 0.3349 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(-0.00038525 \text{ kip/ft}^2)}{(0.3349 \text{ kip/ft}^2)}$ $\text{Ratio} = -0.0011503$ p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6.25 \text{ ft})$ $p_s = 0.9375 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$	Status: PASS Ratio: 0.000

$$Ratio = \frac{(-0.000012229 \text{ kip/ft}^2)}{(0.9375 \text{ kip/ft}^2)}$$

$$Ratio = -0.000013045$$

Status: **PASS**
Ratio: **0.000**

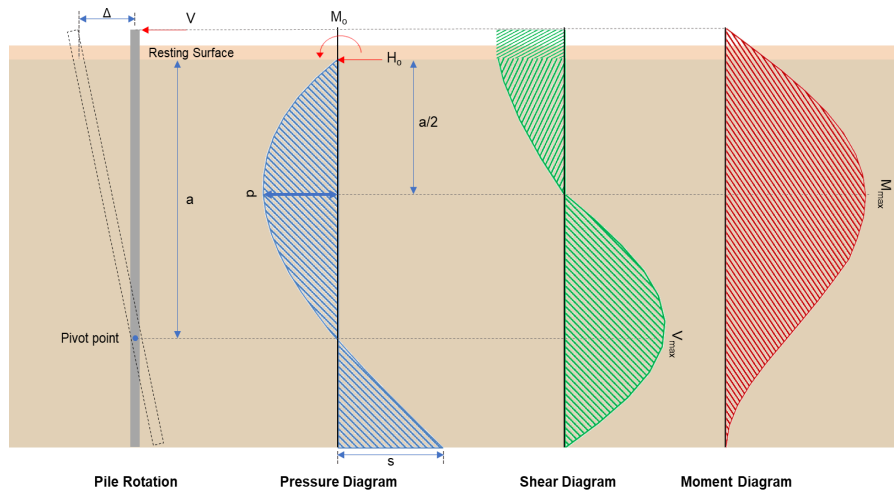

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_e}{1.57 D}$$

$$H_o = \frac{(-3.693 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.58806 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_e + (V_e H)}{1.57 D}$$

$$M_o = \frac{(41.895 \text{ kipft}) + ((-3.693 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 6.6712 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(6.6712 \text{ kipft/ft})}{(-0.58806 \text{ kip/ft})}$$

$$E = 11.344 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (6.6712 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (-0.58806 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (6.6712 \text{ kipft/ft})) + (4 \times (-0.58806 \text{ kip/ft}) \times (6.25 \text{ ft}))}$$

$$a = 4.3066 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.58806 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.3066 \text{ ft})}{(6.25 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.3066 \text{ ft})}{(6.25 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 9.1068 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.58806 \text{ kip/ft}) \times (48 \text{ in}) \times (6.25 \text{ ft})) \times \left[\left(\frac{(11.344 \text{ ft})}{(6.25 \text{ ft})} + \frac{(4.3066 \text{ ft})}{2 \times (6.25 \text{ ft})} \right) - \left[\left(\frac{4 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.3066 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.3066 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 27.123 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.017 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.002707 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.053 \text{ kipft}) + ((-0.017 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.0084395 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.0084395 \text{ kipft/ft})}{(-0.002707 \text{ kip/ft})}$$

$$E = 3.1176 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.0084395 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (-0.002707 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (0.0084395 \text{ kipft/ft})) + (4 \times (-0.002707 \text{ kip/ft}) \times (6.25 \text{ ft}))}$$

$$a = 4.4646 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.002707 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.4646 \text{ ft})}{(6.25 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.4646 \text{ ft})}{(6.25 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.016772 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,


$$M_{max} = (H_o b L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.002707 \text{ kip/ft}) \times (48 \text{ in}) \times (6.25 \text{ ft})) \times \left[\left(\frac{(3.1176 \text{ ft})}{(6.25 \text{ ft})} + \frac{(4.4646 \text{ ft})}{2 \times (6.25 \text{ ft})} \right) - \left[\left(\frac{4 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.4646 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.4646 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^4 \right] \right]$$

	Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.80 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.80 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2)) \right]$ $\phi P_N = 2675.2 \text{ kip}$ Ratio - Capacity $\text{Ratio} = \frac{P}{\phi P_N}$ $\text{Ratio} = \frac{(4.445 \text{ kip})}{(2675.2 \text{ kip})}$ $\text{Ratio} = 0.0016616$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 48 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (48 \text{ in})$ $d = 38.4 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.64282$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,max} = 296.21 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 4.445 \text{ kip} \rightarrow 4445 \text{ lbf}$, $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(4445 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,a} = 119.08 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,b} = 348.89 \text{ kip}$ V_c - Governing shear strength of concrete $V_c = \text{Min} [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = \text{Min} [(296.21 \text{ kip}), (119.08 \text{ kip}), (348.89 \text{ kip})]$ $V_c = 119.08 \text{ kip}$	

22.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{s,a} = 737.28 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{tes}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ 22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{ysk} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 50.894 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(737.28 \text{ kip}), (50.894 \text{ kip})]$ $V_s = 50.894 \text{ kip}$ 22.5.1.1 ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((119.08 \text{ kip}) + (50.894 \text{ kip}))$ $\phi V_n = 110.48 \text{ kip}$ Considering x-direction: $V_{max} = 9.1068 \text{ kip}$ - Maximum shear force in the x-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(9.1068 \text{ kip})}{(110.48 \text{ kip})}$ $Ratio = 0.082429$ Considering z-direction: $V_{max} = 0.016772 \text{ kip}$ - Maximum shear force in the z-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(0.016772 \text{ kip})}{(110.48 \text{ kip})}$ $Ratio = 0.00015181$	Status: PASS Ratio: 0.080 Status: PASS Ratio: 0.000
	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{b D^3}{6}$ $S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$ $S_m = 18432 \text{ in}^3$	

14.5.2.1b	$\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ ksi}} \times 18432.001 \text{ in}^3$ $\phi M_{n,1} = 249.600 \text{ kipft}$ $\phi M_{n,2}$ $\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$ $\phi M_{n,2} = 2121.6 \text{ kipft}$ Therefore, ϕM_n - Allowable flexural strength, $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$ $\phi M_n = 249.6 \text{ kipft}$ Considering x-direction: $M_{max} = 27.123 \text{ kipft}$ - Maximum moment in the x-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(27.123 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.10867$	Status: PASS Ratio: 0.110
	Considering z-direction: $M_{max} = 0.046377 \text{ kipft}$ - Maximum moment in the z-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(0.046377 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.00018581$	Status: PASS Ratio: 0.000

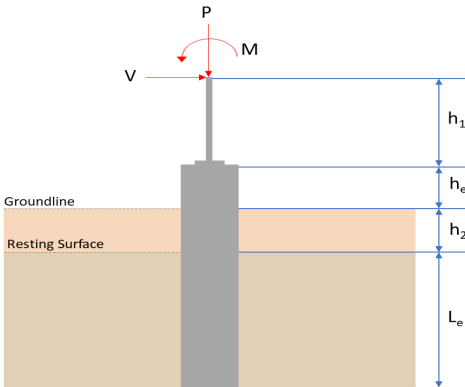REFERENCES	CALCULATIONS	RESULTS																										
	SkyCiv Foundation Design Pile Foundation Design Information : Design code : IBC 2021 (International Building Code) Unit System : Imperial																											
	Pile Input  Geometry Pile shape: rectangular b = 48 in - Pile width D = 48 in - Pile depth L = 6.25 ft - Total pile length h_1 = 0 ft - Lateral load height from the top of the pile, h_2 = 0 ft - Depth to resisting surface h_e = 0 ft - Length of pile above the ground Tabulation of Soil Parameters <table><tr><th>Layer</th><th>Label</th><th>Allowable Bearing Pressure (q_a) (psf)</th><th>Allowable Lateral Pressure (R) (psf/ft)</th></tr><tr><td>1</td><td>Sand, silty sand, clayey sand, silty gravel & clayey gravel</td><td>2000.000</td><td>150.000</td></tr></table> Tabulation of Loads <table><tr><th>Load Component</th><th>ASD</th><th>LRFD</th></tr><tr><td>P (kip)</td><td>3.161</td><td>4.445</td></tr><tr><td>V_x (kip)</td><td>-2.218</td><td>-3.693</td></tr><tr><td>V_z (kip)</td><td>0.010</td><td>0.017</td></tr><tr><td>M_x (kipft)</td><td>0.031</td><td>0.053</td></tr><tr><td>M_z (kipft)</td><td>24.794</td><td>41.895</td></tr></table> Material Properties f'_ck = 2.5 ksi - Concrete strength,	Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	P (kip)	3.161	4.445	V_x (kip)	-2.218	-3.693	V_z (kip)	0.010	0.017	M_x (kipft)	0.031	0.053	M_z (kipft)	24.794	41.895	
Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
P (kip)	3.161	4.445																										
V_x (kip)	-2.218	-3.693																										
V_z (kip)	0.010	0.017																										
M_x (kipft)	0.031	0.053																										
M_z (kipft)	24.794	41.895																										
	Required depth to resist lateral loads (ASD) H - Point of application of the lateral load $H = h_1 + h_2 + h_e$ $H = (0\text{ ft}) + (0\text{ ft}) + (0\text{ ft})$ $H = 0\text{ ft}$ Considering x-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_x}{1.57 D}$ $H_o = \frac{(-2.218\text{ kip})}{1.57 \times (48\text{ in})}$ $H_o = -0.35318\text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_z + (V_x H)}{1.57 D}$																											

	$M_o = \frac{(24.794 \text{ kipft}) + ((-2.218 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 3.9481 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,x} = 5.7822 \text{ ft}$ - Required depth in x-direction, Considering z-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_z}{1.57 b}$ $H_o = \frac{(0.01 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = 0.0015924 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{1.57 b}$ $M_o = \frac{(0.031 \text{ kipft}) + ((0.01 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$ $M_o = 0.0049363 \text{ kipft/ft}$ Required depth of embedment in earth: $L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,z} = 0.77713 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = MAX[L_{e,x}, L_{e,z}]$ $L_{e,req} = MAX[(5.7822 \text{ ft}), (0.77713 \text{ ft})]$ $L_{e,req} = 5.782 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_e - h_2$ $L_e = (6.25 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 6.25 \text{ ft}$ Ratio - Embedded depth $Ratio = \frac{L_{e,req}}{L_e}$ $Ratio = \frac{(5.782 \text{ ft})}{(6.25 \text{ ft})}$ $Ratio = 0.92512$	Status: PASS Ratio: 0.930
	End-bearing Capacity (ASD) A - Pile cross-section area $A = b D$ $A = (48 \text{ in}) \times (48 \text{ in})$ $A = 16 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(3.161 \text{ kip})}{(16 \text{ ft}^2)}$ $q = 0.19756 \text{ kips/ft}^2$	


	$q = 0.19756 \text{ kip/ft}^2$	
	Check bearing capacity ratio: Ratio - Capacity $Ratio = \frac{q}{q_a}$ $Ratio = \frac{(0.19756 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $Ratio = 0.098781$	Status: PASS Ratio: 0.100
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(6.25 \text{ ft})}{(48 \text{ in})}$ $L/D = 1.5625$ Since $L/D \leq 10$, Pile is short. Considering x-direction: $H_o = -0.35318 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 3.9481 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (3.9481 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (3.9481 \text{ kipft/ft})) + (4 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))}$ $a = 4.3081 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 \times [(4 \times (3.9481 \text{ kipft/ft})) + (3 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))]^2}{(6.25 \text{ ft})^3 \times [(3 \times (3.9481 \text{ kipft/ft})) + (2 \times (-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))]}$ $p = 0.21732 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (3.9481 \text{ kipft/ft})) + ((-0.35318 \text{ kip/ft}) \times (6.25 \text{ ft}))]}{(6.25 \text{ ft})^2}$ $s = 0.8738 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.3081 \text{ ft})}{2}$ $p_a = 0.32311 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $Ratio = \frac{p}{p_a}$ $Ratio = \frac{(0.21732 \text{ kip/ft}^2)}{(0.32311 \text{ kip/ft}^2)}$ $Ratio = 0.67259$ p_s - Allowable lateral soil pressure at depth L_e,	Status: PASS Ratio: 0.670

	$p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6.25 \text{ ft})$ $p_s = 0.9375 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(0.8738 \text{ kip/ft}^2)}{(0.9375 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.93205$	Status: PASS Ratio: 0.930
	Considering z-direction: $H_o = 0.0015924 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 0.0049363 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.0049363 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (0.0049363 \text{ kipft/ft})) + (4 \times (0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))}$ $a = 4.4653 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 \times [(4 \times (0.0049363 \text{ kipft/ft})) + (3 \times (0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))]^2}{(6.25 \text{ ft})^3 \times [(3 \times (0.0049363 \text{ kipft/ft})) + (2 \times (0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))]}$ $p = 0.0013608 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 \times [(2 \times (0.0049363 \text{ kipft/ft})) + ((0.0015924 \text{ kip/ft}) \times (6.25 \text{ ft}))]}{(6.25 \text{ ft})^2}$ $s = 0.0030451 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.4653 \text{ ft})}{2}$ $p_a = 0.3349 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(0.0013608 \text{ kip/ft}^2)}{(0.3349 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.0040634$ p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6.25 \text{ ft})$ $p_s = 0.9375 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$	Status: PASS Ratio: 0.000

$$Ratio = \frac{(0.0030451 \text{ kip/ft}^2)}{(0.9375 \text{ kip/ft}^2)}$$

$$Ratio = 0.0032481$$

Status: **PASS**
Ratio: **0.000**

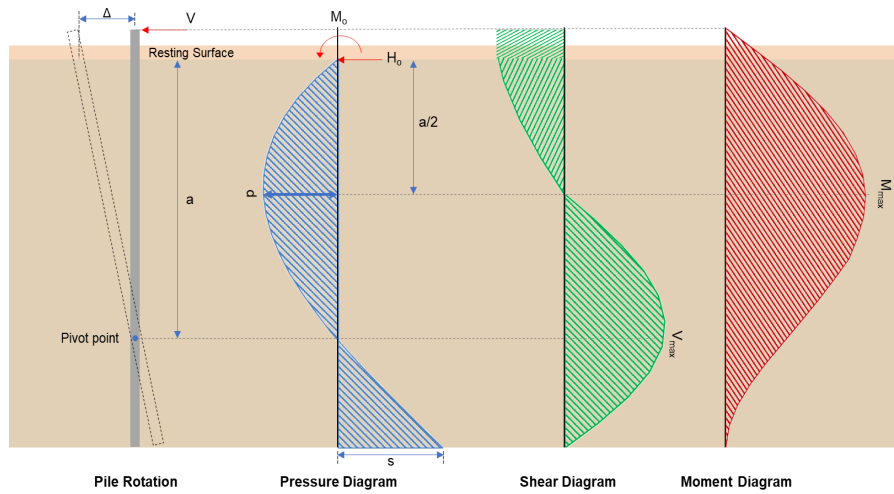

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-3.693 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.58806 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_x H)}{1.57 D}$$

$$M_o = \frac{(41.895 \text{ kipft}) + ((-3.693 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 6.6712 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(6.6712 \text{ kipft/ft})}{(-0.58806 \text{ kip/ft})}$$

$$E = 11.344 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (6.6712 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (-0.58806 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (6.6712 \text{ kipft/ft})) + (4 \times (-0.58806 \text{ kip/ft}) \times (6.25 \text{ ft}))}$$

$$a = 4.3066 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.58806 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.3066 \text{ ft})}{(6.25 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.3066 \text{ ft})}{(6.25 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 9.1068 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.58806 \text{ kip/ft}) \times (48 \text{ in}) \times (6.25 \text{ ft})) \times \left[\left(\frac{(11.344 \text{ ft})}{(6.25 \text{ ft})} + \frac{(4.3066 \text{ ft})}{2 \times (6.25 \text{ ft})} \right) - \left[\left(\frac{4 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.3066 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (11.344 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.3066 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 27.123 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.017 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.002707 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.053 \text{ kipft}) + ((0.017 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.0084395 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.0084395 \text{ kipft/ft})}{(0.002707 \text{ kip/ft})}$$

$$E = 3.1176 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.0084395 \text{ kipft/ft}) \times (6.25 \text{ ft})) + (3 \times (0.002707 \text{ kip/ft}) \times (6.25 \text{ ft})^2)}{(6 \times (0.0084395 \text{ kipft/ft})) + (4 \times (0.002707 \text{ kip/ft}) \times (6.25 \text{ ft}))}$$

$$a = 4.4646 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((0.002707 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.4646 \text{ ft})}{(6.25 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.4646 \text{ ft})}{(6.25 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.016772 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o b L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((0.002707 \text{ kip/ft}) \times (48 \text{ in}) \times (6.25 \text{ ft})) \times \left[\left(\frac{(3.1176 \text{ ft})}{(6.25 \text{ ft})} + \frac{(4.4646 \text{ ft})}{2 \times (6.25 \text{ ft})} \right) - \left[\left(\frac{4 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 3 \right) \times \left(\frac{(4.4646 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.1176 \text{ ft})}{(6.25 \text{ ft})} + 2 \right) \times \left(\frac{(4.4646 \text{ ft})}{2 \times (6.25 \text{ ft})} \right)^4 \right] \right]$$

	Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.80 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.80 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2)) \right]$ $\phi P_N = 2675.2 \text{ kip}$ Ratio - Capacity $\text{Ratio} = \frac{P}{\phi P_N}$ $\text{Ratio} = \frac{(4.445 \text{ kip})}{(2675.2 \text{ kip})}$ $\text{Ratio} = 0.0016616$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 48 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (48 \text{ in})$ $d = 38.4 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.64282$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,max} = 296.21 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 4.445 \text{ kip} \rightarrow 4445 \text{ lbf}$, $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(4445 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,a} = 119.08 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{c,b} = 348.89 \text{ kip}$ V_c - Governing shear strength of concrete $V_c = \text{Min} [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = \text{Min} [(296.21 \text{ kip}), (119.08 \text{ kip}), (348.89 \text{ kip})]$ $V_c = 119.08 \text{ kip}$	

22.5.1.2 22.5.8.5.3 22.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{s,a} = 737.28 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{tes}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{ysk} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 50.894 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(737.28 \text{ kip}), (50.894 \text{ kip})]$ $V_s = 50.894 \text{ kip}$ ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((119.08 \text{ kip}) + (50.894 \text{ kip}))$ $\phi V_n = 110.48 \text{ kip}$ Considering x-direction: $V_{max} = 9.1068 \text{ kip}$ - Maximum shear force in the x-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(9.1068 \text{ kip})}{(110.48 \text{ kip})}$ $Ratio = 0.082429$ Considering z-direction: $V_{max} = 0.016772 \text{ kip}$ - Maximum shear force in the z-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(0.016772 \text{ kip})}{(110.48 \text{ kip})}$ $Ratio = 0.00015181$	Status: PASS Ratio: 0.080 Status: PASS Ratio: 0.000
	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{b D^3}{6}$ $S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$ $S_m = 18432 \text{ in}^3$	

14.5.2.1b	$\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ ksi}} \times 18432.001 \text{ in}^3$ $\phi M_{n,1} = 249.600 \text{ kipft}$ $\phi M_{n,2}$ $\phi M_{n,2} = \phi \times 0.85 \times f'_{ck} \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$ $\phi M_{n,2} = 2121.6 \text{ kipft}$ Therefore, ϕM_n - Allowable flexural strength, $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$ $\phi M_n = 249.6 \text{ kipft}$ Considering x-direction: $M_{max} = 27.123 \text{ kipft}$ - Maximum moment in the x-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(27.123 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.10867$	Status: PASS Ratio: 0.110
	Considering z-direction: $M_{max} = 0.046377 \text{ kipft}$ - Maximum moment in the z-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(0.046377 \text{ kipft})}{(249.6 \text{ kipft})}$ $\text{Ratio} = 0.00018581$	Status: PASS Ratio: 0.000