

# Your Project Calculations



Project Name: MTSOLAR\_0B42E52934K21

S3D Model Link:

[https://platform.skyciv.com/structural?](https://platform.skyciv.com/structural?preload_name=MTSOLAR_0B42E52934K21&preload_path=Shared%20Enterprise%20Folder/MT_Solar_Projects/5_2024)

[preload\\_name=MTSOLAR\\_0B42E52934K21&preload\\_path=Shared%20Enterprise%20Folder/MT\\_Solar\\_Projects/5\\_2024](https://platform.skyciv.com/structural?preload_name=MTSOLAR_0B42E52934K21&preload_path=Shared%20Enterprise%20Folder/MT_Solar_Projects/5_2024)

Public Model Link:

[https://platform.skyciv.com/structural-viewer?project\\_id=4rCafYqQKLV45BcWpzNx2nBcmtaT1rxrjKjDbaPj7rBkJB73WTOBnRsU41vP3vL](https://platform.skyciv.com/structural-viewer?project_id=4rCafYqQKLV45BcWpzNx2nBcmtaT1rxrjKjDbaPj7rBkJB73WTOBnRsU41vP3vL)

## Array Specification

Product:	Beam
Unique ID:	2P-17-6TOP-SD-57-L-4Hx6W-4A9K
Duty Classification:	SD
Module Width:	44.64 in
Module Length:	67.80in
Number of Rows:	4
Number of Columns:	6
Total Number of Modules:	24
Desired Tilt Angle:	50
Front Edge Clearance:	5
Total Array Height at Tilt:	16.46 ft
Total Frame Length:	34.00 ft
Frame Weight:	1532 lbs
Array Dimensions N/S:	15.05 ft
Array Dimensions E/W:	34.40 ft
Rail Length:	180.56 in
Rail Spacing:	2.82 ft
Rail Check:	Not Checked

## Support Specifications


Pole Size:	6in Pipe Sch 80
Pole Length above Grade:	10.76 ft
Number of Poles:	2
Pole Spacing:	17 ft

## Foundation Specifications

Foundation Type:	Square
Foundation Dimensions:	48 x 48 in
Foundation Depth (below grade):	Pile 1: 6.50 ft Pile 2: 6.50 ft
Foundation Volume:	7.704 y <sup>3</sup>
Foundation Result:	PASSED
Mount Twist:	0.952234 kip

## Site Info

Risk Category:	I
Exposure:	C
Soil Classification:	sand
Site Location:	Burlington, VT, USA
Wind Speed:	101 mph
Snow Load:	55 psf
Design Uplift Pressure:	0.022348 ksf
Design Downforce Pressure:	-0.022348 ksf
Design Snow Pressure:	0.012096 ksf

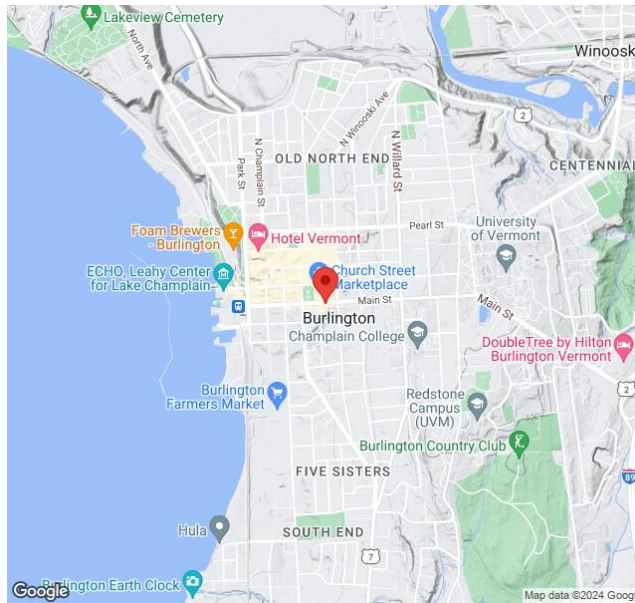

### Design Disclaimer



This software should be used for preliminary designs and should not be used as a final design unless reviewed, verified and designed by a qualified structural engineer.



### AutoDesigner Input


```
{"product_type": "Beam", "project_id": "MTSOLAR_0B42E52934K21", "site_address": "Burlington, VT, USA", "module_width": 44.64, "module_length": 67.8, "number_rows": 4, "number_columns": 6, "pole_mount_section": "4_40", "core_pipe_width": 65, "core_pipe_section": "2_40", "adjuster_section": "2_40", "core_beam_height": 65, "core_beam_section": "HSS3x2x1/8", "main_pipe_section": "2_12GA", "pole_spacing": 15, "tilt_angle": 50, "ground_clearance": 5, "risk_category": "I", "exposure_category": "C", "frame_duty_override": "auto", "pole_override": "auto", "soil_type": "sand", "customer_foundation_override": "48_Square", "foundation_type": "Square", "foundation_size": 48, "check_rails": false, "wind_speed_override": 101, "snow_load_override": 55, "direct_snow_load": false, "add_angle_brace": false}
```

### Design Notes:


- AISC Deflection checks are set to L/1 due to structure design intent
- Foundation Soil Parameters used in this Autodesign are all estimates, proper geotechnical reports are required to confirm soil profiles
- Wind speeds, snow loads and other site specific results are based on ASCE 7 2016
- Steel frame design checks are based on AISC 360 2016 (LRFD)
- Foundation Design and Sizing is approximate only

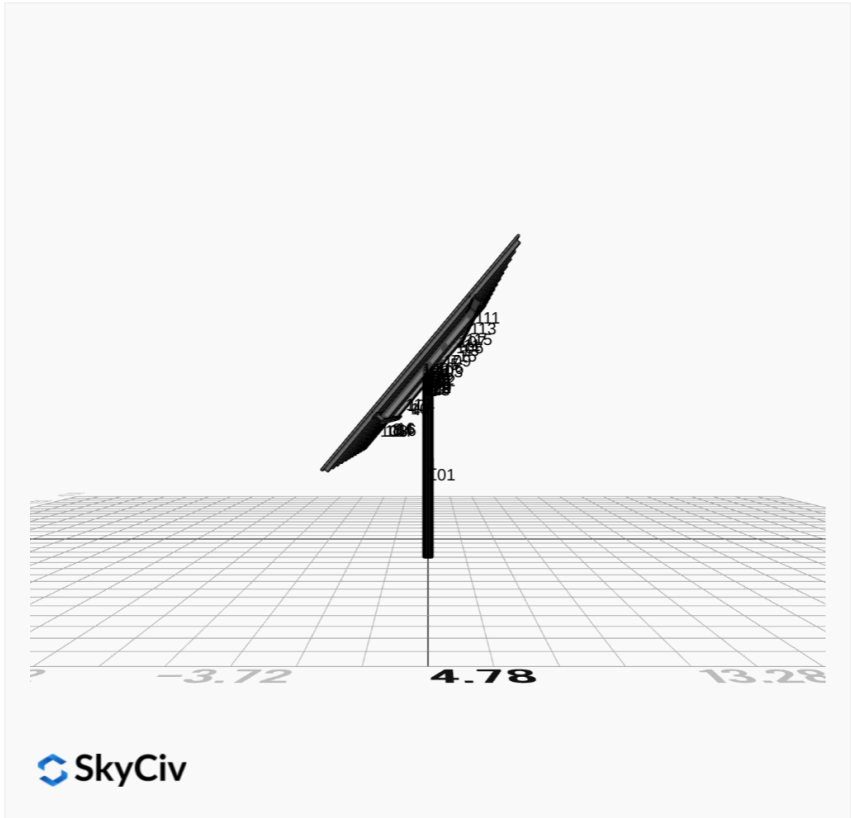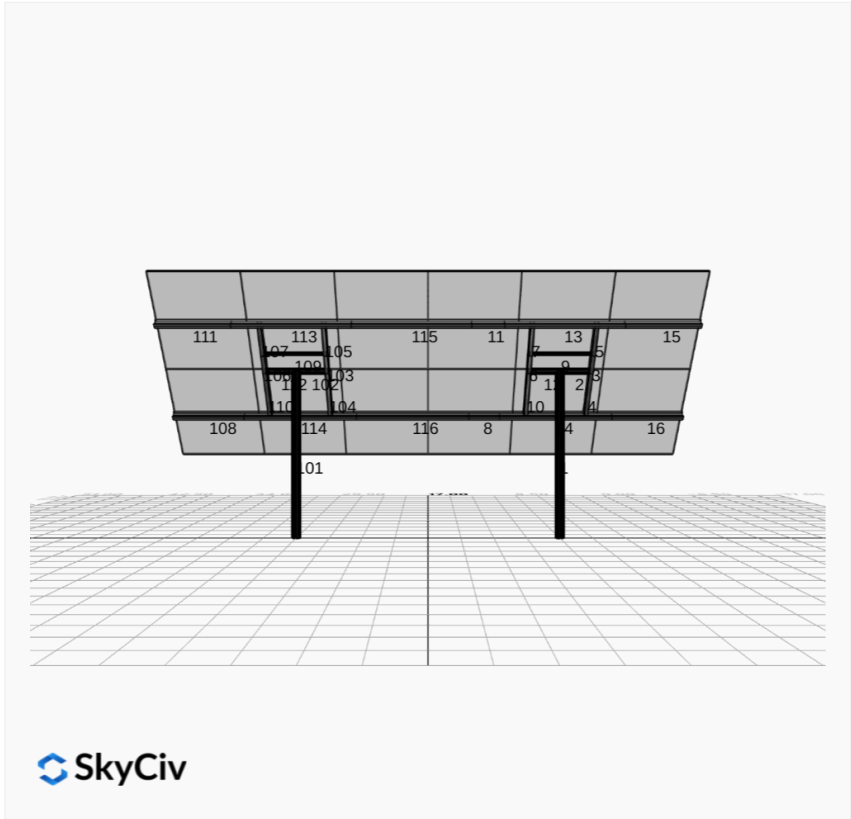

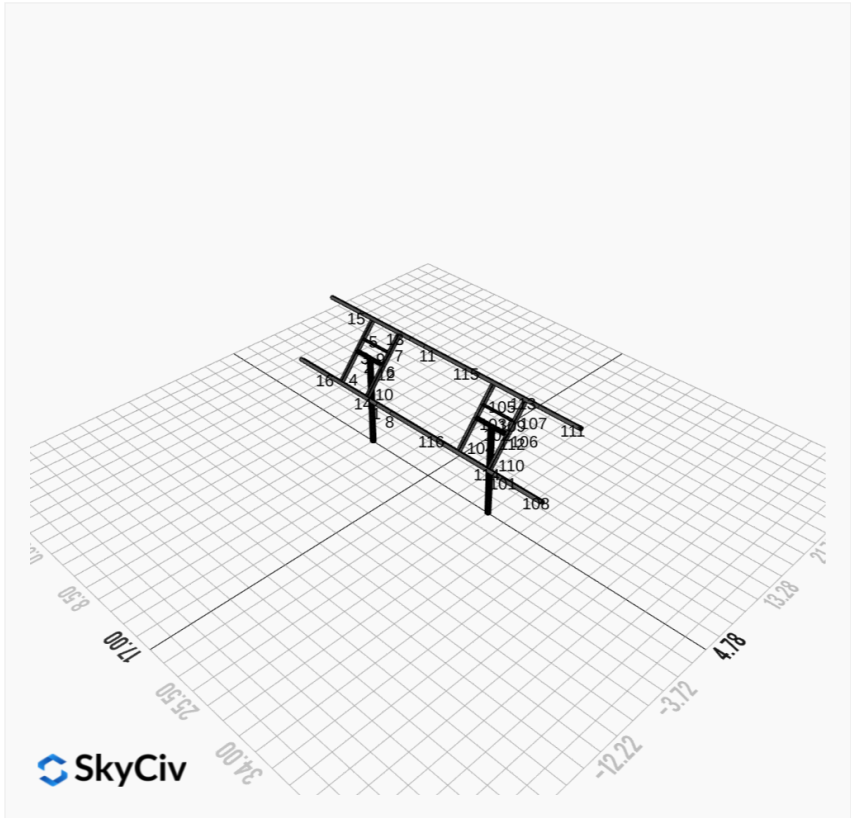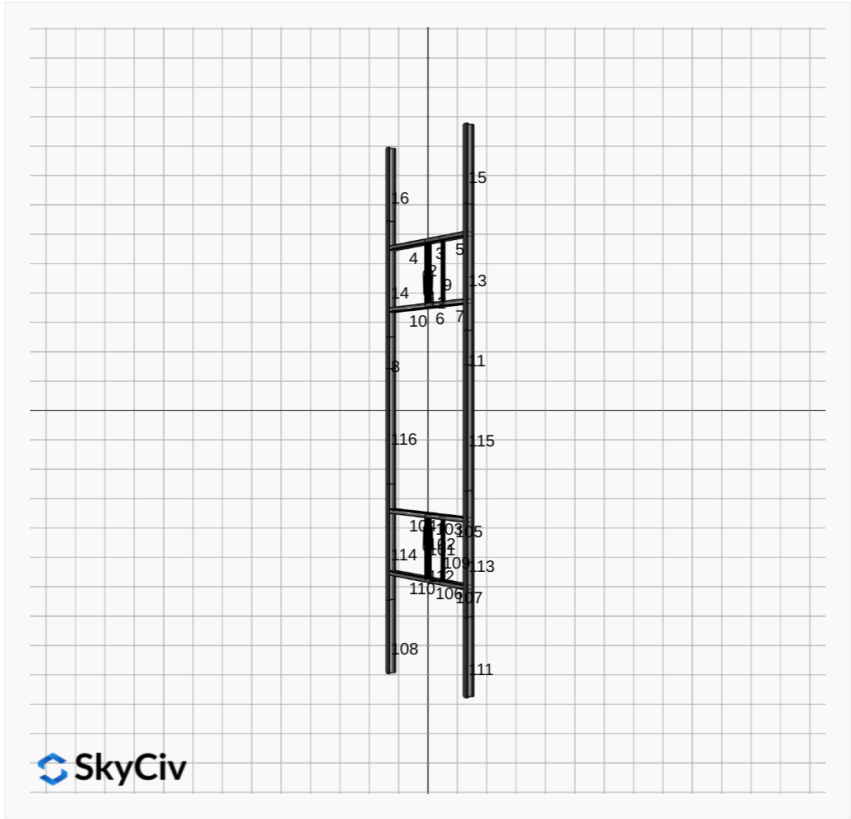


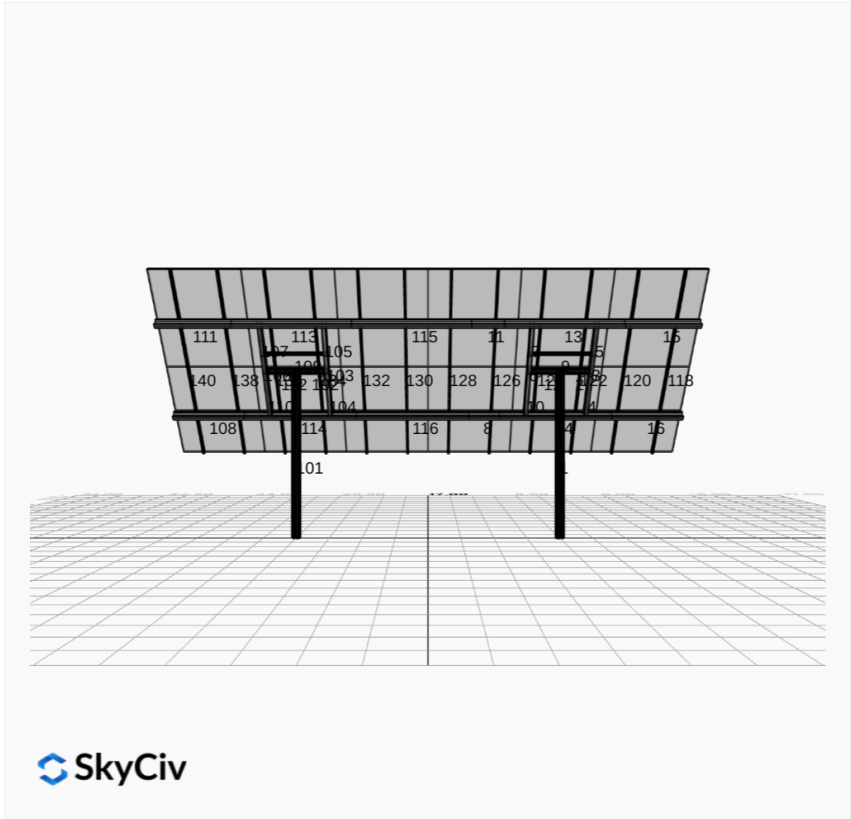



## FEM Results (Envelope Worst Case for each member)


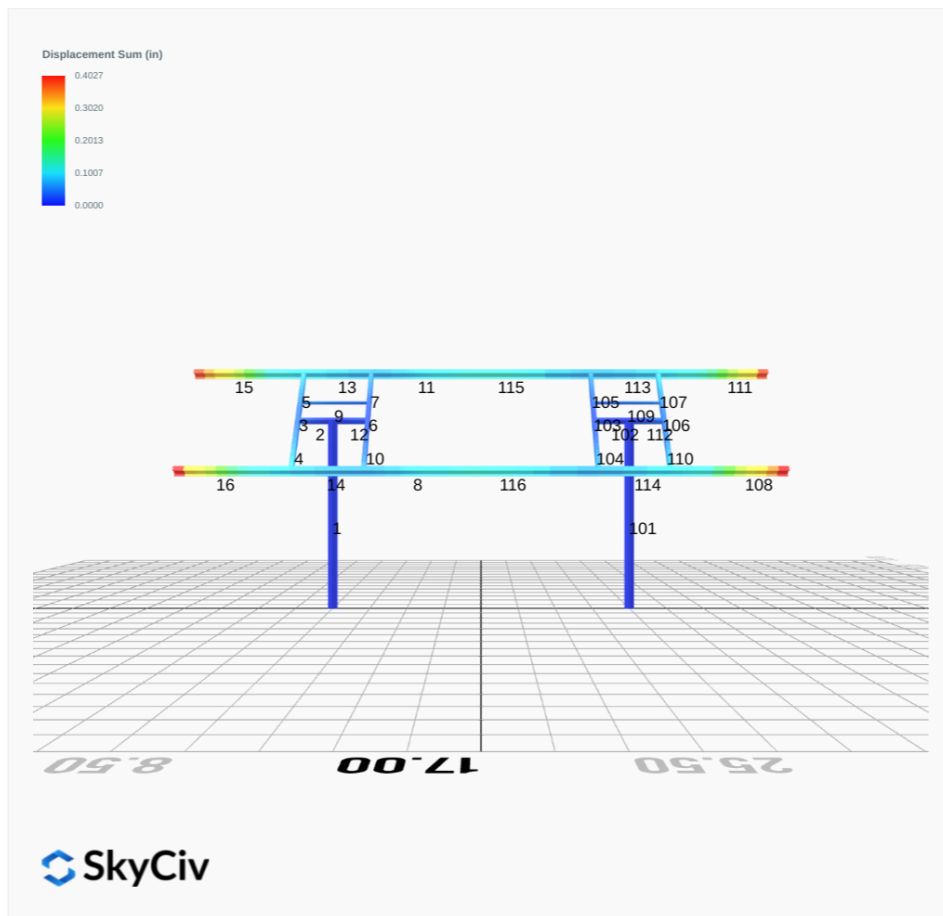



Top Bending Stress Z (ksi)

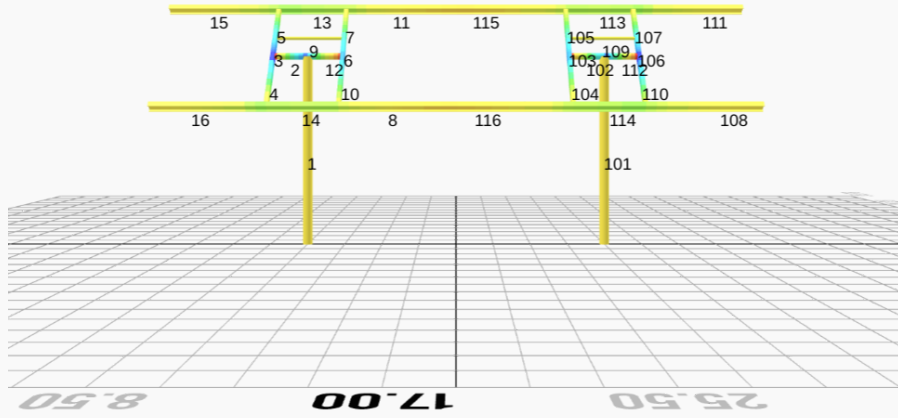

Top Bending Stress Y (ksi)

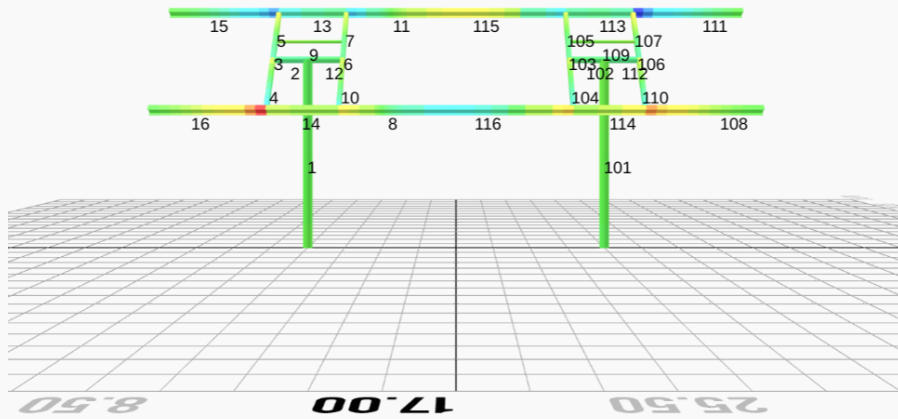

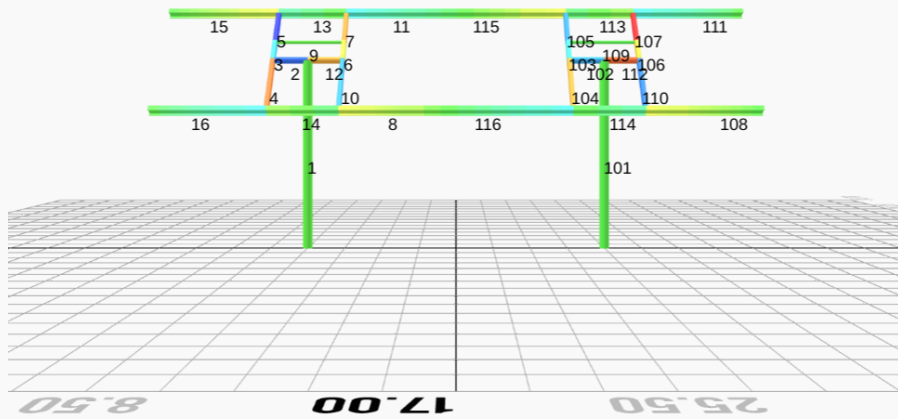

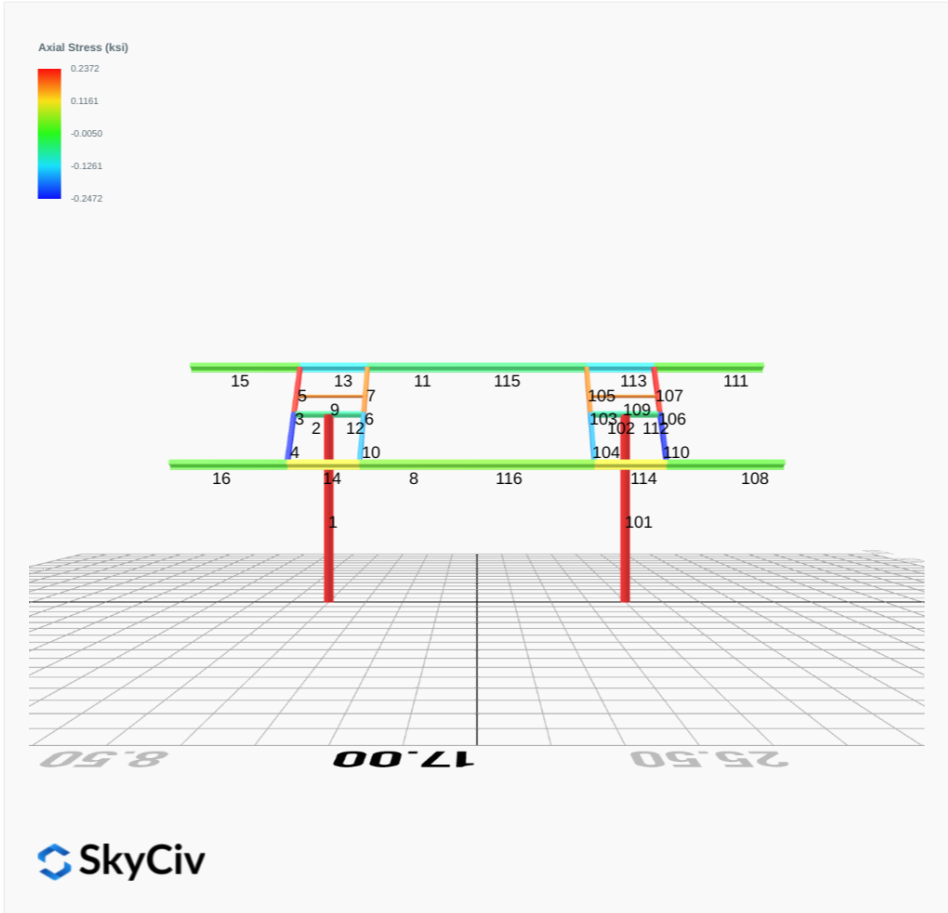

## Reaction Forces for Foundation 1 (Node ID#1), (kip, kip-ft)

### ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 2. D + L	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 3. D + (S or Lr or R)	-0.0000	3.9701	-0.0909	-0.2929	0.2370	0.0235
ULS: 3. D + (S or Lr or R)	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0000	3.4729	-0.0780	-0.2515	0.2036	0.0217
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 5b. D + 0.7E	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0000	3.4729	-0.0780	-0.2515	0.2036	0.0217
ULS: 8. 0.6D + 0.7E	0.0000	1.1888	-0.0237	-0.0764	0.0619	0.0098
ULS: 5a. D + 0.6W_Wind downforce Case A only	-2.6584	4.2119	-0.1542	-0.4877	0.5609	29.1437
ULS: 5a. D + 0.6W_Wind downforce Case B only	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 5a. D + 0.6W_Wind uplift Case A only	2.6584	-0.2494	0.0751	0.2317	-0.3555	-28.1028
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.9938	5.1459	-0.1640	-0.5218	0.5609	21.8673
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0000	3.4729	-0.0780	-0.2515	0.2036	0.0217
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.9938	1.7999	0.0079	0.0178	-0.1404	-21.0676
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0000	3.4729	-0.0780	-0.2515	0.2036	0.0217
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.9938	3.6543	-0.1255	-0.3976	0.4464	21.8619
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.9938	0.3083	0.0465	0.1420	-0.2408	-21.0730
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0000	1.9813	-0.0395	-0.1273	0.1031	0.0163
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-2.6584	3.4194	-0.1384	-0.4368	0.5196	29.1372
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	0.0000	1.1888	-0.0237	-0.0764	0.0619	0.0098
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	2.6584	-1.0419	0.0909	0.2826	-0.3967	-28.1093
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.0000	1.1888	-0.0237	-0.0764	0.0619	0.0098

### Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.  
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	7.4185
Shear X	-4.4306
Shear Z	-0.2642
Moment X	-0.8373
Moment Y (Twist)	0.9520
Moment Z	49.4389

### Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.  
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	5.1459
Shear X	-2.6584
Shear Z	-0.1640
Moment X	-0.5218
Moment Y (Twist)	0.5609
Moment Z	29.1437

## Reaction Forces for Foundation 2 (Node ID#101), (kip, kip-ft)

### ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 2. D + L	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 3. D + (S or Lr or R)	0.0000	3.9701	0.0909	0.2929	-0.2370	0.0235
ULS: 3. D + (S or Lr or R)	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0000	3.4729	0.0780	0.2515	-0.2036	0.0217
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 5b. D + 0.7E	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0000	3.4729	0.0780	0.2515	-0.2036	0.0217
ULS: 8. 0.6D + 0.7E	-0.0000	1.1888	0.0237	0.0764	-0.0619	0.0098
ULS: 5a. D + 0.6W_Wind downforce Case A only	-2.6584	4.2119	0.1542	0.4877	-0.5609	29.1437
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 5a. D + 0.6W_Wind uplift Case A only	2.6584	-0.2494	-0.0751	-0.2317	0.3555	-28.1028
ULS: 5a. D + 0.6W_Wind uplift Case B only	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.9938	5.1459	0.1640	0.5218	-0.5469	21.8673
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0000	3.4729	0.0780	0.2515	-0.2036	0.0217
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.9938	1.7999	-0.0079	-0.0177	0.1404	-21.0676
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0000	3.4729	0.0780	0.2515	-0.2036	0.0217
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.9938	3.6543	0.1255	0.3976	-0.4464	21.8619
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.9938	0.3083	-0.0465	-0.1420	0.2409	-21.0730
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0000	1.9813	0.0395	0.1273	-0.1031	0.0163
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-2.6584	3.4194	0.1384	0.4368	-0.5196	29.1372
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.0000	1.1888	0.0237	0.0764	-0.0619	0.0098
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	2.6584	-1.0419	-0.0909	-0.2826	0.3967	-28.1093
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	-0.0000	1.1888	0.0237	0.0764	-0.0619	0.0098

#### Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.  
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	7.4185
Shear X	-4.4306
Shear Z	0.2642
Moment X	0.8373
Moment Y (Twist)	0.9522
Moment Z	49.4397

#### Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.  
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	5.1459
Shear X	-2.6584
Shear Z	0.1640
Moment X	0.5218
Moment Y (Twist)	0.5609
Moment Z	29.1437

## Project Details

Design Code: AISC 360-16 LRFD  
 Provision: LRFD  
 Country: United States

User Name: sales@mtsolar.us  
 Project Name: MTSOLAR\_0B42E52934K21  
 Unit System: imperial



## Design Input Information

Design Factors			
$\Phi_t$	$\Phi_c$	$\Phi_b$	$\Phi_v$
0.9	0.9	0.9	0.9

Design Materials			
ID	E (ksi)	F <sub>y</sub> (ksi)	F <sub>u</sub> (ksi)
1	29000	50	65

Section Dimensions			

ID	Name	d (in)	t <sub>w</sub> (in)				
1	2in Pipe Sch 40	2.38	0.15				
4	4in Pipe Sch 40	4.50	0.24				
8	6in Pipe Sch 80	6.63	0.43				

Section Dimensions			

ID	Name	d (in)	b (in)	t <sub>w</sub> (in)	t <sub>b</sub> (in)	r (in)	
15	HSS5x3x1/8	5.00	3.00	0.12	0.12	0.12	

Section Dimensions			

ID	Name	d (in)	t <sub>w</sub> (in)	b <sub>t</sub> (in)	b <sub>b</sub> (in)	t <sub>t</sub> (in)	t <sub>b</sub> (in)	r (in)
18	W6x9	5.90	0.17	3.94	3.94	0.21	0.21	0.25

Section Properties								
ID	Name	A (in <sup>2</sup> )	J (in <sup>4</sup> )	I <sub>yp</sub> (in <sup>4</sup> )	I <sub>zp</sub> (in <sup>4</sup> )	I <sub>w</sub> (in <sup>6</sup> )	S <sub>yp</sub> (in <sup>3</sup> )	S <sub>zp</sub> (in <sup>3</sup> )
1	2in Pipe Sch 40	1.07	1.33	0.67	0.67	0.00	0.76	0.76
4	4in Pipe Sch 40	3.17	14.47	7.23	7.23	0.00	4.31	4.31





115	120.60	84.26	21.77	6.45	30.09	45.74
116	120.60	84.26	21.80	6.45	30.09	45.74


## Design Ratio

Member ID	P	M <sub>z</sub>	M <sub>y</sub>	V <sub>y</sub>	V <sub>z</sub>	(P,M <sub>z</sub> ,M <sub>y</sub> )	Worst LC	KL/r	δ	Status
1	0.060	0.794	0.032	0.039	0.002	0.836	#13	0.618	Not Required	Pass
2	0.003	0.409	0.309	0.092	0.056	0.718	#13	0.052	Not Required	Pass
3	0.014	0.722	0.167	0.073	0.021	0.829	#13	0.044	Not Required	Pass
4	0.015	0.719	0.345	0.072	0.042	0.804	#13	0.078	Not Required	Pass
5	0.015	0.447	0.358	0.072	0.051	0.495	#13	0.073	Not Required	Pass
6	0.012	0.597	0.102	0.059	0.007	0.650	#13	0.044	Not Required	Pass
7	0.012	0.372	0.249	0.060	0.037	0.406	#13	0.073	Not Required	Pass
8	0.002	0.065	0.076	0.035	0.012	0.110	#21	0.088	Not Required	Pass
9	0.012	0.059	0.084	0.002	0.002	0.146	#13	0.198	Not Required	Pass
10	0.011	0.593	0.273	0.060	0.036	0.747	#13	0.078	Not Required	Pass
11	0.002	0.064	0.076	0.035	0.012	0.110	#21	0.059	Not Required	Pass
12	0.003	0.289	0.250	0.073	0.048	0.536	#13	0.034	Not Required	Pass
13	0.007	0.244	0.370	0.048	0.016	0.566	#21	0.177	Not Required	Pass
14	0.008	0.249	0.370	0.048	0.016	0.566	#21	0.177	Not Required	Pass
15	0.000	0.108	0.198	0.035	0.012	0.284	#21	Not Required	Not Required	Pass
16	0.000	0.108	0.198	0.035	0.012	0.284	#21	Not Required	Not Required	Pass
101	0.060	0.794	0.032	0.039	0.002	0.836	#13	0.618	Not Required	Pass
102	0.003	0.289	0.250	0.073	0.048	0.536	#13	0.034	Not Required	Pass
103	0.012	0.597	0.102	0.059	0.007	0.650	#13	0.044	Not Required	Pass
104	0.011	0.593	0.273	0.060	0.036	0.747	#13	0.078	Not Required	Pass
105	0.012	0.372	0.249	0.060	0.037	0.406	#13	0.073	Not Required	Pass
106	0.014	0.722	0.167	0.073	0.021	0.829	#13	0.044	Not Required	Pass
107	0.015	0.447	0.358	0.072	0.051	0.495	#13	0.073	Not Required	Pass
108	0.000	0.108	0.198	0.035	0.012	0.284	#21	Not Required	Not Required	Pass
109	0.012	0.059	0.084	0.002	0.002	0.146	#13	0.198	Not Required	Pass
110	0.015	0.719	0.345	0.072	0.042	0.804	#13	0.078	Not Required	Pass
111	0.000	0.108	0.198	0.035	0.012	0.284	#21	Not Required	Not Required	Pass
112	0.003	0.409	0.309	0.092	0.056	0.718	#13	0.052	Not Required	Pass
113	0.007	0.244	0.370	0.048	0.016	0.566	#21	0.177	Not Required	Pass
114	0.008	0.249	0.370	0.048	0.016	0.566	#21	0.265	Not Required	Pass
115	0.002	0.064	0.139	0.035	0.012	0.176	#21	0.214	Not Required	Pass
116	0.003	0.065	0.140	0.035	0.012	0.175	#21	0.321	Not Required	Pass

## Definitions

$\Phi_t$	Safety factor for tensile
$\Phi_c$	Safety factor for compression
$\Phi_b$	Safety factor for flexure
$\Phi_v$	Safety factor for shear
E	Modulus of elasticity
F <sub>y</sub>	Specified minimum yield stress
F <sub>u</sub>	Specified minimum tensile strength
A	Cross-sectional area
J	Torsional constant
I <sub>yp</sub>	Moment of inertia about the Y axes
I <sub>zp</sub>	Moment of inertia about the Z axes
I <sub>w</sub>	Warping constant
S <sub>yp</sub>	Plastic section modulus about the Y axis
S <sub>zp</sub>	Plastic section modulus about the Z axis
KL	Effective length
C <sub>n</sub>	Buckling modification factor (from all load combinations)

$L_b$	Length between braced points
LST	Limited slenderness for tension
LSC	Limited slenderness for compression
LD	Limited deflection
$P_n$	Nominal axial strength (tension/compression)
$M_n$	Nominal flexural strength (about Z/Y axis)
$V_n$	Nominal shear strength (along Z/Y axis)
P	Design ratio in case of axial force
$M_z$	Design ratio in case of bending about Z axis
$M_y$	Design ratio in case of bending about Y axis
$V_y$	Design ratio in case of shear along Y axis
$V_z$	Design ratio in case of shear along Z axis
(P, $M_z$ , $M_y$ )	Design ratio in case of axial force and bending action
KL/r	Design ratio in case of section slenderness
$\delta$	Design ratio in case of member deflection
OK	Capacity is provided
NG	Capacity is not provided

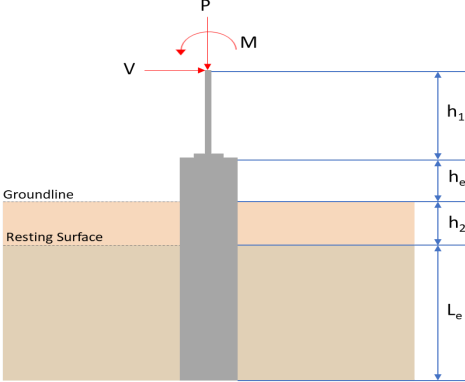REFERENCES	CALCULATIONS	RESULTS																										
	<p><b>SkyCiv Foundation Design</b> Pile Foundation</p> <p><b>Design Information :</b> Design code : IBC 2021 (International Building Code) Unit System : Imperial</p>																											
	<p><b>Pile Input</b></p>  <p><b>Geometry</b> Pile shape: rectangular <math>b = 48</math> in - Pile width <math>D = 48</math> in - Pile depth <math>L = 6.5</math> ft - Total pile length <math>h_1 = 0</math> ft - Lateral load height from the top of the pile, <math>h_2 = 0</math> ft - Depth to resisting surface <math>h_e = 0</math> ft - Length of pile above the ground</p> <p><b>Tabulation of Soil Parameters</b></p> <table border="1" data-bbox="416 1102 1193 1191"> <thead> <tr> <th>Layer</th> <th>Label</th> <th>Allowable Bearing Pressure (<math>q_a</math>) (psf)</th> <th>Allowable Lateral Pressure (<math>R</math>) (psf/ft)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Sand, silty sand, clayey sand, silty gravel &amp; clayey gravel</td> <td>2000.000</td> <td>150.000</td> </tr> </tbody> </table> <p><b>Tabulation of Loads</b></p> <table border="1" data-bbox="676 1288 935 1458"> <thead> <tr> <th>Load Component</th> <th>ASD</th> <th>LRFD</th> </tr> </thead> <tbody> <tr> <td><math>P</math> (kip)</td> <td>5.146</td> <td>7.419</td> </tr> <tr> <td><math>V_x</math> (kip)</td> <td>-2.658</td> <td>-4.431</td> </tr> <tr> <td><math>V_z</math> (kip)</td> <td>-0.164</td> <td>-0.264</td> </tr> <tr> <td><math>M_x</math> (kipft)</td> <td>-0.522</td> <td>-0.837</td> </tr> <tr> <td><math>M_z</math> (kipft)</td> <td>29.144</td> <td>49.439</td> </tr> </tbody> </table> <p><b>Material Properties</b> <math>f'_{ck} = 2.5</math> ksi - Concrete strength,</p>	Layer	Label	Allowable Bearing Pressure ( $q_a$ ) (psf)	Allowable Lateral Pressure ( $R$ ) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	$P$ (kip)	5.146	7.419	$V_x$ (kip)	-2.658	-4.431	$V_z$ (kip)	-0.164	-0.264	$M_x$ (kipft)	-0.522	-0.837	$M_z$ (kipft)	29.144	49.439	
Layer	Label	Allowable Bearing Pressure ( $q_a$ ) (psf)	Allowable Lateral Pressure ( $R$ ) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
$P$ (kip)	5.146	7.419																										
$V_x$ (kip)	-2.658	-4.431																										
$V_z$ (kip)	-0.164	-0.264																										
$M_x$ (kipft)	-0.522	-0.837																										
$M_z$ (kipft)	29.144	49.439																										
	<p><b>Required depth to resist lateral loads (ASD)</b> <math>H</math> - Point of application of the lateral load</p> $H = h_1 + h_2 + h_e$ $H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$ $H = 0 \text{ ft}$ <p><b>Considering x-direction:</b> <math>H_o</math> - Lateral force per length of pile,</p> $H_o = \frac{V_x}{1.57 D}$ $H_o = \frac{(-2.658 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = -0.42325 \text{ kip/ft}$ <p><math>M_o</math> - Moment per length of pile,</p> $M_o = \frac{M_z + (V_x H)}{1.57 D}$																											

$$M_o = \frac{(29.144 \text{ kipft}) + ((-2.658 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 4.6408 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$$

Solving the cubic equation:

$L_{e,x} = 6.0216 \text{ ft}$  - Required depth in x-direction,

**Considering z-direction:**

$H_o$  - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.164 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.026115 \text{ kip/ft}$$

$M_o$  - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.522 \text{ kipft}) + ((-0.164 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.083121 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$$

Solving the cubic equation:

$L_{e,z} = 1.6051 \text{ ft}$  - Required depth in z-direction,

**Minimum embedded depth required:**

$L_{e,req}$  - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$$

$$L_{e,req} = \text{MAX}[(6.0216 \text{ ft}), (1.6051 \text{ ft})]$$

$$L_{e,req} = 6.022 \text{ ft}$$

$L_e$  - Actual embedded length of pile,

$$L_e = L - h_c - h_2$$

$$L_e = (6.5 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 6.5 \text{ ft}$$

**Ratio** - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(6.022 \text{ ft})}{(6.5 \text{ ft})}$$

$$\text{Ratio} = 0.92646$$

Status: **PASS**  
Ratio: **0.930**

**End-bearing Capacity (ASD)**

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_c}{A}$$

$$q = \frac{(5.146 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.32163 \text{ kip/ft}^2$$

$$q = 0.32162 \text{ kip/ft}$$

**Check bearing capacity ratio:**

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.32162 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.16081$$

Status: **PASS**  
Ratio: **0.160**

Czerniak

**Lateral Soil Pressure (ASD):**

$L/D$  - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(6.5 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.625$$

Since  $L/D \leq 10$ ,

Pile is short.

**Considering x-direction:**

$H_o = -0.42325 \text{ kip/ft}$  - Lateral force per length of pile,

$M_o = 4.6408 \text{ kipft/ft}$  - Overturning moment per length of pile,

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (4.6408 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (4.6408 \text{ kipft/ft})) + (4 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.4868 \text{ ft}$$

$p$  - Earth pressure against the pile at distance  $a/2$  from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 [(4 \times (4.6408 \text{ kipft/ft})) + (3 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))]^2}{(6.5 \text{ ft})^2 [(3 \times (4.6408 \text{ kipft/ft})) + (2 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))]}$$

$$p = 0.22408 \text{ kip/ft}^2$$

$s$  - Earth pressure against the pile at distance  $L_e$ ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 [(2 \times (4.6408 \text{ kipft/ft})) + ((-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))]}{(6.5 \text{ ft})^2}$$

$$s = 0.9274 \text{ kip/ft}^2$$

**Check lateral soil pressure capacity:**

$p_a$  - Allowable lateral soil pressure at depth  $a/2$ ,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(4.4868 \text{ ft})}{2}$$

$$p_a = 0.33651 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{p}{p_a}$$

$$\text{Ratio} = \frac{(0.22408 \text{ kip/ft}^2)}{(0.33651 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.66591$$

$p_a$  - Allowable lateral soil pressure at depth  $L_e$ ,

Status: **PASS**  
Ratio: **0.670**

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (6.5 \text{ ft})$$

$$p_s = 0.975 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{s}{p_s}$$

$$\text{Ratio} = \frac{(0.9274 \text{ kip/ft}^2)}{(0.975 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.95118$$

Status: **PASS**  
Ratio: **0.950**

**Considering z-direction:**

$H_o = -0.026115 \text{ kip/ft}$  - Lateral force per length of pile,

$M_o = 0.083121 \text{ kipft/ft}$  - Overturning moment per length of pile,

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.083121 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (-0.026115 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (0.083121 \text{ kipft/ft})) + (4 \times (-0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.6456 \text{ ft}$$

$p$  - Earth pressure against the pile at distance  $a/2$  from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (0.083121 \text{ kipft/ft})) + (3 \times (-0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))]^2}{(6.5 \text{ ft})^2 \times [(3 \times (0.083121 \text{ kipft/ft})) + (2 \times (-0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))]}$$

$$p = -0.0061532 \text{ kip/ft}^2$$

$s$  - Earth pressure against the pile at distance  $L_e$ ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (0.083121 \text{ kipft/ft})) + ((-0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))]}{(6.5 \text{ ft})^2}$$

$$s = -0.00049749 \text{ kip/ft}^2$$

**Check lateral soil pressure capacity:**

$p_a$  - Allowable lateral soil pressure at depth  $a/2$ ,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(4.6456 \text{ ft})}{2}$$

$$p_a = 0.34842 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{p}{p_a}$$

$$\text{Ratio} = \frac{(-0.0061532 \text{ kip/ft}^2)}{(0.34842 \text{ kip/ft}^2)}$$

$$\text{Ratio} = -0.01766$$

$p_s$  - Allowable lateral soil pressure at depth  $L_e$ ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (6.5 \text{ ft})$$

$$p_s = 0.975 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{s}{p_s}$$

Status: **PASS**  
Ratio: **-0.020**

$$Ratio = \frac{(-0.00049749 \text{ kip/ft}^2)}{(0.975 \text{ kip/ft}^2)}$$

$$Ratio = -0.00051025$$

Status: **PASS**  
Ratio: **0.000**



#### Shear force and Bending moment (x-direction, LRFD)

$H_o$  - Lateral force per length of pile,

$$H_o = \frac{V_e}{1.57 D}$$

$$H_o = \frac{(-4.431 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.70557 \text{ kip/ft}$$

$M_o$  - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(49.439 \text{ kipft}) + ((-4.431 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 7.8725 \text{ kipft/ft}$$

$E$  - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(7.8725 \text{ kipft/ft})}{(-0.70557 \text{ kip/ft})}$$

$$E = 11.158 \text{ ft}$$

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (7.8725 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (-0.70557 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (7.8725 \text{ kipft/ft})) + (4 \times (-0.70557 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.4849 \text{ ft}$$

$V_{max}$  - Max shear force located at depth  $a$ ,

$$V_{max} = (H_o D) \left[ 1 - \left[ 3 \left( \frac{4 E}{L_e} + 3 \right) \left( \frac{a}{L_e} \right)^2 \right] + \left[ 4 \left( \frac{3 E}{L_e} + 2 \right) \left( \frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.70557 \text{ kip/ft}) \times (48 \text{ in})) \times \left[ 1 - \left[ 3 \times \left( \frac{4 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.4849 \text{ ft})}{(6.5 \text{ ft})} \right)^2 \right] + \left[ 4 \times \left( \frac{3 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.4849 \text{ ft})}{(6.5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 10.434 \text{ kip}$$

$M_{max}$  - Max bending moment located at depth  $a/2$ ,

$$M_{max} = (H_o D L_e) \left[ \left( \frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[ \left( \frac{4E}{L_e} + 3 \right) \left( \frac{a}{2 L_e} \right)^3 + \left[ \left( \frac{3E}{L_e} + 2 \right) \left( \frac{a}{2 L_e} \right)^4 \right] \right] \right]$$

$$M_{max} = ((-0.70557 \text{ kip/ft}) \times (48 \text{ in}) \times (6.5 \text{ ft})) \times \left[ \left( \frac{(11.158 \text{ ft})}{(6.5 \text{ ft})} + \frac{(4.4849 \text{ ft})}{2 \times (6.5 \text{ ft})} \right) - \left[ \left( \frac{4 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.4849 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^3 + \left[ \left( \frac{3 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.4849 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^4 \right] \right] \right]$$

$$M_{max} = 32.245 \text{ kipft}$$

### Shear force and Bending moment (z-direction, LRFD)

$H_o$  - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.264 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.042038 \text{ kip/ft}$$

$M_o$  - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.837 \text{ kipft}) + ((-0.264 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.13328 \text{ kipft/ft}$$

$E$  - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.13328 \text{ kipft/ft})}{(-0.042038 \text{ kip/ft})}$$

$$E = 3.1705 \text{ ft}$$

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.13328 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (-0.042038 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (0.13328 \text{ kipft/ft})) + (4 \times (-0.042038 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.6461 \text{ ft}$$

$V_{max}$  - Max shear force located at depth  $a$ ,

$$V_{max} = (H_o b) \left[ 1 - \left[ 3 \left( \frac{4E}{L_e} + 3 \right) \left( \frac{a}{L_e} \right)^2 + 4 \left( \frac{3E}{L_e} + 2 \right) \left( \frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.042038 \text{ kip/ft}) \times (48 \text{ in})) \times \left[ 1 - \left[ 3 \times \left( \frac{4 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.6461 \text{ ft})}{(6.5 \text{ ft})} \right)^2 + 4 \times \left( \frac{3 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.6461 \text{ ft})}{(6.5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.25721 \text{ kip}$$

$M_{max}$  - Max bending moment located at depth  $a/2$ ,

$$M_{max} = (H_o b L_e) \left[ \left( \frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[ \left( \frac{4E}{L_e} + 3 \right) \left( \frac{a}{2 L_e} \right)^3 + \left[ \left( \frac{3E}{L_e} + 2 \right) \left( \frac{a}{2 L_e} \right)^4 \right] \right] \right]$$

$$M_{max} = ((-0.042038 \text{ kip/ft}) \times (48 \text{ in}) \times (6.5 \text{ ft})) \times \left[ \left( \frac{(3.1705 \text{ ft})}{(6.5 \text{ ft})} + \frac{(4.6461 \text{ ft})}{2 \times (6.5 \text{ ft})} \right) - \left[ \left( \frac{4 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.6461 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^3 + \left[ \left( \frac{3 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.6461 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^4 \right] \right] \right]$$

$$M_{max} = 0.73847 \text{ kipft}$$

### Minimum Reinforcement Check (LRFD)

#### Parameters:

$f'_{ck} = 2.5 \text{ ksi}$  - Concrete strength,  
 $f_{yk} = 60 \text{ ksi}$  - Longitudinal reinforcement strength,  
 $\phi = 0.65$  - Reduction factor for axial strength,  
 $\alpha = 0.8$  - Alpha factor for axial strength,  
 $A_g = 2304 \text{ in}^2$  - Gross area of concrete,

Table 22.4.2.1

#### Longitudinal reinforcement:

Required reinforcement due to axial load,  $A_{st,required}$

22.4.2.2, 10.6.1.1

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[ \frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[ \frac{\frac{(7.419 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.35 \text{ in}^2$$

$A_{min}$  - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.35 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

$n_{rebar}$  - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

$A_{st}$  - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

$$\text{Ratio} = 0.96556$$

Status: **PASS**  
Ratio: **0.970**

25.2.3

$s_{rebar}$  - Minimum spacing of reinforcement,

$$s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$$

$$s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$$

$$s_{rebar} = 1.5 \text{ in}$$

#### Ties:

25.7.2.2 Since longitudinal reinforcement is  $\leq$  No. 10: Use #3(0.375 in)

25.7.2.1  $s_{ties}$  - Maximum spacing of ties,

$$s_{ties} = \text{Min} [(16 d_{bar}), (48 d_{ties}), \text{Min} (D, b)]$$

$$s_{ties} = \text{Min} [(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), \text{Min} ((48 \text{ in}), (48 \text{ in}))]$$

$$s_{ties} = 10 \text{ in}$$

#### Summary:

Main reinforcement: **14 - #5 (0.625 in)**

Ties: #3(0.375 in) - 10 in

**Axial Compression Strength (ACI 318-19, LRFD)**

22.4.2.2

$\phi P_N$  - Allowable axial compressive strength

$$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st})]$$

$$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$$

$$\phi P_N = 2675.2 \text{ kip}$$

Ratio - Capacity

$$\text{Ratio} = \frac{P}{\phi P_N}$$

$$\text{Ratio} = \frac{(7.419 \text{ kip})}{(2675.2 \text{ kip})}$$

$$\text{Ratio} = 0.0027733$$

Status: **PASS**  
Ratio: **0.000**

**Shear Strength (ACI 318-19, LRFD)**

**Parameters:**

22.5.2.2

$b_w = 48 \text{ in}$  - Effective width,  
 $d$  - Effective depth

$$d = 0.80 D$$

$$d = 0.80 \times (48 \text{ in})$$

$$d = 38.4 \text{ in}$$

22.5.5.1.3

$\lambda_s$  - size effect modification factor

$$\lambda_s = \text{MIN} \left[ \sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$$

$$\lambda_s = \text{MIN} \left[ \sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$$

$$\lambda_s = 0.64282$$

22.5.5.1.1

The following variables were converted to be consistent with empirical formula  $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$ ,  
 $V_{c,max}$  - Max shear strength of concrete

$$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$$

$$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,max} = 296.21 \text{ kip}$$

22.5.5.1.1(a)

The following variables were converted to be consistent with empirical formula  $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$ ,  $P = 7.419 \text{ kip} \rightarrow 7419 \text{ lbf}$ ,  
 $V_{c,a}$  - Shear strength of concrete (a)

$$V_{c,a} = \left[ 2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$$

$$V_{c,a} = \left[ 2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(7419 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.47 \text{ kip}$$

22.5.5.1.2

The following variables were converted to be consistent with empirical formula  $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$ ,  
 $V_{c,b}$  - Shear strength of concrete (b)

$$V_{c,b} = \left[ 2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$$

$$V_{c,b} = \left[ 2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

$V_c$  - Governing shear strength of concrete


$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.47 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.47 \text{ kip}$$

<p>22.5.1.2</p>	<p>The following variables were converted to be consistent with empirical formula <math>f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}</math>.</p> <p><math>V_{s,a}</math> - Shear strength of steel (a)</p> $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{s,a} = 737.28 \text{ kip}$ <p><math>A_v</math> - Ties rebar area,</p> $A_v = \frac{\pi d_{ties}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ <p>22.5.8.5.3 <math>V_{s,b}</math> - Shear strength of steel (b)</p> $V_{s,b} = \frac{2 A_v f_{yt} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 50.894 \text{ kip}$ <p><math>V_s</math> - Governing shear strength of steel</p> $V_s = \text{MIN}[V_{s,a}, V_{s,b}]$ $V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$ $V_s = 50.894 \text{ kip}$ <p>22.5.1.1 <math>\phi V_n</math> - Allowable shear strength</p> $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((119.47 \text{ kip}) + (50.894 \text{ kip}))$ $\phi V_n = 110.74 \text{ kip}$ <p><b>Considering x-direction:</b></p> <p><math>V_{max} = 10.434 \text{ kip}</math> - Maximum shear force in the x-direction, Ratio - Capacity</p> $\text{Ratio} = \frac{V_{max}}{\phi V_n}$ $\text{Ratio} = \frac{(10.434 \text{ kip})}{(110.74 \text{ kip})}$ $\text{Ratio} = 0.094221$ <p><b>Considering z-direction:</b></p> <p><math>V_{max} = 0.25721 \text{ kip}</math> - Maximum shear force in the z-direction, Ratio - Capacity</p> $\text{Ratio} = \frac{V_{max}}{\phi V_n}$ $\text{Ratio} = \frac{(0.25721 \text{ kip})}{(110.74 \text{ kip})}$ $\text{Ratio} = 0.0023227$	<p>Status: <b>PASS</b> Ratio: <b>0.090</b></p> <p>Status: <b>PASS</b> Ratio: <b>0.000</b></p>
	<p><b>Flexural Strength (ACI 318-19, LRFD)</b></p> <p><math>S_m</math> - Section modulus</p> $S_m = \frac{b D^2}{6}$ $S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$ $S_m = 18432 \text{ in}^3$	

<p>14.5.2.1b</p>	<p><math>\lambda = 1</math> - Concrete modification factor (Normal concrete),  Allowable flexural strength:  <math>M_n</math> shall be the lesser of:  <math>\phi M_{n,1}</math></p> $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ksi}} \times 18432.001 \text{in}^3$ $\phi M_{n,1} = 249.600 \text{kipft}$ <p><math>\phi M_{n,2}</math></p> $\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ksi}) \times (18432 \text{in}^3)$ $\phi M_{n,2} = 2121.6 \text{kipft}$ <p>Therefore,  <math>\phi M_n</math> - Allowable flexural strength,</p> $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(249.6 \text{kipft}), (2121.6 \text{kipft})]$ $\phi M_n = 249.6 \text{kipft}$ <p><b>Considering x-direction:</b>  <math>M_{max} = 32.245 \text{kipft}</math> - Maximum moment in the x-direction,  Ratio - Capacity</p> $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(32.245 \text{kipft})}{(249.6 \text{kipft})}$ $\text{Ratio} = 0.12919$	<p>Status: <b>PASS</b>  Ratio: <b>0.130</b></p>
	<p><b>Considering z-direction:</b>  <math>M_{max} = 0.73847 \text{kipft}</math> - Maximum moment in the z-direction,  Ratio - Capacity</p> $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(0.73847 \text{kipft})}{(249.6 \text{kipft})}$ $\text{Ratio} = 0.0029586$	<p>Status: <b>PASS</b>  Ratio: <b>0.000</b></p>

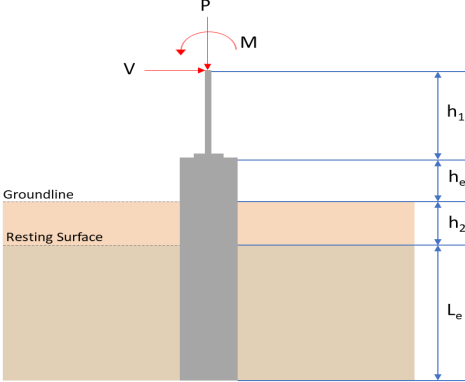REFERENCES	CALCULATIONS	RESULTS																										
	<p><b>SkyCiv Foundation Design</b> Pile Foundation</p> <p><b>Design Information :</b> Design code : IBC 2021 (International Building Code) Unit System : Imperial</p>																											
	<p><b>Pile Input</b></p>  <p><b>Geometry</b> Pile shape: rectangular <math>b = 48</math> in - Pile width <math>D = 48</math> in - Pile depth <math>L = 6.5</math> ft - Total pile length <math>h_1 = 0</math> ft - Lateral load height from the top of the pile, <math>h_2 = 0</math> ft - Depth to resting surface <math>h_e = 0</math> ft - Length of pile above the ground</p> <p><b>Tabulation of Soil Parameters</b></p> <table border="1" data-bbox="416 1102 1193 1191"> <thead> <tr> <th>Layer</th> <th>Label</th> <th>Allowable Bearing Pressure (<math>q_a</math>) (psf)</th> <th>Allowable Lateral Pressure (<math>R</math>) (psf/ft)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Sand, silty sand, clayey sand, silty gravel &amp; clayey gravel</td> <td>2000.000</td> <td>150.000</td> </tr> </tbody> </table> <p><b>Tabulation of Loads</b></p> <table border="1" data-bbox="676 1285 935 1458"> <thead> <tr> <th>Load Component</th> <th>ASD</th> <th>LRFD</th> </tr> </thead> <tbody> <tr> <td><math>P</math> (kip)</td> <td>5.146</td> <td>7.419</td> </tr> <tr> <td><math>V_x</math> (kip)</td> <td>-2.658</td> <td>-4.431</td> </tr> <tr> <td><math>V_z</math> (kip)</td> <td>0.164</td> <td>0.264</td> </tr> <tr> <td><math>M_x</math> (kipft)</td> <td>0.522</td> <td>0.837</td> </tr> <tr> <td><math>M_z</math> (kipft)</td> <td>29.144</td> <td>49.440</td> </tr> </tbody> </table> <p><b>Material Properties</b> <math>f'_{ck} = 2.5</math> ksi - Concrete strength,</p>	Layer	Label	Allowable Bearing Pressure ( $q_a$ ) (psf)	Allowable Lateral Pressure ( $R$ ) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	$P$ (kip)	5.146	7.419	$V_x$ (kip)	-2.658	-4.431	$V_z$ (kip)	0.164	0.264	$M_x$ (kipft)	0.522	0.837	$M_z$ (kipft)	29.144	49.440	
Layer	Label	Allowable Bearing Pressure ( $q_a$ ) (psf)	Allowable Lateral Pressure ( $R$ ) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
$P$ (kip)	5.146	7.419																										
$V_x$ (kip)	-2.658	-4.431																										
$V_z$ (kip)	0.164	0.264																										
$M_x$ (kipft)	0.522	0.837																										
$M_z$ (kipft)	29.144	49.440																										
	<p><b>Required depth to resist lateral loads (ASD)</b> <math>H</math> - Point of application of the lateral load</p> $H = h_1 + h_2 + h_e$ $H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$ $H = 0 \text{ ft}$ <p><b>Considering x-direction:</b> <math>H_o</math> - Lateral force per length of pile,</p> $H_o = \frac{V_x}{1.57 D}$ $H_o = \frac{(-2.658 \text{ kip})}{1.57 \times (48 \text{ in})}$ $H_o = -0.42325 \text{ kip/ft}$ <p><math>M_o</math> - Moment per length of pile,</p> $M_o = \frac{M_z + (V_x H)}{1.57 D}$																											

$$M_o = \frac{(29.144 \text{ kipft}) + ((-2.658 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 4.6408 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$$

Solving the cubic equation:

$L_{e,x} = 6.0216 \text{ ft}$  - Required depth in x-direction,

**Considering z-direction:**

$H_o$  - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.164 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.026115 \text{ kip/ft}$$

$M_o$  - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.522 \text{ kipft}) + ((0.164 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.083121 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$$

Solving the cubic equation:

$L_{e,z} = 2.1564 \text{ ft}$  - Required depth in z-direction,

**Minimum embedded depth required:**

$L_{e,req}$  - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$$

$$L_{e,req} = \text{MAX}[(6.0216 \text{ ft}), (2.1564 \text{ ft})]$$

$$L_{e,req} = 6.022 \text{ ft}$$

$L_e$  - Actual embedded length of pile,

$$L_e = L - h_c - h_2$$

$$L_e = (6.5 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 6.5 \text{ ft}$$

**Ratio** - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(6.022 \text{ ft})}{(6.5 \text{ ft})}$$

$$\text{Ratio} = 0.92646$$

Status: **PASS**  
Ratio: **0.930**

**End-bearing Capacity (ASD)**

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_c}{A}$$

$$q = \frac{(5.146 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.32163 \text{ kip/ft}^2$$

$$q = 0.32162 \text{ kip/ft}$$

**Check bearing capacity ratio:**

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.32162 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.16081$$

Status: **PASS**  
Ratio: **0.160**

Czerniak

**Lateral Soil Pressure (ASD):**

$L/D$  - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(6.5 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.625$$

Since  $L/D \leq 10$ ,

Pile is short.

**Considering x-direction:**

$H_o = -0.42325 \text{ kip/ft}$  - Lateral force per length of pile,

$M_o = 4.6408 \text{ kipft/ft}$  - Overturning moment per length of pile,

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (4.6408 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (4.6408 \text{ kipft/ft})) + (4 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.4868 \text{ ft}$$

$p$  - Earth pressure against the pile at distance  $a/2$  from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 [(4 \times (4.6408 \text{ kipft/ft})) + (3 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))]^2}{(6.5 \text{ ft})^2 [(3 \times (4.6408 \text{ kipft/ft})) + (2 \times (-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))]}$$

$$p = 0.22408 \text{ kip/ft}^2$$

$s$  - Earth pressure against the pile at distance  $L_e$ ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 [(2 \times (4.6408 \text{ kipft/ft})) + ((-0.42325 \text{ kip/ft}) \times (6.5 \text{ ft}))]}{(6.5 \text{ ft})^2}$$

$$s = 0.9274 \text{ kip/ft}^2$$

**Check lateral soil pressure capacity:**

$p_a$  - Allowable lateral soil pressure at depth  $a/2$ ,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(4.4868 \text{ ft})}{2}$$

$$p_a = 0.33651 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{p}{p_a}$$

$$\text{Ratio} = \frac{(0.22408 \text{ kip/ft}^2)}{(0.33651 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.66591$$

$p_a$  - Allowable lateral soil pressure at depth  $L_e$ ,


Status: **PASS**  
Ratio: **0.670**

	$p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6.5 \text{ ft})$ $p_s = 0.975 \text{ kip/ft}^2$ <p>Ratio - Lateral soil capacity</p> $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(0.9274 \text{ kip/ft}^2)}{(0.975 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.95118$	<p>Status: <b>PASS</b> Ratio: <b>0.950</b></p>
	<p><b>Considering z-direction:</b></p> <p><math>H_o = 0.026115 \text{ kip/ft}</math> - Lateral force per length of pile,  <math>M_o = 0.083121 \text{ kipft/ft}</math> - Overturning moment per length of pile,  <math>a</math> - Distance from resting surface to pivot point,</p> $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.083121 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (0.026115 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (0.083121 \text{ kipft/ft})) + (4 \times (0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))}$ $a = 4.6456 \text{ ft}$ <p><math>p</math> - Earth pressure against the pile at distance <math>a/2</math> from resting surface,</p> $p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{0.75 [(4 \times (0.083121 \text{ kipft/ft})) + (3 \times (0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))]^2}{(6.5 \text{ ft})^2 [(3 \times (0.083121 \text{ kipft/ft})) + (2 \times (0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))]}$ $p = 0.021358 \text{ kip/ft}^2$ <p><math>s</math> - Earth pressure against the pile at distance <math>L_e</math>,</p> $s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{6 [(2 \times (0.083121 \text{ kipft/ft})) + ((0.026115 \text{ kip/ft}) \times (6.5 \text{ ft}))]}{(6.5 \text{ ft})^2}$ $s = 0.047714 \text{ kip/ft}^2$ <p><b>Check lateral soil pressure capacity:</b></p> <p><math>p_a</math> - Allowable lateral soil pressure at depth <math>a/2</math>,</p> $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(4.6456 \text{ ft})}{2}$ $p_a = 0.34842 \text{ kip/ft}^2$ <p>Ratio - Lateral soil capacity</p> $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(0.021358 \text{ kip/ft}^2)}{(0.34842 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.0613$ <p><math>p_s</math> - Allowable lateral soil pressure at depth <math>L_e</math>,</p> $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (6.5 \text{ ft})$ $p_s = 0.975 \text{ kip/ft}^2$ <p>Ratio - Lateral soil capacity</p> $\text{Ratio} = \frac{s}{p_s}$	<p>Status: <b>PASS</b> Ratio: <b>0.060</b></p>

$$Ratio = \frac{(0.047714 \text{ kip/ft}^2)}{(0.975 \text{ kip/ft}^2)}$$

$$Ratio = 0.048938$$

Status: **PASS**  
Ratio: **0.050**

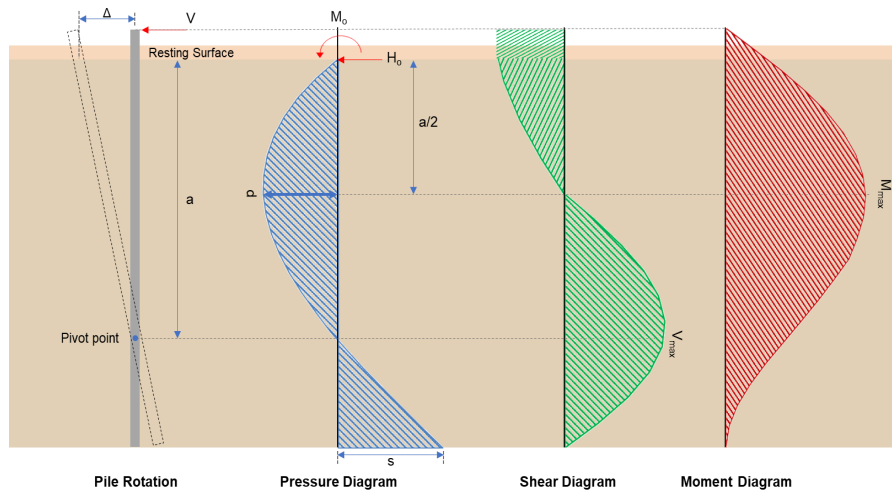

#### Shear force and Bending moment (x-direction, LRFD)

$H_o$  - Lateral force per length of pile,

$$H_o = \frac{V_e}{1.57 D}$$

$$H_o = \frac{(-4.431 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.70557 \text{ kip/ft}$$

$M_o$  - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(49.44 \text{ kipft}) + ((-4.431 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 7.8726 \text{ kipft/ft}$$

$E$  - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(7.8726 \text{ kipft/ft})}{(-0.70557 \text{ kip/ft})}$$

$$E = 11.158 \text{ ft}$$

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (7.8726 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (-0.70557 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (7.8726 \text{ kipft/ft})) + (4 \times (-0.70557 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.4849 \text{ ft}$$

$V_{max}$  - Max shear force located at depth  $a$ ,

$$V_{max} = (H_o D) \left[ 1 - \left[ 3 \left( \frac{4 E}{L_e} + 3 \right) \left( \frac{a}{L_e} \right)^2 \right] + \left[ 4 \left( \frac{3 E}{L_e} + 2 \right) \left( \frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.70557 \text{ kip/ft}) \times (48 \text{ in})) \times \left[ 1 - \left[ 3 \times \left( \frac{4 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.4849 \text{ ft})}{(6.5 \text{ ft})} \right)^2 \right] + \left[ 4 \times \left( \frac{3 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.4849 \text{ ft})}{(6.5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 10.434 \text{ kip}$$

$M_{max}$  - Max bending moment located at depth  $a/2$ ,

$$M_{max} = (H_o D L_e) \left[ \left( \frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[ \left( \frac{4E}{L_e} + 3 \right) \left( \frac{a}{2 L_e} \right)^3 + \left[ \left( \frac{3E}{L_e} + 2 \right) \left( \frac{a}{2 L_e} \right)^4 \right] \right] \right]$$

$$M_{max} = ((-0.70557 \text{ kip/ft}) \times (48 \text{ in}) \times (6.5 \text{ ft})) \times \left[ \left( \frac{(11.158 \text{ ft})}{(6.5 \text{ ft})} + \frac{(4.4849 \text{ ft})}{2 \times (6.5 \text{ ft})} \right) - \left[ \left( \frac{4 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.4849 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^3 + \left[ \left( \frac{3 \times (11.158 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.4849 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 32.245 \text{ kipft}$$

### Shear force and Bending moment (z-direction, LRFD)

$H_o$  - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.264 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.042038 \text{ kip/ft}$$

$M_o$  - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.837 \text{ kipft}) + ((0.264 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.13328 \text{ kipft/ft}$$

$E$  - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.13328 \text{ kipft/ft})}{(0.042038 \text{ kip/ft})}$$

$$E = 3.1705 \text{ ft}$$

$a$  - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.13328 \text{ kipft/ft}) \times (6.5 \text{ ft})) + (3 \times (0.042038 \text{ kip/ft}) \times (6.5 \text{ ft})^2)}{(6 \times (0.13328 \text{ kipft/ft})) + (4 \times (0.042038 \text{ kip/ft}) \times (6.5 \text{ ft}))}$$

$$a = 4.6461 \text{ ft}$$

$V_{max}$  - Max shear force located at depth  $a$ ,

$$V_{max} = (H_o b) \left[ 1 - \left[ 3 \left( \frac{4E}{L_e} + 3 \right) \left( \frac{a}{L_e} \right)^2 + 4 \left( \frac{3E}{L_e} + 2 \right) \left( \frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((0.042038 \text{ kip/ft}) \times (48 \text{ in})) \times \left[ 1 - \left[ 3 \times \left( \frac{4 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.6461 \text{ ft})}{(6.5 \text{ ft})} \right)^2 + 4 \times \left( \frac{3 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.6461 \text{ ft})}{(6.5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.25721 \text{ kip}$$

$M_{max}$  - Max bending moment located at depth  $a/2$ ,

$$M_{max} = (H_o b L_e) \left[ \left( \frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[ \left( \frac{4E}{L_e} + 3 \right) \left( \frac{a}{2 L_e} \right)^3 + \left[ \left( \frac{3E}{L_e} + 2 \right) \left( \frac{a}{2 L_e} \right)^4 \right] \right] \right]$$

$$M_{max} = ((0.042038 \text{ kip/ft}) \times (48 \text{ in}) \times (6.5 \text{ ft})) \times \left[ \left( \frac{(3.1705 \text{ ft})}{(6.5 \text{ ft})} + \frac{(4.6461 \text{ ft})}{2 \times (6.5 \text{ ft})} \right) - \left[ \left( \frac{4 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 3 \right) \times \left( \frac{(4.6461 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^3 + \left[ \left( \frac{3 \times (3.1705 \text{ ft})}{(6.5 \text{ ft})} + 2 \right) \times \left( \frac{(4.6461 \text{ ft})}{2 \times (6.5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 0.73847 \text{ kipft}$$

### Minimum Reinforcement Check (LRFD)

#### Parameters:

$f'_{ck} = 2.5 \text{ ksi}$  - Concrete strength,  
 $f_{yk} = 60 \text{ ksi}$  - Longitudinal reinforcement strength,  
 $\phi = 0.65$  - Reduction factor for axial strength,  
 $\alpha = 0.8$  - Alpha factor for axial strength,  
 $A_g = 2304 \text{ in}^2$  - Gross area of concrete,

Table 22.4.2.1

#### Longitudinal reinforcement:

Required reinforcement due to axial load,  $A_{st,required}$

22.4.2.2, 10.6.1.1

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[ \frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[ \frac{\frac{(7.419 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.35 \text{ in}^2$$

$A_{min}$  - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.35 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

$n_{rebar}$  - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

$A_{st}$  - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

$$\text{Ratio} = 0.96556$$

Status: **PASS**  
Ratio: **0.970**

25.2.3

$s_{rebar}$  - Minimum spacing of reinforcement,

$$s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$$

$$s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$$

$$s_{rebar} = 1.5 \text{ in}$$

#### Ties:

25.7.2.2

Since longitudinal reinforcement is  $\leq$  No. 10: Use #3(0.375 in)

25.7.2.1

$s_{ties}$  - Maximum spacing of ties,

$$s_{ties} = \text{Min} [(16 d_{bar}), (48 d_{ties}), \text{Min} (D, b)]$$

$$s_{ties} = \text{Min} [(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), \text{Min} ((48 \text{ in}), (48 \text{ in}))]$$

$$s_{ties} = 10 \text{ in}$$

#### Summary:

Main reinforcement: **14 - #5 (0.625 in)**

Ties: #3(0.375 in) - 10 in

**Axial Compression Strength (ACI 318-19, LRFD)**

22.4.2.2

$\phi P_N$  - Allowable axial compressive strength

$$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st})]$$

$$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$$

$$\phi P_N = 2675.2 \text{ kip}$$

Ratio - Capacity

$$\text{Ratio} = \frac{P}{\phi P_N}$$

$$\text{Ratio} = \frac{(7.419 \text{ kip})}{(2675.2 \text{ kip})}$$

$$\text{Ratio} = 0.0027733$$

Status: **PASS**  
Ratio: **0.000**

**Shear Strength (ACI 318-19, LRFD)**

**Parameters:**

22.5.2.2

$b_w = 48 \text{ in}$  - Effective width,  
 $d$  - Effective depth

$$d = 0.80 D$$

$$d = 0.80 \times (48 \text{ in})$$

$$d = 38.4 \text{ in}$$

22.5.5.1.3

$\lambda_s$  - size effect modification factor

$$\lambda_s = \text{MIN} \left[ \sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$$

$$\lambda_s = \text{MIN} \left[ \sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$$

$$\lambda_s = 0.64282$$

22.5.5.1.1

The following variables were converted to be consistent with empirical formula  $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$ ,  
 $V_{c,max}$  - Max shear strength of concrete

$$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$$

$$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,max} = 296.21 \text{ kip}$$

22.5.5.1.1(a)

The following variables were converted to be consistent with empirical formula  $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$ ,  $P = 7.419 \text{ kip} \rightarrow 7419 \text{ lbf}$ ,  
 $V_{c,a}$  - Shear strength of concrete (a)

$$V_{c,a} = \left[ 2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$$

$$V_{c,a} = \left[ 2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(7419 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.47 \text{ kip}$$

22.5.5.1.2

The following variables were converted to be consistent with empirical formula  $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$ ,  
 $V_{c,b}$  - Shear strength of concrete (b)

$$V_{c,b} = \left[ 2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$$

$$V_{c,b} = \left[ 2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

$V_c$  - Governing shear strength of concrete

$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.47 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.47 \text{ kip}$$

<p>22.5.1.2</p>	<p>The following variables were converted to be consistent with empirical formula <math>f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}</math>.</p> <p><math>V_{s,a}</math> - Shear strength of steel (a)</p> $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$ $V_{s,a} = 737.28 \text{ kip}$ <p><math>A_v</math> - Ties rebar area,</p> $A_v = \frac{\pi d_{ties}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ <p>22.5.8.5.3 <math>V_{s,b}</math> - Shear strength of steel (b)</p> $V_{s,b} = \frac{2 A_v f_{ytie} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 50.894 \text{ kip}$ <p><math>V_s</math> - Governing shear strength of steel</p> $V_s = \text{MIN}[V_{s,a}, V_{s,b}]$ $V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$ $V_s = 50.894 \text{ kip}$ <p>22.5.1.1 <math>\phi V_n</math> - Allowable shear strength</p> $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((119.47 \text{ kip}) + (50.894 \text{ kip}))$ $\phi V_n = 110.74 \text{ kip}$ <p><b>Considering x-direction:</b></p> <p><math>V_{max} = 10.434 \text{ kip}</math> - Maximum shear force in the x-direction,  Ratio - Capacity</p> $\text{Ratio} = \frac{V_{max}}{\phi V_n}$ $\text{Ratio} = \frac{(10.434 \text{ kip})}{(110.74 \text{ kip})}$ $\text{Ratio} = 0.094222$ <p><b>Considering z-direction:</b></p> <p><math>V_{max} = 0.25721 \text{ kip}</math> - Maximum shear force in the z-direction,  Ratio - Capacity</p> $\text{Ratio} = \frac{V_{max}}{\phi V_n}$ $\text{Ratio} = \frac{(0.25721 \text{ kip})}{(110.74 \text{ kip})}$ $\text{Ratio} = 0.0023227$	<p>Status: <b>PASS</b>  Ratio: <b>0.090</b></p> <p>Status: <b>PASS</b>  Ratio: <b>0.000</b></p>
	<p><b>Flexural Strength (ACI 318-19, LRFD)</b></p> <p><math>S_m</math> - Section modulus</p> $S_m = \frac{b D^2}{6}$ $S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$ $S_m = 18432 \text{ in}^3$	

<p>14.5.2.1b</p>	<p><math>\lambda = 1</math> - Concrete modification factor (Normal concrete),  Allowable flexural strength:  <math>M_n</math> shall be the lesser of:  <math>\phi M_{n,1}</math></p> $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ksi}} \times 18432.001 \text{in}^3$ $\phi M_{n,1} = 249.600 \text{kipft}$ <p><math>\phi M_{n,2}</math></p> $\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ksi}) \times (18432 \text{in}^3)$ $\phi M_{n,2} = 2121.6 \text{kipft}$ <p>Therefore,  <math>\phi M_n</math> - Allowable flexural strength,</p> $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(249.6 \text{kipft}), (2121.6 \text{kipft})]$ $\phi M_n = 249.6 \text{kipft}$ <p><b>Considering x-direction:</b>  <math>M_{max} = 32.245 \text{kipft}</math> - Maximum moment in the x-direction,  Ratio - Capacity</p> $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(32.245 \text{kipft})}{(249.6 \text{kipft})}$ $\text{Ratio} = 0.12919$	<p>Status: <b>PASS</b>  Ratio: <b>0.130</b></p>
	<p><b>Considering z-direction:</b>  <math>M_{max} = 0.73847 \text{kipft}</math> - Maximum moment in the z-direction,  Ratio - Capacity</p> $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(0.73847 \text{kipft})}{(249.6 \text{kipft})}$ $\text{Ratio} = 0.0029586$	<p>Status: <b>PASS</b>  Ratio: <b>0.000</b></p>