

Your Project Calculations

Project Name: MTSOLAR_65F781KB5958E

S3D Model Link:

[https://platform.skyciv.com/structural?](https://platform.skyciv.com/structural?preload_name=MTSOLAR_65F781KB5958E&preload_path=Shared%20Enterprise%20Folder/MT_Solar_Projects/9_2023)

[preload_name=MTSOLAR_65F781KB5958E&preload_path=Shared%20Enterprise%20Folder/MT_Solar_Projects/9_2023](https://platform.skyciv.com/structural?preload_name=MTSOLAR_65F781KB5958E&preload_path=Shared%20Enterprise%20Folder/MT_Solar_Projects/9_2023)

Public Model Link:

https://platform.skyciv.com/structural-viewer?project_id=st8UwHN2skWPujB8vdpCwgAYZutXTy6e6HRH2gMb0aKVCzso3gHA0ZYkXBGEY5fv



Array Specification

Product:	Beam
Unique ID:	3P-19.75-6TOP-SD-24-L-3Hx7W-G17L
Duty Classification:	SD
Module Width:	41.15 in
Module Length:	87.25in
Number of Rows:	3
Number of Columns:	7
Total Number of Modules:	21
Desired Tilt Angle:	60
Front Edge Clearance:	5
Total Array Height at Tilt:	13.96 ft
Total Frame Length:	51.00 ft
Frame Weight:	1916 lbs
Array Dimensions N/S:	10.41 ft
Array Dimensions E/W:	51.48 ft
Rail Length:	124.95 in
Rail Spacing:	3.64 ft
Rail Check:	Not Checked

Support Specifications

Pole Size:	6in Pipe Sch 40
Pole Length above Grade:	9.51 ft
Number of Poles:	3
Pole Spacing:	19.75 ft

Foundation Specifications

Foundation Type:	Round
Foundation Dimensions:	Ø36 in
Foundation Depth (below grade):	Pile 1: 7.75 ft Pile 2: 8.25 ft Pile 3: 7.75 ft
Foundation Volume:	6.218 y ³
Foundation Result:	PASSED
Mount Twist:	1.317798 kip

Site Info

Risk Category:	I
Exposure:	C
Soil Classification:	sand
Site Location:	Columbus, MT 59019, USA
Wind Speed:	102 mph
Snow Load:	41 psf
Design Uplift Pressure:	0.020889 ksf
Design Downforce Pressure:	-0.020889 ksf
Design Snow Pressure:	0.004509 ksf



Design Disclaimer


This software should be used for preliminary designs and should not be used as a final design unless reviewed, verified and designed by a qualified structural engineer.

AutoDesigner Input


```
{"wind_speed_override":null,"snow_load_override":null,"direct_snow_load":false,"product_type":"Beam","project_id":"MTSOLAR_65F781KB5958E","site_address":"Columbus, MT 59019, USA","module_width":41.15,"module_length":87.25,"number_rows":3,"number_columns":7,"pole_mount_section":"4_40","core_pipe_width":65,"core_pipe_section":"2_40","adjuster_section":"2_40","core_beam_height":65,"core_beam_section":"HSS3x2x1/8","main_pipe_section":"2_12GA","pole_spacing":15,"tilt_angle":60,"ground_clearance":5,"risk_category":"I","exposure_category":"C","frame_duty_override":"auto","pole_override":"auto","soil_type":"sand","customer_foundation_override":"36_Round","foundation_type":"Round","foundation_size":36,"check_rails":false}
```

Design Notes:



- AISC Deflection checks are set to L/1 due to structure design intent
- Foundation Design and Sizing is approximate only

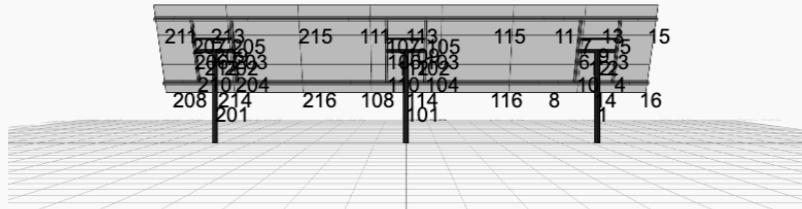


 SkyCiv


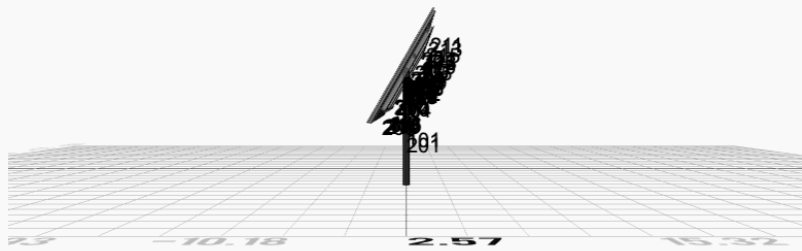




 SkyCiv

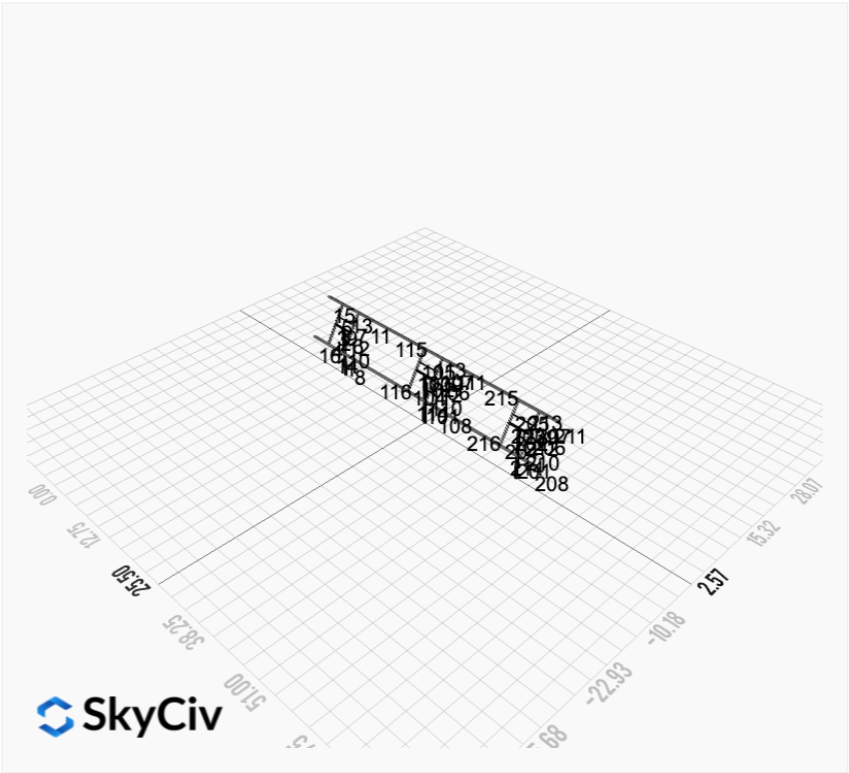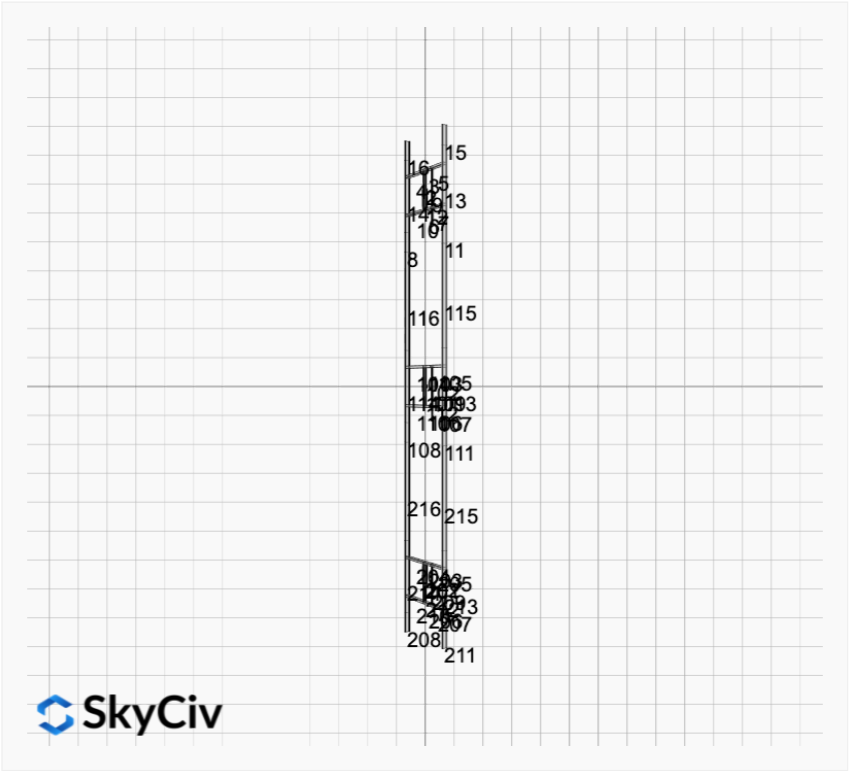


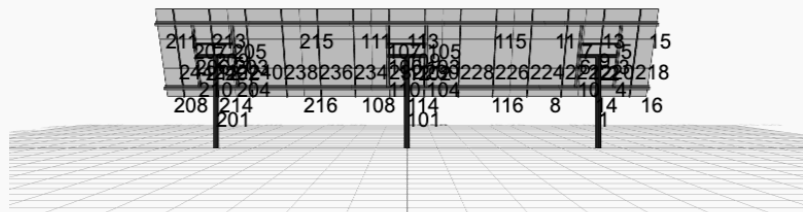

FEM Results (Envelope Worst Case for each member)

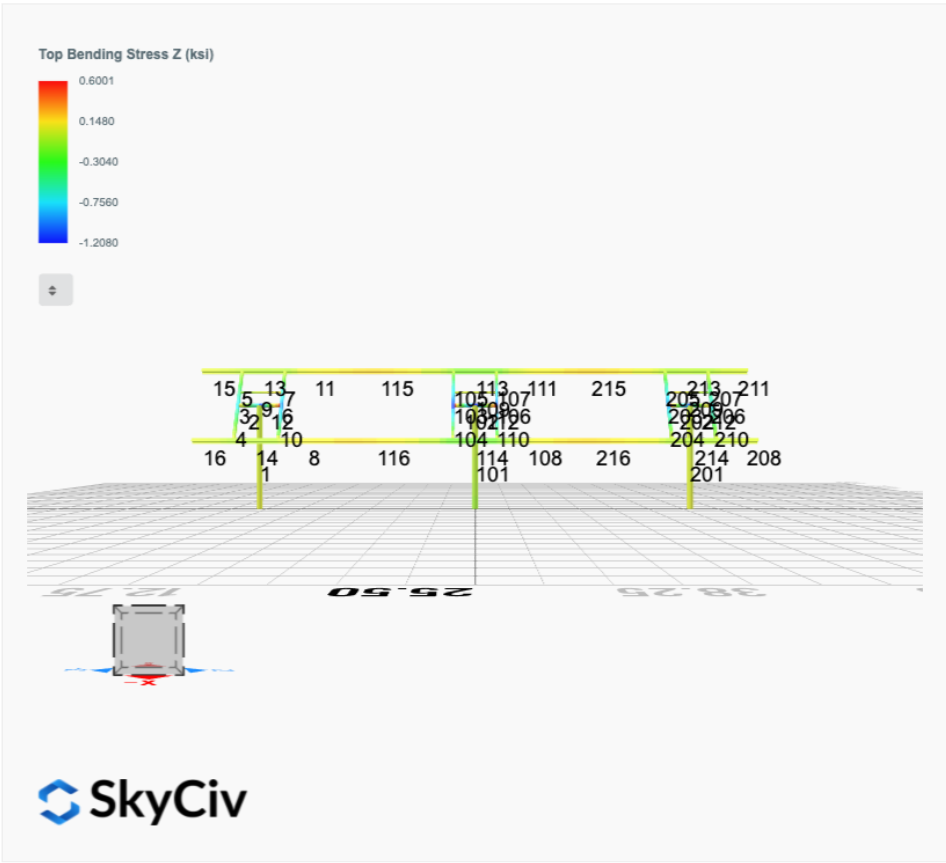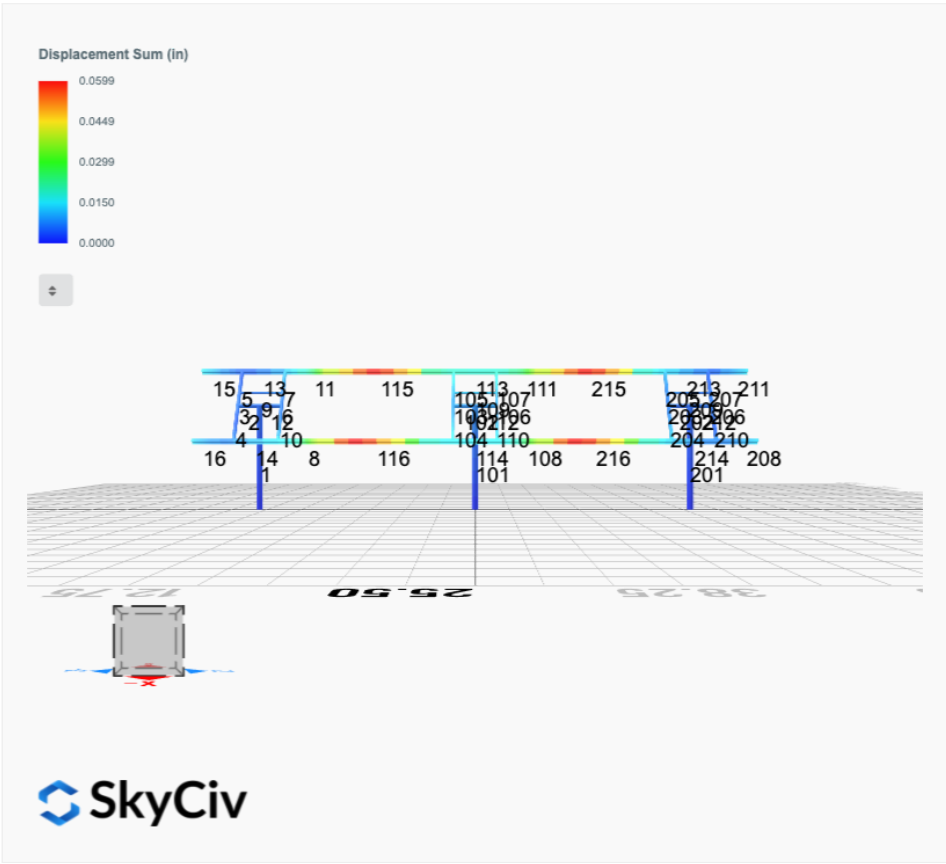

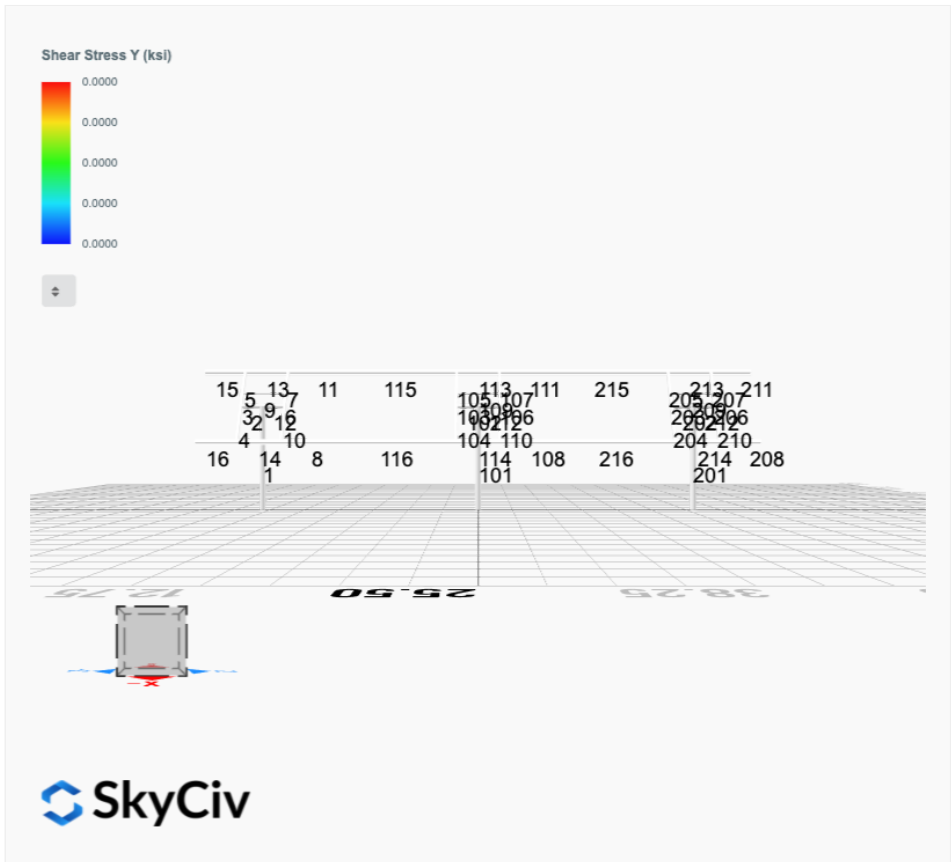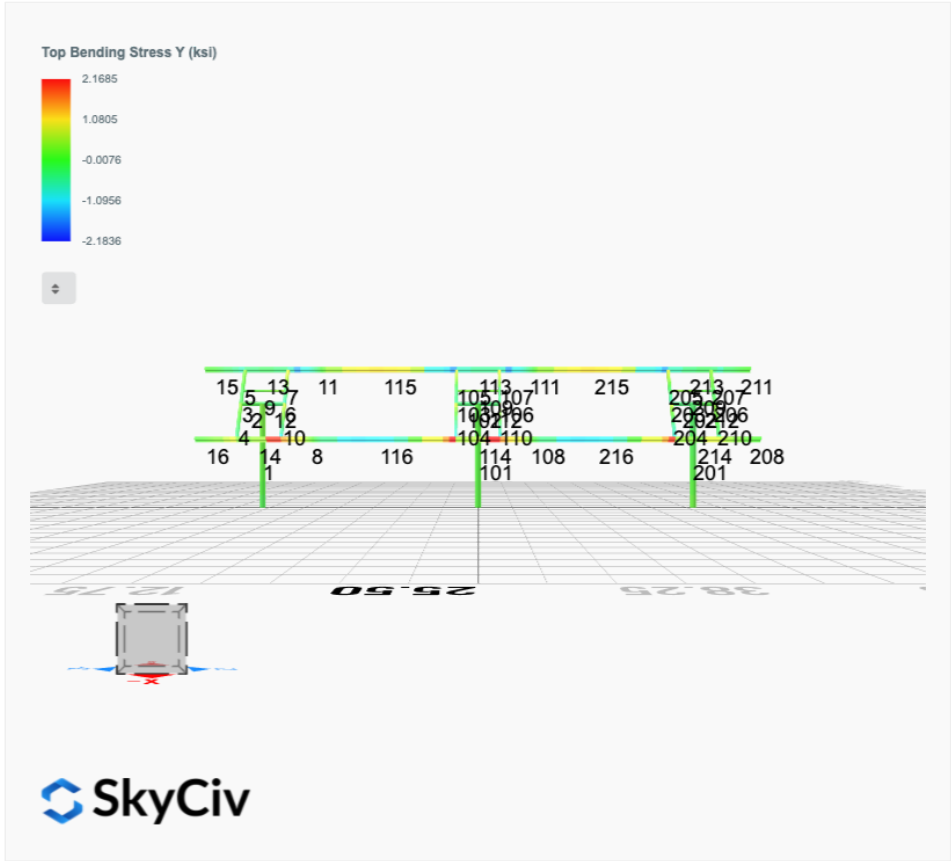

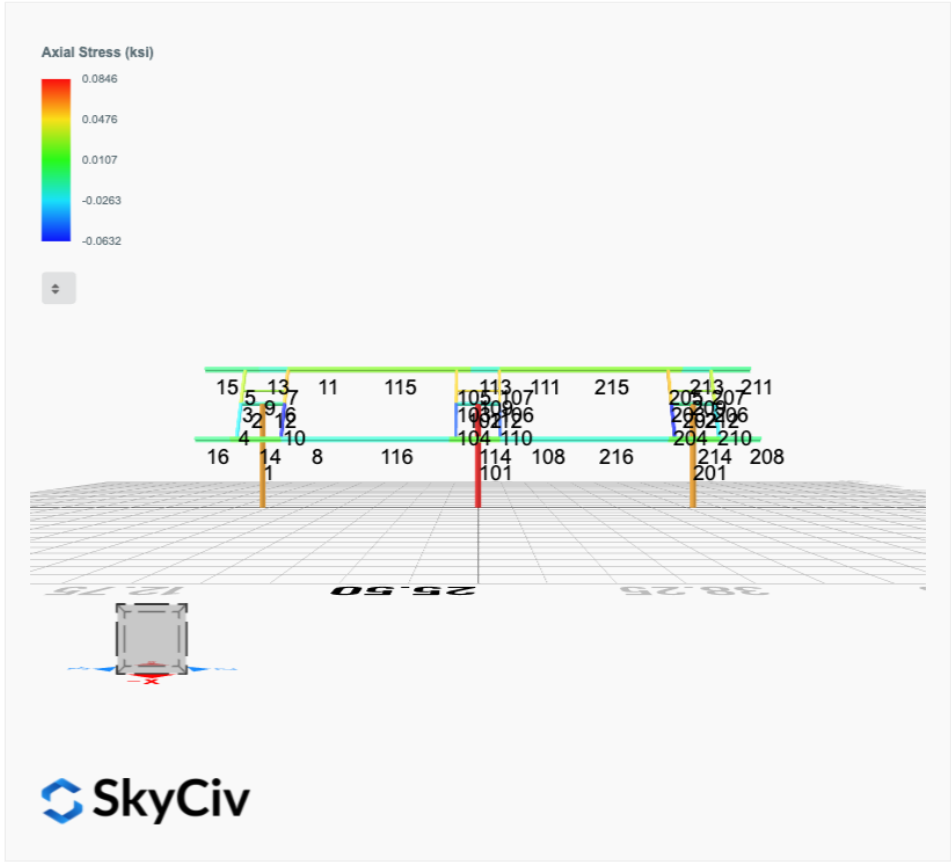

Reaction Forces for Foundation 1 (Node ID#1), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 2. D + L	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 3. D + (S or Lr or R)	0.0221	1.7496	0.0772	0.2258	-0.0997	-0.1720
ULS: 3. D + (S or Lr or R)	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0207	1.6590	0.0723	0.2114	-0.0933	-0.1603
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 5b. D + 0.7E	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0207	1.6590	0.0723	0.2114	-0.0933	-0.1603
ULS: 8. 0.6D + 0.7E	0.0099	0.8322	0.0345	0.1009	-0.0445	-0.0751
ULS: 5a. D + 0.6W_Wind downforce Case A only	-1.7466	2.3784	0.2031	0.5686	-0.7991	17.0077
ULS: 5a. D + 0.6W_Wind downforce Case B only	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 5a. D + 0.6W_Wind uplift Case A only	1.7770	0.3965	-0.0858	-0.2253	0.6394	-16.9249
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.3016	2.4025	0.1815	0.5117	-0.6370	12.6894
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0207	1.6590	0.0723	0.2114	-0.0933	-0.1603
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.3411	0.9161	-0.0352	-0.0837	0.4418	-12.7600
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0207	1.6590	0.0723	0.2114	-0.0933	-0.1603
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.3058	2.1306	0.1667	0.4685	-0.6179	12.7245
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.3369	0.6441	-0.0500	-0.1270	0.4610	-12.7249
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0164	1.3871	0.0575	0.1682	-0.0742	-0.1252
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-1.7531	1.8236	0.1801	0.5013	-0.7694	17.0578
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	0.0099	0.8322	0.0345	0.1009	-0.0445	-0.0751
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	1.7705	-0.1583	-0.1088	-0.2926	0.6691	-16.8748
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.0099	0.8322	0.0345	0.1009	-0.0445	-0.0751

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.4985
Shear X	-2.9587
Shear Z	0.3233
Moment X	0.9032
Moment Y (Twist)	1.3179
Moment Z	28.7144

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	2.4025
Shear X	-1.7770
Shear Z	0.2031
Moment X	0.5686
Moment Y (Twist)	0.7991
Moment Z	17.0578

Reaction Forces for Foundation 2 (Node ID#101), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 2. D + L	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 3. D + (S or Lr or R)	-0.0442	2.1785	0.0000	-0.0000	0.0000	0.3805
ULS: 3. D + (S or Lr or R)	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0413	2.0605	0.0000	-0.0000	0.0000	0.3569
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 5b. D + 0.7E	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0413	2.0605	0.0000	-0.0000	0.0000	0.3569
ULS: 8. 0.6D + 0.7E	-0.0197	1.0239	0.0000	-0.0000	0.0000	0.1717
ULS: 5a. D + 0.6W_Wind downforce Case A only	-2.3250	3.0828	0.0000	-0.0000	0.0000	21.9087
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 5a. D + 0.6W_Wind uplift Case A only	2.2641	0.3285	0.0000	-0.0000	0.0000	-20.8856
ULS: 5a. D + 0.6W_Wind uplift Case B only	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.7604	3.0927	0.0000	-0.0000	0.0000	16.5738
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0413	2.0605	0.0000	-0.0000	0.0000	0.3569
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.6814	1.0270	0.0000	-0.0000	0.0000	-15.5220
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0413	2.0605	0.0000	-0.0000	0.0000	0.3569
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.7520	2.7387	0.0000	-0.0000	0.0000	16.5031
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.6898	0.6730	0.0000	-0.0000	0.0000	-15.5927
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	-0.0329	1.7065	0.0000	-0.0000	0.0000	0.2862
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-2.3119	2.4002	0.0000	-0.0000	0.0000	21.7943
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.0197	1.0239	0.0000	-0.0000	0.0000	0.1717
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	2.2772	-0.3541	0.0000	-0.0000	0.0000	-21.0001
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	-0.0197	1.0239	0.0000	-0.0000	0.0000	0.1717

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	4.5768
Shear X	-3.8613
Shear Z	0.0000
Moment X	-0.0001
Moment Y (Twist)	0.0001
Moment Z	36.8627

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.0927
Shear X	-2.3250
Shear Z	0.0000
Moment X	-0.0000
Moment Y (Twist)	0.0000
Moment Z	21.9087

Reaction Forces for Foundation 3 (Node ID#201), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 2. D + L	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 3. D + (S or Lr or R)	0.0221	1.7496	-0.0772	-0.2258	0.0997	-0.1719
ULS: 3. D + (S or Lr or R)	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0207	1.6590	-0.0723	-0.2114	0.0934	-0.1603
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 5b. D + 0.7E	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0207	1.6590	-0.0723	-0.2114	0.0934	-0.1603
ULS: 8. 0.6D + 0.7E	0.0099	0.8322	-0.0345	-0.1009	0.0445	-0.0751
ULS: 5a. D + 0.6W_Wind downforce Case A only	-1.7466	2.3784	-0.2031	-0.5686	0.7991	17.0077
ULS: 5a. D + 0.6W_Wind downforce Case B only	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 5a. D + 0.6W_Wind uplift Case A only	1.7770	0.3965	0.0858	0.2253	-0.6394	-16.9248
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.3016	2.4025	-0.1815	-0.5117	0.6370	12.6894
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0207	1.6590	-0.0723	-0.2114	0.0934	-0.1603
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.3411	0.9161	0.0352	0.0837	-0.4418	-12.7600
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0207	1.6590	-0.0723	-0.2114	0.0934	-0.1603

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-1.3058	2.1306	-0.1667	-0.4685	0.6179	12.7245
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	1.3369	0.6441	0.0500	0.1270	-0.4610	-12.7249
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.0164	1.3871	-0.0575	-0.1682	0.0742	-0.1252
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-1.7531	1.8236	-0.1801	-0.5013	0.7694	17.0578
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	0.0099	0.8322	-0.0345	-0.1009	0.0445	-0.0751
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	1.7705	-0.1583	0.1088	0.2926	-0.6691	-16.8748
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.0099	0.8322	-0.0345	-0.1009	0.0445	-0.0751

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	3.4985
Shear X	-2.9587
Shear Z	-0.3233
Moment X	-0.9034
Moment Y (Twist)	1.3178
Moment Z	28.7151

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	2.4025
Shear X	-1.7770
Shear Z	-0.2031
Moment X	-0.5686
Moment Y (Twist)	0.7991
Moment Z	17.0578

Project Details

Design Code: AISC 360-16 LRFD
Provision: LRFD
Country: United States


User Name: sales@mtsolar.us
Unit System: imperial




Design Input Information

Design Factors			
Φ_t	Φ_c	Φ_b	Φ_v
0.9	0.9	0.9	0.9


Design Materials			
ID	E (ksi)	F_y (ksi)	F_u (ksi)
1	29000	50	65

Section Dimensions								
								

ID	Name	d (in)	t_w (in)					
1	2in Pipe Sch 40	2.38	0.15					
4	4in Pipe Sch 40	4.50	0.24					
7	6in Pipe Sch 40	6.63	0.28					

								
---	--	--	--	--	--	--	--	--

ID	Name	d (in)	b (in)	t_w (in)	t_b (in)	r (in)		
15	HSS5x3x1/8	5.00	3.00	0.12	0.12	0.12		

								
---	--	--	--	--	--	--	--	--

ID	Name	d (in)	t_w (in)	b_f (in)	b_b (in)	t_f (in)	t_b (in)	r (in)
18	W6x9	5.90	0.17	3.94	3.94	0.21	0.21	0.25

Section Properties								
ID	Name	A (in ²)	J (in ⁴)	I_{yp} (in ⁴)	I_{zp} (in ⁴)	I_w (in ⁶)	S_{yp} (in ³)	S_{zp} (in ³)
1	2in Pipe Sch 40	1.07	1.33	0.67	0.67	0.00	0.76	0.76
4	4in Pipe Sch 40	3.17	14.47	7.23	7.23	0.00	4.31	4.31
7	6in Pipe Sch 40	5.58	56.28	28.14	28.14	0.00	11.28	11.28

15	HSS5x3x1/8	1.77	6.02	2.75	6.03	152.35	2.07	2.93
18	W6x9	2.68	0.04	2.20	16.40	17.70	1.72	6.23

Member Properties									
Member ID	Section ID	K _z L (ft)	K _y L (ft)	L _b (ft)	C _b	L S T	L S C	L D	
1	7	19.97	19.97	9.51	-	300	200	1	
2	4	1.30	1.30	2.00	-	300	200	1	
3	15	0.92	0.92	1.42	1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.16,1.18,1.17,1.18,1.16,1.18,1.17,1.18,1.15,1.18,1.17,1.18,1.16,1.18,1.17,1.18,1.16,1.18	300	200	1	
4	15	2.44	2.44	3.75	1.69,1.69,1.69,1.68,1.69,1.69,1.67,1.69,1.66,1.69,1.67,1.69,1.66,1.69,1.67,1.68,1.65,1.68,1.67,1.69,1.65,1.69,1.67,1.69,1.66,1.69	300	200	1	
5	15	1.52	1.52	2.33	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.65,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
6	15	0.92	0.92	1.42	1.19,1.19,1.19,1.19,1.19,1.19,1.19,1.19,1.18,1.19,1.19,1.19,1.18,1.19,1.19,1.19,1.18,1.19,1.19,1.19,1.18,1.19,1.19,1.19,1.18,1.19	300	200	1	
7	15	1.52	1.52	2.33	1.68,1.68,1.68,1.67,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
8	18	1.33	1.33	2.05	1.32,1.32,1.32,1.32,1.32,1.32,1.29,1.32,1.28,1.32,1.29,1.32,1.28,1.32,1.30,1.32,1.26,1.32,1.29,1.32,1.27,1.32,1.29,1.32,1.28,1.32	300	200	1	
9	1	2.60	2.60	4.00	-	300	200	1	
10	15	2.44	2.44	3.75	1.69,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.65,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
11	18	1.33	1.33	2.05	1.37,1.37,1.37,1.37,1.37,1.37,1.42,1.37,1.44,1.37,1.42,1.37,1.44,1.37,1.41,1.37,1.49,1.37,1.41,1.37,1.46,1.37,1.42,1.37,1.43,1.37	300	200	1	
12	4	1.30	1.30	2.00	-	300	200	1	
13	18	4.88	4.00	7.50	1.15,1.15,1.15,1.15,1.15,1.15,1.13,1.15,1.13,1.15,1.13,1.15,1.13,1.15,1.14,1.15,1.19,1.15,1.14,1.15,1.15,1.15,1.13,1.15,1.13,1.15	300	200	1	
14	18	4.88	4.00	7.50	1.16,1.17,1.16,1.17,1.16,1.16,1.18,1.17,1.18,1.17,1.18,1.16,1.18,1.16,1.18,1.17,1.20,1.17,1.18,1.16,1.19,1.16,1.18,1.16,1.18,1.16	300	200	1	
15	18	4.20	4.20	2.00	2.33,2.33	300	200	1	
16	18	4.20	4.20	2.00	2.33,2.33	300	200	1	
101	7	19.97	19.97	9.51	-	300	200	1	
102	4	1.30	1.30	2.00	-	300	200	1	
103	15	0.92	0.92	1.42	1.19,1.18,1.19,1.18,1.19,1.19,1.18,1.18,1.18,1.18,1.18,1.19,1.18,1.19,1.18,1.18,1.17,1.18,1.18,1.19,1.17,1.19,1.18,1.19,1.18,1.19	300	200	1	
104	15	2.44	2.44	3.75	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.65,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68	300	200	1	
105	15	1.52	1.52	2.33	1.68,1.67,1.68,1.67,1.68,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.68,1.67,1.68	300	200	1	
106	15	0.92	0.92	1.42	1.19,1.18,1.19,1.18,1.19,1.19,1.18,1.18,1.18,1.18,1.18,1.19,1.18,1.19,1.18,1.18,1.17,1.18,1.18,1.19,1.17,1.19,1.18,1.19,1.18,1.19	300	200	1	
107	15	1.52	1.52	2.33	1.68,1.67,1.68,1.67,1.68,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.67,1.66,1.67,1.67,1.68,1.66,1.68,1.67,1.68,1.67,1.68	300	200	1	

108	18	1.33	1.33	2.0 5	2.10,2.10,2.10,2.10,2.10,2.10,2.07,2.10,1.94,2.10,2.07,2.10,1.95,2.10,2.07,2.10,1.71,2.10,2.0 7,2.10,1.84,2.10,2.06,2.10,1.97,2.10	3 0 0	2 0 0	1
109	1	2.60	2.60	4.0 0	-	3 0 0	2 0 0	1
110	15	2.44	2.44	3.7 5	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.65,1.68,1.6 7,1.68,1.66,1.68,1.67,1.68,1.66,1.68	3 0 0	2 0 0	1
111	18	1.33	1.33	2.0 5	1.82,1.82,1.83,1.82,1.82,1.83,1.38,1.82,1.29,1.82,1.37,1.83,1.30,1.83,1.43,1.82,1.17,1.82,1.4 1,1.83,1.24,1.83,1.36,1.83,1.31,1.83	3 0 0	2 0 0	1
112	4	1.30	1.30	2.0 0	-	3 0 0	2 0 0	1
113	18	4.88	4.00	7.5 0	1.04,1.04,1.04,1.04,1.04,1.04,1.07,1.04,1.09,1.04,1.07,1.04,1.09,1.04,1.06,1.04,4.01,1.04,1.0 6,1.04,1.61,1.04,1.07,1.04,1.08,1.04	3 0 0	2 0 0	1
114	18	4.88	4.00	7.5 0	1.03,1.03,1.03,1.03,1.03,1.03,1.04,1.03,1.04,1.03,1.04,1.03,1.04,1.03,1.04,1.03,1.0 4,1.03,1.04,1.03,1.04,1.03,1.04,1.03	3 0 0	2 0 0	1
115	18	6.63	6.63	10. 20	1.14,1.14,1.14,1.14,1.14,1.14,1.09,1.14,1.08,1.14,1.09,1.14,1.08,1.14,1.10,1.14,1.06,1.14,1.1 0,1.14,1.07,1.14,1.09,1.14,1.08,1.14	3 0 0	2 0 0	1
116	18	6.63	6.63	10. 20	1.17,1.17,1.17,1.17,1.17,1.17,1.16,1.17,1.15,1.17,1.16,1.17,1.15,1.17,1.16,1.17,1.14,1.17,1.1 6,1.17,1.15,1.17,1.16,1.17,1.15,1.17	3 0 0	2 0 0	1
201	7	19.9 7	19.9 7	9.5 1	-	3 0 0	2 0 0	1
202	4	1.30	1.30	2.0 0	-	3 0 0	2 0 0	1
203	15	0.92	0.92	1.4 2	1.19,1.19,1.19,1.19,1.19,1.19,1.19,1.19,1.18,1.19,1.19,1.19,1.18,1.19,1.19,1.19,1.18,1.19,1.1 9,1.19,1.18,1.19,1.19,1.19,1.18,1.19	3 0 0	2 0 0	1
204	15	2.44	2.44	3.7 5	1.69,1.68,1.69,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.69,1.66,1.69,1.67,1.68,1.65,1.68,1.6 7,1.69,1.66,1.69,1.67,1.68,1.66,1.68	3 0 0	2 0 0	1
205	15	1.52	1.52	2.3 3	1.68,1.68,1.68,1.67,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.67,1.66,1.67,1.6 7,1.68,1.66,1.68,1.67,1.68,1.67,1.68	3 0 0	2 0 0	1
206	15	0.92	0.92	1.4 2	1.18,1.18,1.18,1.18,1.18,1.18,1.17,1.18,1.16,1.18,1.17,1.18,1.16,1.18,1.17,1.18,1.15,1.18,1.1 7,1.18,1.16,1.18,1.17,1.18,1.16,1.18	3 0 0	2 0 0	1
207	15	1.52	1.52	2.3 3	1.68,1.68,1.68,1.68,1.68,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.66,1.68,1.67,1.68,1.65,1.68,1.6 7,1.68,1.66,1.68,1.67,1.68,1.66,1.68	3 0 0	2 0 0	1
208	18	4.20	4.20	2.0 0	2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.3 3,2.33,2.33,2.33,2.33,2.33,2.33,2.33	3 0 0	2 0 0	1
209	1	2.60	2.60	4.0 0	-	3 0 0	2 0 0	1
210	15	2.44	2.44	3.7 5	1.69,1.69,1.69,1.68,1.69,1.69,1.67,1.69,1.66,1.69,1.67,1.69,1.66,1.69,1.67,1.68,1.65,1.68,1.6 7,1.69,1.65,1.69,1.67,1.69,1.66,1.69	3 0 0	2 0 0	1
211	18	4.20	4.20	2.0 0	2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.33,2.3 3,2.33,2.33,2.33,2.33,2.33,2.33,2.33	3 0 0	2 0 0	1
212	4	1.30	1.30	2.0 0	-	3 0 0	2 0 0	1
213	18	4.88	4.00	7.5 0	1.15,1.15,1.15,1.15,1.15,1.15,1.13,1.15,1.13,1.15,1.13,1.15,1.13,1.15,1.14,1.15,1.19,1.15,1.1 4,1.15,1.15,1.15,1.13,1.15,1.13,1.15	3 0 0	2 0 0	1
214	18	4.88	4.00	7.5 0	1.16,1.16,1.16,1.17,1.16,1.16,1.18,1.16,1.18,1.16,1.18,1.16,1.18,1.16,1.18,1.17,1.20,1.17,1.1 8,1.16,1.19,1.16,1.18,1.16,1.18,1.16	3 0 0	2 0 0	1
215	18	6.63	6.63	10. 20	1.09,1.09,1.09,1.09,1.09,1.09,1.10,1.09,1.11,1.09,1.10,1.09,1.11,1.09,1.10,1.09,1.12,1.09,1.1 0,1.09,1.12,1.09,1.10,1.09,1.11,1.09	3 0 0	2 0 0	1
216	18	6.63	6.63	10. 20	1.09,1.09,1.09,1.09,1.09,1.09,1.08,1.09,1.08,1.09,1.08,1.09,1.08,1.09,1.09,1.09,1.08,1.09,1.0 9,1.09,1.08,1.09,1.08,1.09,1.08,1.09	3 0 0	2 0 0	1

Member Design Capacity

Member ID	$\Phi_t P_n$ (kip)	$\Phi_c P_n$ (kip)	$\Phi_b M_{zn}$ (k-ft)	$\Phi_b M_{yn}$ (k-ft)	$\Phi_v V_{yn}$ (kip)	$\Phi_v V_{zn}$ (kip)
1	251.16	109.23	42.30	42.30	75.35	75.35
2	142.83	141.72	16.17	16.17	42.85	42.85
3	79.65	74.02	10.99	4.60	29.14	16.61
4	79.65	72.01	10.99	4.60	29.14	16.61
5	79.65	73.44	10.99	4.60	29.14	16.61
6	79.65	74.02	10.99	4.60	29.14	16.61
7	79.65	73.44	10.99	4.60	29.14	16.61
8	120.60	117.88	23.36	6.45	30.09	45.74
9	48.35	43.11	2.85	2.85	14.51	14.51
10	79.65	72.01	10.99	4.60	29.14	16.61
11	120.60	117.88	23.36	6.45	30.09	45.74
12	142.83	141.72	16.17	16.17	42.85	42.85
13	120.60	98.23	19.89	6.45	30.09	45.74
14	120.60	98.23	20.42	6.45	30.09	45.74
15	120.60	96.18	23.36	6.45	30.09	45.74
16	120.60	96.18	23.36	6.45	30.09	45.74
101	251.16	109.23	42.30	42.30	75.35	75.35
102	142.83	141.72	16.17	16.17	42.85	42.85
103	79.65	74.02	10.99	4.60	29.14	16.61
104	79.65	72.01	10.99	4.60	29.14	16.61
105	79.65	73.44	10.99	4.60	29.14	16.61
106	79.65	74.02	10.99	4.60	29.14	16.61
107	79.65	73.44	10.99	4.60	29.14	16.61
108	120.60	117.88	23.36	6.45	30.09	45.74
109	48.35	43.11	2.85	2.85	14.51	14.51
110	79.65	72.01	10.99	4.60	29.14	16.61
111	120.60	117.88	23.36	6.45	30.09	45.74
112	142.83	141.72	16.17	16.17	42.85	42.85
113	120.60	98.23	18.31	6.45	30.09	45.74
114	120.60	98.23	18.13	6.45	30.09	45.74
115	120.60	68.63	14.48	6.45	30.09	45.74
116	120.60	68.63	15.57	6.45	30.09	45.74
201	251.16	109.23	42.30	42.30	75.35	75.35
202	142.83	141.72	16.17	16.17	42.85	42.85
203	79.65	74.02	10.99	4.60	29.14	16.61
204	79.65	72.01	10.99	4.60	29.14	16.61
205	79.65	73.44	10.99	4.60	29.14	16.61
206	79.65	74.02	10.99	4.60	29.14	16.61
207	79.65	73.44	10.99	4.60	29.14	16.61
208	120.60	96.18	23.36	6.45	30.09	45.74
209	48.35	43.11	2.85	2.85	14.51	14.51
210	79.65	72.01	10.99	4.60	29.14	16.61
211	120.60	96.18	23.36	6.45	30.09	45.74
212	142.83	141.72	16.17	16.17	42.85	42.85
213	120.60	98.23	19.89	6.45	30.09	45.74
214	120.60	98.23	20.42	6.45	30.09	45.74
215	120.60	68.63	14.89	6.45	30.09	45.74
216	120.60	68.63	14.75	6.45	30.09	45.74

Design Ratio

Member ID	P	M _z	M _y	V _y	V _z	(P,M _z ,M _y)	Worst LC	KL/r	δ	Status
1	0.032	0.679	0.051	0.039	0.004	0.716	#13	0.534	Not Required	Pass
2	0.001	0.093	0.130	0.027	0.029	0.224	#13	0.052	Not Required	Pass
3	0.004	0.283	0.027	0.027	0.003	0.305	#13	0.044	Not Required	Pass
4	0.004	0.284	0.095	0.029	0.014	0.380	#13	0.078	Not Required	Pass
5	0.004	0.175	0.050	0.028	0.007	0.178	#13	0.073	Not Required	Pass
6	0.007	0.443	0.108	0.046	0.017	0.535	#13	0.044	Not Required	Pass
7	0.008	0.275	0.171	0.044	0.024	0.302	#13	0.073	Not Required	Pass
8	0.003	0.082	0.066	0.024	0.007	0.117	#13	0.088	Not Required	Pass
9	0.003	0.045	0.058	0.004	0.003	0.082	#13	0.198	Not Required	Pass
10	0.008	0.403	0.180	0.040	0.024	0.423	#13	0.078	Not Required	Pass
11	0.002	0.075	0.066	0.027	0.007	0.107	#13	0.088	Not Required	Pass
12	0.001	0.227	0.212	0.049	0.042	0.439	#13	0.052	Not Required	Pass
13	0.003	0.068	0.167	0.035	0.009	0.190	#15	0.265	Not Required	Pass
14	0.003	0.057	0.166	0.032	0.009	0.173	#23	0.177	Not Required	Pass
15	0.000	0.011	0.016	0.009	0.002	0.024	#13	Not Required	Not Required	Pass
16	0.000	0.011	0.016	0.009	0.002	0.024	#13	Not Required	Not Required	Pass
101	0.042	0.871	0.000	0.051	0.000	0.892	#13	0.534	Not Required	Pass
102	0.002	0.212	0.230	0.051	0.045	0.443	#13	0.034	Not Required	Pass
103	0.007	0.454	0.074	0.045	0.009	0.512	#13	0.044	Not Required	Pass
104	0.007	0.488	0.170	0.049	0.021	0.590	#13	0.078	Not Required	Pass
105	0.007	0.282	0.178	0.045	0.026	0.321	#13	0.073	Not Required	Pass
106	0.007	0.454	0.074	0.045	0.009	0.512	#13	0.044	Not Required	Pass
107	0.007	0.282	0.178	0.045	0.026	0.321	#13	0.073	Not Required	Pass
108	0.003	0.049	0.070	0.030	0.007	0.087	#13	0.088	Not Required	Pass
109	0.007	0.019	0.042	0.001	0.000	0.064	#13	0.198	Not Required	Pass
110	0.007	0.488	0.170	0.049	0.021	0.590	#13	0.078	Not Required	Pass
111	0.002	0.079	0.071	0.027	0.007	0.090	#15	0.088	Not Required	Pass
112	0.002	0.212	0.230	0.051	0.045	0.443	#13	0.034	Not Required	Pass
113	0.003	0.076	0.173	0.035	0.009	0.220	#21	0.265	Not Required	Pass
114	0.005	0.136	0.172	0.038	0.009	0.275	#13	0.265	Not Required	Pass
115	0.004	0.186	0.092	0.027	0.007	0.267	#13	0.439	Not Required	Pass
116	0.003	0.166	0.092	0.030	0.007	0.242	#13	0.439	Not Required	Pass
201	0.032	0.679	0.051	0.039	0.004	0.716	#13	0.534	Not Required	Pass
202	0.001	0.227	0.212	0.049	0.042	0.439	#13	0.052	Not Required	Pass
203	0.007	0.443	0.108	0.046	0.017	0.535	#13	0.044	Not Required	Pass
204	0.008	0.403	0.180	0.040	0.024	0.423	#13	0.078	Not Required	Pass
205	0.008	0.275	0.171	0.044	0.024	0.302	#13	0.073	Not Required	Pass
206	0.004	0.283	0.027	0.027	0.003	0.305	#13	0.044	Not Required	Pass
207	0.004	0.175	0.050	0.028	0.007	0.178	#13	0.073	Not Required	Pass
208	0.000	0.011	0.016	0.009	0.002	0.024	#13	Not Required	Not Required	Pass
209	0.003	0.045	0.058	0.004	0.003	0.082	#13	0.198	Not Required	Pass
210	0.004	0.284	0.095	0.029	0.014	0.380	#13	0.078	Not Required	Pass
211	0.000	0.011	0.016	0.009	0.002	0.024	#13	Not Required	Not Required	Pass
212	0.001	0.093	0.130	0.027	0.029	0.224	#13	0.052	Not Required	Pass
213	0.003	0.068	0.167	0.035	0.009	0.190	#15	0.177	Not Required	Pass
214	0.003	0.057	0.166	0.032	0.009	0.173	#23	0.265	Not Required	Pass
215	0.004	0.195	0.092	0.027	0.007	0.264	#13	0.439	Not Required	Pass
216	0.003	0.179	0.092	0.024	0.007	0.254	#13	0.439	Not Required	Pass

Definitions

Φ_t Safety factor for tensile

Φ_c	Safety factor for compression
Φ_b	Safety factor for flexure
Φ_v	Safety factor for shear
E	Modulus of elasticity
F_y	Specified minimum yield stress
F_u	Specified minimum tensile strength
A	Cross-sectional area
J	Torsional constant
I_{yp}	Moment of inertia about the Y axes
I_{zp}	Moment of inertia about the Z axes
I_w	Warping constant
S_{yp}	Plastic section modulus about the Y axis
S_{zp}	Plastic section modulus about the Z axis
KL	Effective length
C_b	Buckling modification factor (from all load combinations)
L_b	Length between braced points
LST	Limited slenderness for tension
LSC	Limited slenderness for compression
LD	Limited deflection
P_n	Nominal axial strength (tension/compression)
M_n	Nominal flexural strength (about Z/Y axis)
V_n	Nominal shear strength (along Z/Y axis)
P	Design ratio in case of axial force
M_z	Design ratio in case of bending about Z axis
M_y	Design ratio in case of bending about Y axis
V_y	Design ratio in case of shear along Y axis
V_z	Design ratio in case of shear along Z axis
(P, M_z, M_y)	Design ratio in case of axial force and bending action
KL/r	Design ratio in case of section slenderness
δ	Design ratio in case of member deflection
OK	Capacity is provided
NG	Capacity is not provided

	$M_o = \frac{(17.058 \text{ kipft}) + ((-1.777 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 5.686 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,x} = 6.9038 \text{ ft}$ - Required depth in x-direction, Considering z-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_z}{D}$ $H_o = \frac{(0.203 \text{ kip})}{(36 \text{ in})}$ $H_o = 0.067667 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{D}$ $M_o = \frac{(0.569 \text{ kipft}) + ((0.203 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 0.18967 \text{ kipft/ft}$ Required depth of embedment in earth: $L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,z} = 3.6044 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$ $L_{e,req} = \text{MAX}[(6.9038 \text{ ft}), (3.6044 \text{ ft})]$ $L_{e,req} = 6.904 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_c - h_2$ $L_e = (7.75 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 7.75 \text{ ft}$ Ratio - Embedded depth $\text{Ratio} = \frac{L_{e,req}}{L_e}$ $\text{Ratio} = \frac{(6.904 \text{ ft})}{(7.75 \text{ ft})}$ $\text{Ratio} = 0.89084$	Status: PASS Ratio: 0.890
	End-bearing Capacity (ASD) A - Pile cros-section area $A = \pi \left(\frac{D}{2}\right)^2$ $A = \pi \times \left(\frac{(36 \text{ in})}{2}\right)^2$ $A = 7.0686 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(2.402 \text{ kip})}{(7.0686 \text{ ft}^2)}$	

	$q = 0.33981 \text{ kip/ft}^2$ Check bearing capacity ratio: Ratio - Capacity $\text{Ratio} = \frac{q}{q_a}$ $\text{Ratio} = \frac{(0.33981 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $\text{Ratio} = 0.16991$	Status: PASS Ratio: 0.170
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(7.75 \text{ ft})}{(36 \text{ in})}$ $L/D = 2.5833$ Since $L/D \leq 10$, Pile is short. Considering x-direction: $H_o = -0.59233 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 5.686 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (5.686 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (5.686 \text{ kipft/ft})) + (4 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))}$ $a = 5.3926 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{1.178 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{1.178 \times [(4 \times (5.686 \text{ kipft/ft})) + (3 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))]^2}{(7.75 \text{ ft})^2 \times [(3 \times (5.686 \text{ kipft/ft})) + (2 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))]}$ $p = 0.20044 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{9.425 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{9.425 \times [(2 \times (5.686 \text{ kipft/ft})) + ((-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))]}{(7.75 \text{ ft})^2}$ $s = 1.0641 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(5.3926 \text{ ft})}{2}$ $p_a = 0.40445 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(0.20044 \text{ kip/ft}^2)}{(0.40445 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.4956$	Status: PASS Ratio: 0.500


	p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (7.75 \text{ ft})$ $p_s = 1.1625 \text{ kip/ft}^2$ <i>Ratio</i> - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(1.0641 \text{ kip/ft}^2)}{(1.1625 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.91539$	Status: PASS Ratio: 0.920
	Considering z-direction: $H_o = 0.067667 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 0.18967 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.18967 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (0.067667 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (0.18967 \text{ kipft/ft})) + (4 \times (0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))}$ $a = 5.5854 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{1.178 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{1.178 \times [(4 \times (0.18967 \text{ kipft/ft})) + (3 \times (0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))]^2}{(7.75 \text{ ft})^2 \times [(3 \times (0.18967 \text{ kipft/ft})) + (2 \times (0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))]}$ $p = 0.065923 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{9.425 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{9.425 \times [(2 \times (0.18967 \text{ kipft/ft})) + ((0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))]}{(7.75 \text{ ft})^2}$ $s = 0.14182 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(5.5854 \text{ ft})}{2}$ $p_a = 0.4189 \text{ kip/ft}^2$ <i>Ratio</i> - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(0.065923 \text{ kip/ft}^2)}{(0.4189 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.15737$ p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (7.75 \text{ ft})$ $p_s = 1.1625 \text{ kip/ft}^2$ <i>Ratio</i> - Lateral soil capacity	Status: PASS Ratio: 0.160

$$Ratio = \frac{M_o}{p_s}$$

$$Ratio = \frac{(0.14182 \text{ kip/ft}^2)}{(1.1625 \text{ kip/ft}^2)}$$

$$Ratio = 0.12199$$

Status: **PASS**
Ratio: **0.120**

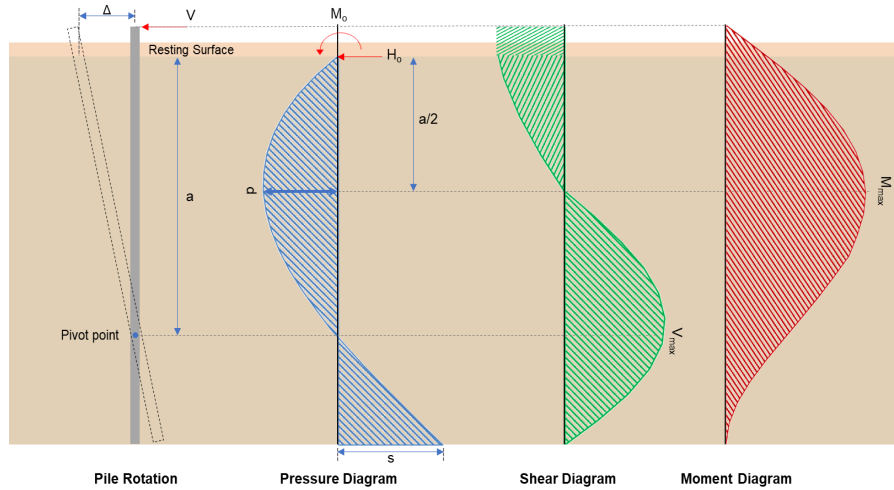

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{D}$$

$$H_o = \frac{(-2.959 \text{ kip})}{(36 \text{ in})}$$

$$H_o = -0.98633 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_x H)}{D}$$

$$M_o = \frac{(28.714 \text{ kipft}) + ((-2.959 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$$

$$M_o = 9.5713 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(9.5713 \text{ kipft/ft})}{(-0.98633 \text{ kip/ft})}$$

$$E = 9.704 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (9.5713 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (-0.98633 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (9.5713 \text{ kipft/ft})) + (4 \times (-0.98633 \text{ kip/ft}) \times (7.75 \text{ ft}))}$$

$$a = 5.3911 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 + 4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.98633 \text{ kip/ft}) \times (36 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (9.704 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.3911 \text{ ft})}{(7.75 \text{ ft})} \right)^2 + 4 \times \left(\frac{3 \times (9.704 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.3911 \text{ ft})}{(7.75 \text{ ft})} \right)^3 \right] \right]$$

	$V_{max} = 8.5077 \text{ kip}$ M_{max} - Max bending moment located at depth $a/2$, $M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$ $M_{max} = ((-0.98633 \text{ kip/ft}) \times (36 \text{ in}) \times (7.75 \text{ ft})) \times \left[\left(\frac{(9.704 \text{ ft})}{(7.75 \text{ ft})} + \frac{(5.3911 \text{ ft})}{2 \times (7.75 \text{ ft})} \right) - \left[\left(\frac{4 \times (9.704 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.3911 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (9.704 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.3911 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^4 \right] \right]$ $M_{max} = 30.895 \text{ kipft}$	
	Shear force and Bending moment (z-direction, LRFD) H_o - Lateral force per length of pile, $H_o = \frac{V_z}{D}$ $H_o = \frac{(0.323 \text{ kip})}{(36 \text{ in})}$ $H_o = 0.10767 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{D}$ $M_o = \frac{(0.903 \text{ kipft}) + ((0.323 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 0.301 \text{ kipft/ft}$ E - Distance from lateral load to resisting surface, $E = \frac{M_o}{H_o}$ $E = \frac{(0.301 \text{ kipft/ft})}{(0.10767 \text{ kip/ft})}$ $E = 2.7957 \text{ ft}$ a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.301 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (0.10767 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (0.301 \text{ kipft/ft})) + (4 \times (0.10767 \text{ kip/ft}) \times (7.75 \text{ ft}))}$ $a = 5.5857 \text{ ft}$ V_{max} - Max shear force located at depth a, $V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$ $V_{max} = ((0.10767 \text{ kip/ft}) \times (36 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.5857 \text{ ft})}{(7.75 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.5857 \text{ ft})}{(7.75 \text{ ft})} \right)^3 \right] \right]$ $V_{max} = 0.42247 \text{ kip}$ M_{max} - Max bending moment located at depth $a/2$, $M_{max} = (H_o b L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$ $M_{max} = ((0.10767 \text{ kip/ft}) \times (36 \text{ in}) \times (7.75 \text{ ft})) \times \left[\left(\frac{(2.7957 \text{ ft})}{(7.75 \text{ ft})} + \frac{(5.5857 \text{ ft})}{2 \times (7.75 \text{ ft})} \right) - \left[\left(\frac{4 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.5857 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.5857 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^4 \right] \right]$	


		$M_{max} = 1.4147 \text{ kipft}$	
		Minimum Reinforcement Check (LRFD) Parameters: $f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength, $f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength, $\phi = 0.65$ - Reduction factor for axial strength, $\alpha = 0.85$ - Alpha factor for axial strength, $A_g = 1017.9 \text{ in}^2$ - Gross area of concrete, Longitudinal reinforcement: Required reinforcement due to axial load, $A_{st,required}$ $A_{st,required}$ $A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$ $A_{st,required} = \text{Min} \left[\frac{\frac{(3.498 \text{ kip})}{(0.65) \times (0.85)} - (0.85 \times (2.5 \text{ ksi}) \times (1017.9 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (1017.9 \text{ in}^2)) \right]$ $A_{st,required} = -37.264 \text{ in}^2$ A_{min} - Governing minimum reinforcement area, $A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$ $A_{min} = \text{Max} [(-37.264 \text{ in}^2), (0.0018 \times (1017.9 \text{ in}^2))]$ $A_{min} = 1.8322 \text{ in}^2$ n_{rebar} - Required number of reinforcement, $n_{rebar} = \frac{A_{min}}{A_{rebar}}$ $n_{rebar} = \frac{(1.8322 \text{ in}^2)}{(0.3068 \text{ in}^2)}$ $n_{rebar} = 6$ A_{st} - Actual total reinforcement area, $A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$ $A_{st} = (6) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$ $A_{st} = 1.8408 \text{ in}^2$ Ratio - Capacity $\text{Ratio} = \frac{A_{min}}{A_{st}}$ $\text{Ratio} = \frac{(1.8322 \text{ in}^2)}{(1.8408 \text{ in}^2)}$ $\text{Ratio} = 0.99533$ 25.2.3 s_{rebar} - Minimum spacing of reinforcement, $s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$ $s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$ $s_{rebar} = 1.5 \text{ in}$ Ties: 25.7.2.2 Since longitudinal reinforcement is $\leq \text{No. } 10\phi$: Use #3(0.375 in) 25.7.2.1 s_{ties} - Maximum center-to-center spacing of ties, $s_{ties} = \text{Min} [(16 d_{bar}), (48 d_{ties}), D]$ $s_{ties} = \text{Min} [(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), (36 \text{ in})]$ $s_{ties} = 10 \text{ in}$ Summary:	Status: PASS Ratio: 1.000

	Main reinforcement: 6 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.85 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.85 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(1017.9 \text{ in}^2) - (1.8408 \text{ in}^2)]) + ((60 \text{ ksi}) \times (1.8408 \text{ in}^2)) \right]$ $\phi P_N = 1253.9 \text{ kip}$ Ratio - Capacity $Ratio = \frac{P}{\phi P_N}$ $Ratio = \frac{(3.498 \text{ kip})}{(1253.9 \text{ kip})}$ $Ratio = 0.0027897$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 36 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (36 \text{ in})$ $d = 28.8 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(28.8 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.71796$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.71796) \times \sqrt{(2500 \text{ psi})} \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,max} = 186.09 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 3.498 \text{ kip} \rightarrow 3498 \text{ lbf}$, $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.71796) \times \sqrt{(2500 \text{ psi})} + \frac{(3498 \text{ lbf})}{6 \times (1017.9 \text{ in}^2)} \right] \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,a} = 75.032 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.71796) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,b} = 204.04 \text{ kip}$	
	V_c - Governing shear strength of concrete $V_c = MIN [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = MIN [(186.09 \text{ kip}), (75.032 \text{ kip}), (204.04 \text{ kip})]$	

	$V_c = 75.032 \text{ kip}$ The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, 22.5.1.2 $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{s,a} = 414.72 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{ties}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ 22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (28.8 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 38.17 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(414.72 \text{ kip}), (38.17 \text{ kip})]$ $V_s = 38.17 \text{ kip}$ 22.5.1.1 ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((75.032 \text{ kip}) + (38.17 \text{ kip}))$ $\phi V_n = 73.581 \text{ kip}$ Considering x-direction: $V_{max} = 8.5077 \text{ kip}$ - Maximum shear force in the x-direction, Ratio - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(8.5077 \text{ kip})}{(73.581 \text{ kip})}$ $Ratio = 0.11562$ Considering z-direction: $V_{max} = 0.42247 \text{ kip}$ - Maximum shear force in the z-direction, Ratio - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(0.42247 \text{ kip})}{(73.581 \text{ kip})}$ $Ratio = 0.0057415$	Status: PASS Ratio: 0.120 Status: PASS Ratio: 0.010
	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{\pi D^3}{32}$ $S_m = \frac{\pi \times (36 \text{ in})^3}{32}$	

© 2020 SkyCiv

14.5.2.1b	$S_m = 4580.4 \text{ in}^3$ $\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 4580.442 \text{ in}^3$ $\phi M_{n,1} = 62.027 \text{ kipft}$ $\phi M_{n,2}$ $\phi M_{n,2} = \phi \times 0.85 \times f'_{ck} \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (4580.4 \text{ in}^3)$ $\phi M_{n,2} = 527.23 \text{ kipft}$ Therefore, ϕM_n - Allowable flexural strength, $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(62.027 \text{ kipft}), (527.23 \text{ kipft})]$ $\phi M_n = 62.027 \text{ kipft}$ Considering x-direction: $M_{max} = 30.895 \text{ kipft}$ - Maximum moment in the x-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(30.895 \text{ kipft})}{(62.027 \text{ kipft})}$ $\text{Ratio} = 0.49809$	Status: PASS Ratio: 0.500
	Considering z-direction: $M_{max} = 1.4147 \text{ kipft}$ - Maximum moment in the z-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(1.4147 \text{ kipft})}{(62.027 \text{ kipft})}$ $\text{Ratio} = 0.022808$	Status: PASS Ratio: 0.020

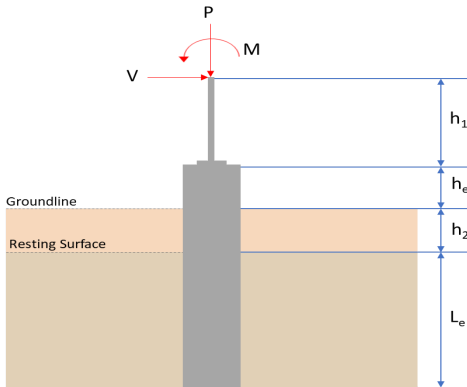REFERENCES	CALCULATIONS	RESULTS																										
	SkyCiv Foundation Design Pile Foundation Design Information : Design code : IBC 2021 (International Building Code) Unit System : Imperial																											
	Pile Input  Geometry Pile shape: round D = 36 in - Pile diameter L = 7.75 ft - Total pile length h1 = 0 ft - Lateral load height from the top of the pile, h2 = 0 ft - Depth to resisting surface he = 0 ft - Length of pile above the ground Tabulation of Soil Parameters <table><tr><th>Layer</th><th>Label</th><th>Allowable Bearing Pressure (qa) (psf)</th><th>Allowable Lateral Pressure (R) (psf/ft)</th></tr><tr><td>1</td><td>Sand, silty sand, clayey sand, silty gravel & clayey gravel</td><td>2000.000</td><td>150.000</td></tr></table> Tabulation of Loads <table><tr><th>Load Component</th><th>ASD</th><th>LRFD</th></tr><tr><td>P (kip)</td><td>2.402</td><td>3.498</td></tr><tr><td>Vx (kip)</td><td>-1.777</td><td>-2.959</td></tr><tr><td>Vz (kip)</td><td>-0.203</td><td>-0.323</td></tr><tr><td>Mx (kipft)</td><td>-0.569</td><td>-0.903</td></tr><tr><td>Mz (kipft)</td><td>17.058</td><td>28.715</td></tr></table> Material Properties f'ck = 2.5 ksi - Concrete strength,	Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	P (kip)	2.402	3.498	Vx (kip)	-1.777	-2.959	Vz (kip)	-0.203	-0.323	Mx (kipft)	-0.569	-0.903	Mz (kipft)	17.058	28.715	
Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
P (kip)	2.402	3.498																										
Vx (kip)	-1.777	-2.959																										
Vz (kip)	-0.203	-0.323																										
Mx (kipft)	-0.569	-0.903																										
Mz (kipft)	17.058	28.715																										
	Required depth to resist lateral loads (ASD) H - Point of application of the lateral load $H = h_1 + h_2 + h_e$ $H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$ $H = 0 \text{ ft}$ Considering x-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_x}{D}$ $H_o = \frac{(-1.777 \text{ kip})}{(36 \text{ in})}$ $H_o = -0.59233 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_x H)}{D}$																											

	$M_o = \frac{(17.058 \text{ kipft}) + ((-1.777 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 5.686 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$ Solving the cubic equation: $L_{e,x} = 6.9038 \text{ ft}$ - Required depth in x-direction, Considering z-direction: H_o - Lateral force per length of pile, $H_o = \frac{V_z}{D}$ $H_o = \frac{(-0.203 \text{ kip})}{(36 \text{ in})}$ $H_o = -0.067667 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{D}$ $M_o = \frac{(0.569 \text{ kipft}) + ((-0.203 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 0.18967 \text{ kipft/ft}$ Required depth of embedment in earth: $L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$ Solving the cubic equation: $L_{e,z} = 2.159 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$ $L_{e,req} = \text{MAX}[(6.9038 \text{ ft}), (2.159 \text{ ft})]$ $L_{e,req} = 6.904 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_c - h_2$ $L_e = (7.75 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 7.75 \text{ ft}$ Ratio - Embedded depth $\text{Ratio} = \frac{L_{e,req}}{L_e}$ $\text{Ratio} = \frac{(6.904 \text{ ft})}{(7.75 \text{ ft})}$ $\text{Ratio} = 0.89084$	Status: PASS Ratio: 0.890
	End-bearing Capacity (ASD) A - Pile cros-section area $A = \pi \left(\frac{D}{2} \right)^2$ $A = \pi \times \left(\frac{(36 \text{ in})}{2} \right)^2$ $A = 7.0686 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(2.402 \text{ kip})}{(7.0686 \text{ ft}^2)}$	

	$q = 0.33981 \text{ kip/ft}^2$ Check bearing capacity ratio: Ratio - Capacity $Ratio = \frac{q}{q_a}$ $Ratio = \frac{(0.33981 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $Ratio = 0.16991$	Status: PASS Ratio: 0.170
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(7.75 \text{ ft})}{(36 \text{ in})}$ $L/D = 2.5833$ Since $L/D \leq 10$, Pile is short. Considering x-direction: $H_o = -0.59233 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 5.686 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (5.686 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (5.686 \text{ kipft/ft})) + (4 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))}$ $a = 5.3926 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{1.178 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{1.178 \times [(4 \times (5.686 \text{ kipft/ft})) + (3 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))]^2}{(7.75 \text{ ft})^2 \times [(3 \times (5.686 \text{ kipft/ft})) + (2 \times (-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))]}$ $p = 0.20044 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{9.425 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{9.425 \times [(2 \times (5.686 \text{ kipft/ft})) + ((-0.59233 \text{ kip/ft}) \times (7.75 \text{ ft}))]}{(7.75 \text{ ft})^2}$ $s = 1.0641 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(5.3926 \text{ ft})}{2}$ $p_a = 0.40445 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $Ratio = \frac{p}{p_a}$ $Ratio = \frac{(0.20044 \text{ kip/ft}^2)}{(0.40445 \text{ kip/ft}^2)}$ $Ratio = 0.4956$	Status: PASS Ratio: 0.500


	p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (7.75 \text{ ft})$ $p_s = 1.1625 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{s}{p_s}$ $\text{Ratio} = \frac{(1.0641 \text{ kip/ft}^2)}{(1.1625 \text{ kip/ft}^2)}$ $\text{Ratio} = 0.91539$	Status: PASS Ratio: 0.920
	Considering z-direction: $H_o = -0.067667 \text{ kip/ft}$ - Lateral force per length of pile, $M_o = 0.18967 \text{ kipft/ft}$ - Overturning moment per length of pile, a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.18967 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (-0.067667 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (0.18967 \text{ kipft/ft})) + (4 \times (-0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))}$ $a = 5.5854 \text{ ft}$ p - Earth pressure against the pile at distance $a/2$ from resting surface, $p = \frac{1.178 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$ $p = \frac{1.178 \times [(4 \times (0.18967 \text{ kipft/ft})) + (3 \times (-0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))]^2}{(7.75 \text{ ft})^2 \times [(3 \times (0.18967 \text{ kipft/ft})) + (2 \times (-0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))]}$ $p = -0.027122 \text{ kip/ft}^2$ s - Earth pressure against the pile at distance L_e, $s = \frac{9.425 [(2 M_o) + (H_o L_e)]}{L_e^2}$ $s = \frac{9.425 \times [(2 \times (0.18967 \text{ kipft/ft})) + ((-0.067667 \text{ kip/ft}) \times (7.75 \text{ ft}))]}{(7.75 \text{ ft})^2}$ $s = -0.022766 \text{ kip/ft}^2$ Check lateral soil pressure capacity: p_a - Allowable lateral soil pressure at depth $a/2$, $p_a = R \frac{a}{2}$ $p_a = (150 \text{ psf/ft}) \times \frac{(5.5854 \text{ ft})}{2}$ $p_a = 0.4189 \text{ kip/ft}^2$ Ratio - Lateral soil capacity $\text{Ratio} = \frac{p}{p_a}$ $\text{Ratio} = \frac{(-0.027122 \text{ kip/ft}^2)}{(0.4189 \text{ kip/ft}^2)}$ $\text{Ratio} = -0.064746$ p_s - Allowable lateral soil pressure at depth L_e, $p_s = R L_e$ $p_s = (150 \text{ psf/ft}) \times (7.75 \text{ ft})$ $p_s = 1.1625 \text{ kip/ft}^2$ Ratio - Lateral soil capacity	Status: PASS Ratio: -0.060

$$Ratio = \frac{M_o}{p_s}$$

$$Ratio = \frac{(-0.022766 \text{ kip/ft}^2)}{(1.1625 \text{ kip/ft}^2)}$$

$$Ratio = -0.019584$$

Status: **PASS**
Ratio: **-0.020**

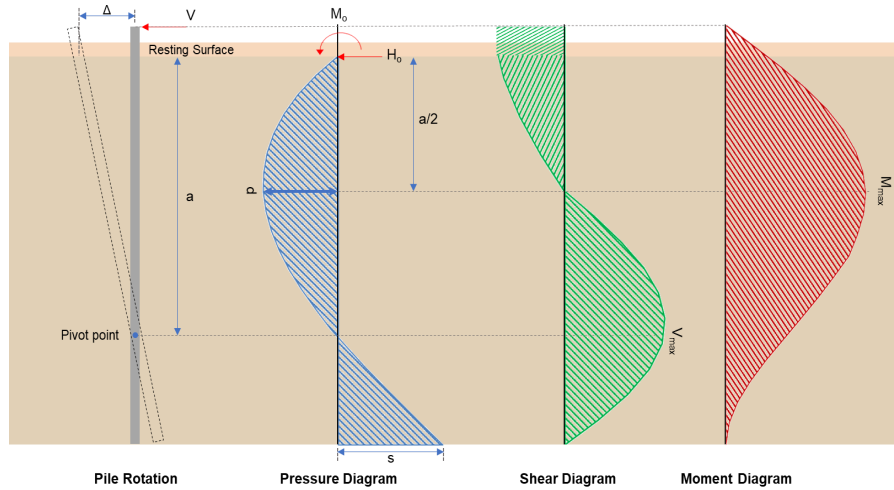

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{D}$$

$$H_o = \frac{(-2.959 \text{ kip})}{(36 \text{ in})}$$

$$H_o = -0.98633 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_z H)}{D}$$

$$M_o = \frac{(28.715 \text{ kipft}) + ((-2.959 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$$

$$M_o = 9.5717 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(9.5717 \text{ kipft/ft})}{(-0.98633 \text{ kip/ft})}$$

$$E = 9.7043 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (9.5717 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (-0.98633 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (9.5717 \text{ kipft/ft})) + (4 \times (-0.98633 \text{ kip/ft}) \times (7.75 \text{ ft}))}$$

$$a = 5.3911 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 + 4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.98633 \text{ kip/ft}) \times (36 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (9.7043 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.3911 \text{ ft})}{(7.75 \text{ ft})} \right)^2 + 4 \times \left(\frac{3 \times (9.7043 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.3911 \text{ ft})}{(7.75 \text{ ft})} \right)^3 \right] \right]$$


	$V_{max} = 8.508 \text{ kip}$ M_{max} - Max bending moment located at depth $a/2$, $M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$ $M_{max} = ((-0.98633 \text{ kip/ft}) \times (36 \text{ in}) \times (7.75 \text{ ft})) \times \left[\left(\frac{(9.7043 \text{ ft})}{(7.75 \text{ ft})} + \frac{(5.3911 \text{ ft})}{2 \times (7.75 \text{ ft})} \right) - \left[\left(\frac{4 \times (9.7043 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.3911 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (9.7043 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.3911 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^4 \right] \right]$ $M_{max} = 30.896 \text{ kipft}$	
	Shear force and Bending moment (z-direction, LRFD) H_o - Lateral force per length of pile, $H_o = \frac{V_z}{D}$ $H_o = \frac{(-0.323 \text{ kip})}{(36 \text{ in})}$ $H_o = -0.10767 \text{ kip/ft}$ M_o - Moment per length of pile, $M_o = \frac{M_x + (V_z H)}{D}$ $M_o = \frac{(0.903 \text{ kipft}) + ((-0.323 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 0.301 \text{ kipft/ft}$ E - Distance from lateral load to resisting surface, $E = \frac{M_o}{H_o}$ $E = \frac{(0.301 \text{ kipft/ft})}{(-0.10767 \text{ kip/ft})}$ $E = 2.7957 \text{ ft}$ a - Distance from resting surface to pivot point, $a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$ $a = \frac{(4 \times (0.301 \text{ kipft/ft}) \times (7.75 \text{ ft})) + (3 \times (-0.10767 \text{ kip/ft}) \times (7.75 \text{ ft})^2)}{(6 \times (0.301 \text{ kipft/ft})) + (4 \times (-0.10767 \text{ kip/ft}) \times (7.75 \text{ ft}))}$ $a = 5.5857 \text{ ft}$ V_{max} - Max shear force located at depth a, $V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$ $V_{max} = ((-0.10767 \text{ kip/ft}) \times (36 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.5857 \text{ ft})}{(7.75 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.5857 \text{ ft})}{(7.75 \text{ ft})} \right)^3 \right] \right]$ $V_{max} = 0.42247 \text{ kip}$ M_{max} - Max bending moment located at depth $a/2$, $M_{max} = (H_o b L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$ $M_{max} = ((-0.10767 \text{ kip/ft}) \times (36 \text{ in}) \times (7.75 \text{ ft})) \times \left[\left(\frac{(2.7957 \text{ ft})}{(7.75 \text{ ft})} + \frac{(5.5857 \text{ ft})}{2 \times (7.75 \text{ ft})} \right) - \left[\left(\frac{4 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 3 \right) \times \left(\frac{(5.5857 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (2.7957 \text{ ft})}{(7.75 \text{ ft})} + 2 \right) \times \left(\frac{(5.5857 \text{ ft})}{2 \times (7.75 \text{ ft})} \right)^4 \right] \right]$	

		$M_{max} = 1.4147 \text{ kipft}$	
		Minimum Reinforcement Check (LRFD) Parameters: $f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength, $f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength, $\phi = 0.65$ - Reduction factor for axial strength, $\alpha = 0.85$ - Alpha factor for axial strength, $A_g = 1017.9 \text{ in}^2$ - Gross area of concrete, Longitudinal reinforcement: Required reinforcement due to axial load, $A_{st,required}$ $A_{st,required}$ $A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$ $A_{st,required} = \text{Min} \left[\frac{\frac{(3.498 \text{ kip})}{(0.65) \times (0.85)} - (0.85 \times (2.5 \text{ ksi}) \times (1017.9 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (1017.9 \text{ in}^2)) \right]$ $A_{st,required} = -37.264 \text{ in}^2$ A_{min} - Governing minimum reinforcement area, $A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$ $A_{min} = \text{Max} [(-37.264 \text{ in}^2), (0.0018 \times (1017.9 \text{ in}^2))]$ $A_{min} = 1.8322 \text{ in}^2$ n_{rebar} - Required number of reinforcement, $n_{rebar} = \frac{A_{min}}{A_{rebar}}$ $n_{rebar} = \frac{(1.8322 \text{ in}^2)}{(0.3068 \text{ in}^2)}$ $n_{rebar} = 6$ A_{st} - Actual total reinforcement area, $A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$ $A_{st} = (6) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$ $A_{st} = 1.8408 \text{ in}^2$ Ratio - Capacity $\text{Ratio} = \frac{A_{min}}{A_{st}}$ $\text{Ratio} = \frac{(1.8322 \text{ in}^2)}{(1.8408 \text{ in}^2)}$ $\text{Ratio} = 0.99533$ 25.7.2.3 s_{rebar} - Minimum spacing of reinforcement, $s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$ $s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$ $s_{rebar} = 1.5 \text{ in}$ Ties: 25.7.2.2 Since longitudinal reinforcement is $\leq \text{No. } 10\phi$: Use #3(0.375 in) 25.7.2.1 s_{ties} - Maximum center-to-center spacing of ties, $s_{ties} = \text{Min} [(16 d_{bar}), (48 d_{ties}), D]$ $s_{ties} = \text{Min} [(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), (36 \text{ in})]$ $s_{ties} = 10 \text{ in}$ Summary:	Status: PASS Ratio: 1.000

	Main reinforcement: 6 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.85 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.85 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(1017.9 \text{ in}^2) - (1.8408 \text{ in}^2)]) + ((60 \text{ ksi}) \times (1.8408 \text{ in}^2)) \right]$ $\phi P_N = 1253.9 \text{ kip}$ Ratio - Capacity $Ratio = \frac{P}{\phi P_N}$ $Ratio = \frac{(3.498 \text{ kip})}{(1253.9 \text{ kip})}$ $Ratio = 0.0027897$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 36 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (36 \text{ in})$ $d = 28.8 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(28.8 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.71796$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$. $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.71796) \times \sqrt{(2500 \text{ psi})} \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,max} = 186.09 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 3.498 \text{ kip} \rightarrow 3498 \text{ lbf}$. $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.71796) \times \sqrt{(2500 \text{ psi})} + \frac{(3498 \text{ lbf})}{6 \times (1017.9 \text{ in}^2)} \right] \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,a} = 75.032 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$. $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.71796) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,b} = 204.04 \text{ kip}$ V_c - Governing shear strength of concrete $V_c = MIN [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = MIN [(186.09 \text{ kip}), (75.032 \text{ kip}), (204.04 \text{ kip})]$	

	$V_c = 75.032 \text{ kip}$ The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, 22.5.1.2 $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{s,a} = 414.72 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{ties}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ 22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (28.8 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 38.17 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(414.72 \text{ kip}), (38.17 \text{ kip})]$ $V_s = 38.17 \text{ kip}$ 22.5.1.1 ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((75.032 \text{ kip}) + (38.17 \text{ kip}))$ $\phi V_n = 73.581 \text{ kip}$ Considering x-direction: $V_{max} = 8.508 \text{ kip}$ - Maximum shear force in the x-direction, Ratio - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(8.508 \text{ kip})}{(73.581 \text{ kip})}$ $Ratio = 0.11563$ Considering z-direction: $V_{max} = 0.42247 \text{ kip}$ - Maximum shear force in the z-direction, Ratio - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(0.42247 \text{ kip})}{(73.581 \text{ kip})}$ $Ratio = 0.0057415$	Status: PASS Ratio: 0.120 Status: PASS Ratio: 0.010
	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{\pi D^3}{32}$ $S_m = \frac{\pi \times (36 \text{ in})^3}{32}$	

14.5.2.1b	$S_m = 4580.4 \text{ in}^3$ $\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 4580.442 \text{ in}^3$ $\phi M_{n,1} = 62.027 \text{ kipft}$ $\phi M_{n,2}$ $\phi M_{n,2} = \phi \times 0.85 \times f'_{ck} \times S_m$ $\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (4580.4 \text{ in}^3)$ $\phi M_{n,2} = 527.23 \text{ kipft}$ Therefore, ϕM_n - Allowable flexural strength, $\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$ $\phi M_n = \text{MIN}[(62.027 \text{ kipft}), (527.23 \text{ kipft})]$ $\phi M_n = 62.027 \text{ kipft}$ Considering x-direction: $M_{max} = 30.896 \text{ kipft}$ - Maximum moment in the x-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(30.896 \text{ kipft})}{(62.027 \text{ kipft})}$ $\text{Ratio} = 0.4981$	Status: PASS Ratio: 0.500
	Considering z-direction: $M_{max} = 1.4147 \text{ kipft}$ - Maximum moment in the z-direction, Ratio - Capacity $\text{Ratio} = \frac{M_{max}}{\phi M_n}$ $\text{Ratio} = \frac{(1.4147 \text{ kipft})}{(62.027 \text{ kipft})}$ $\text{Ratio} = 0.022808$	Status: PASS Ratio: 0.020

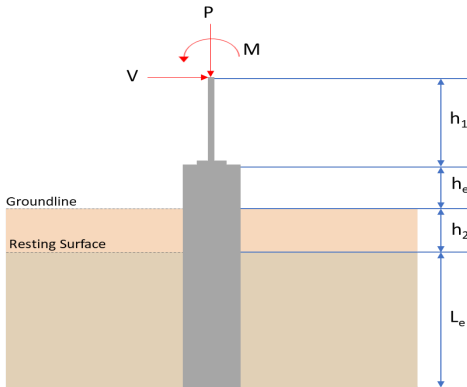REFERENCES	CALCULATIONS	RESULTS																										
	SkyCiv Foundation Design Pile Foundation Design Information : Design code : IBC 2021 (International Building Code) Unit System : Imperial																											
	Pile Input  Geometry Pile shape: round D = 36 in - Pile diameter Le = 8.25 ft - Total pile length h1 = 0 ft - Lateral load height from the top of the pile, h2 = 0 ft - Depth to resisting surface he = 0 ft - Length of pile above the ground Tabulation of Soil Parameters <table><tr><th>Layer</th><th>Label</th><th>Allowable Bearing Pressure (qa) (psf)</th><th>Allowable Lateral Pressure (R) (psf/ft)</th></tr><tr><td>1</td><td>Sand, silty sand, clayey sand, silty gravel & clayey gravel</td><td>2000.000</td><td>150.000</td></tr></table> Tabulation of Loads <table><tr><th>Load Component</th><th>ASD</th><th>LRFD</th></tr><tr><td>P (kip)</td><td>3.093</td><td>4.577</td></tr><tr><td>Vx (kip)</td><td>-2.325</td><td>-3.861</td></tr><tr><td>Vz (kip)</td><td>0.000</td><td>0.000</td></tr><tr><td>Mx (kipft)</td><td>0.000</td><td>0.000</td></tr><tr><td>Mz (kipft)</td><td>21.909</td><td>36.863</td></tr></table> Material Properties f'ck = 2.5 ksi - Concrete strength,	Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)	1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000	Load Component	ASD	LRFD	P (kip)	3.093	4.577	Vx (kip)	-2.325	-3.861	Vz (kip)	0.000	0.000	Mx (kipft)	0.000	0.000	Mz (kipft)	21.909	36.863	
Layer	Label	Allowable Bearing Pressure (qa) (psf)	Allowable Lateral Pressure (R) (psf/ft)																									
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000																									
Load Component	ASD	LRFD																										
P (kip)	3.093	4.577																										
Vx (kip)	-2.325	-3.861																										
Vz (kip)	0.000	0.000																										
Mx (kipft)	0.000	0.000																										
Mz (kipft)	21.909	36.863																										
	Required depth to resist lateral loads (ASD) H - Point of application of the lateral load $H = h_1 + h_2 + h_e$ $H = (0\text{ ft}) + (0\text{ ft}) + (0\text{ ft})$ $H = 0\text{ ft}$ Considering x-direction: Ho - Lateral force per length of pile, $H_o = \frac{V_x}{D}$ $H_o = \frac{(-2.325\text{ kip})}{(36\text{ in})}$ $H_o = -0.775\text{ kip/ft}$ Mo - Moment per length of pile, $M_o = \frac{M_z + (V_x H)}{D}$																											

	$M_o = \frac{(21.909 \text{ kipft}) + ((-2.325 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$ $M_o = 7.303 \text{ kipft/ft}$ Required depth of embedment in earth: $L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$ Solving the cubic equation: $L_{e,x} = 7.2803 \text{ ft}$ - Required depth in x-direction, Considering z-direction: $L_{e,z} = 0 \text{ ft}$ - Required depth in z-direction, Minimum embedded depth required: $L_{e,req}$ - Depth of pile required, $L_{e,req} = MAX[L_{e,x}, L_{e,z}]$ $L_{e,req} = MAX[(7.2803 \text{ ft}), (0 \text{ ft})]$ $L_{e,req} = 7.28 \text{ ft}$ L_e - Actual embedded length of pile, $L_e = L - h_e - h_2$ $L_e = (8.25 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$ $L_e = 8.25 \text{ ft}$ Ratio - Embedded depth $Ratio = \frac{L_{e,req}}{L_e}$ $Ratio = \frac{(7.28 \text{ ft})}{(8.25 \text{ ft})}$ $Ratio = 0.88242$	Status: PASS Ratio: 0.880
	End-bearing Capacity (ASD) A - Pile cross-section area $A = \pi \left(\frac{D}{2}\right)^2$ $A = \pi \times \left(\frac{(36 \text{ in})}{2}\right)^2$ $A = 7.0686 \text{ ft}^2$ q - End-bearing pressure $q = \frac{P_o}{A}$ $q = \frac{(3.093 \text{ kip})}{(7.0686 \text{ ft}^2)}$ $q = 0.43757 \text{ kip/ft}^2$ Check bearing capacity ratio: Ratio - Capacity $Ratio = \frac{q}{q_a}$ $Ratio = \frac{(0.43757 \text{ kip/ft}^2)}{(2000 \text{ psf})}$ $Ratio = 0.21878$	Status: PASS Ratio: 0.220
Czerniak	Lateral Soil Pressure (ASD): L/D - Length to least lateral dimension ratio, $L/D = \frac{L}{D}$ $L/D = \frac{(8.25 \text{ ft})}{(36 \text{ in})}$	

$$L/D = 2.75$$

Since $L/D \leq 10$,

Pile is short.

Considering x-direction:

$H_o = -0.775$ kip/ft - Lateral force per length of pile,

$M_o = 7.303$ kipft/ft - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (7.303 \text{ kipft/ft}) \times (8.25 \text{ ft})) + (3 \times (-0.775 \text{ kip/ft}) \times (8.25 \text{ ft})^2)}{(6 \times (7.303 \text{ kipft/ft})) + (4 \times (-0.775 \text{ kip/ft}) \times (8.25 \text{ ft}))}$$

$$a = 5.7534 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{1.178 [(4 M_o) + (3 H_o L_e)]^2}{L_e^3 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{1.178 \times [(4 \times (7.303 \text{ kipft/ft})) + (3 \times (-0.775 \text{ kip/ft}) \times (8.25 \text{ ft}))]^2}{(8.25 \text{ ft})^3 \times [(3 \times (7.303 \text{ kipft/ft})) + (2 \times (-0.775 \text{ kip/ft}) \times (8.25 \text{ ft}))]}$$

$$p = 0.19091 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{9.425 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{9.425 \times [(2 \times (7.303 \text{ kipft/ft})) + ((-0.775 \text{ kip/ft}) \times (8.25 \text{ ft}))]}{(8.25 \text{ ft})^2}$$

$$s = 1.1372 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(5.7534 \text{ ft})}{2}$$

$$p_a = 0.4315 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{p}{p_a}$$

$$\text{Ratio} = \frac{(0.19091 \text{ kip/ft}^2)}{(0.4315 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.44244$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (8.25 \text{ ft})$$

$$p_s = 1.2375 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity


$$\text{Ratio} = \frac{s}{p_s}$$


$$\text{Ratio} = \frac{(1.1372 \text{ kip/ft}^2)}{(1.2375 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.91895$$

Status: **PASS**
Ratio: **0.440**

Status: **PASS**
Ratio: **0.920**



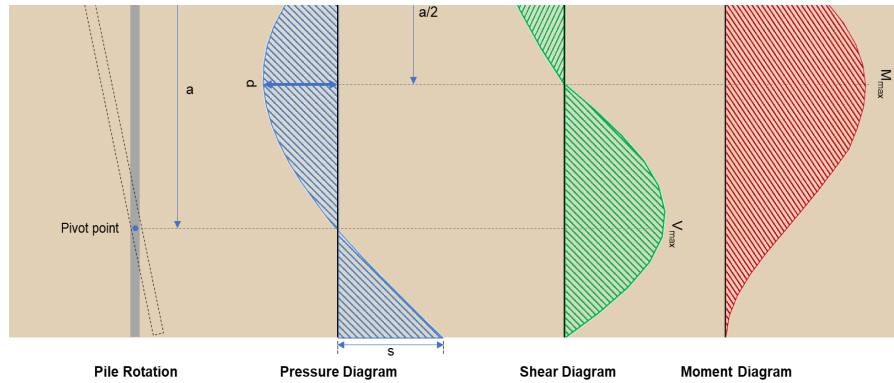

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{D}$$

$$H_o = \frac{(-3.861 \text{ kip})}{(36 \text{ in})}$$

$$H_o = -1.287 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_x H)}{D}$$

$$M_o = \frac{(36.863 \text{ kipft}) + ((-3.861 \text{ kip}) \times (0 \text{ ft}))}{(36 \text{ in})}$$

$$M_o = 12.288 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(12.288 \text{ kipft/ft})}{(-1.287 \text{ kip/ft})}$$

$$E = 9.5475 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (12.288 \text{ kipft/ft}) \times (8.25 \text{ ft})) + (3 \times (-1.287 \text{ kip/ft}) \times (8.25 \text{ ft})^2)}{(6 \times (12.288 \text{ kipft/ft})) + (4 \times (-1.287 \text{ kip/ft}) \times (8.25 \text{ ft}))}$$

$$a = 5.7513 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-1.287 \text{ kip/ft}) \times (36 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (9.5475 \text{ ft})}{(8.25 \text{ ft})} + 3 \right) \times \left(\frac{(5.7513 \text{ ft})}{(8.25 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (9.5475 \text{ ft})}{(8.25 \text{ ft})} + 2 \right) \times \left(\frac{(5.7513 \text{ ft})}{(8.25 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 10.454 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-1.287 \text{ kip/ft}) \times (36 \text{ in}) \times (8.25 \text{ ft})) \times \left[\left(\frac{(9.5475 \text{ ft})}{(8.25 \text{ ft})} + \frac{(5.7513 \text{ ft})}{2 \times (8.25 \text{ ft})} \right) - \left[\left(\frac{4 \times (9.5475 \text{ ft})}{(8.25 \text{ ft})} + 3 \right) \times \left(\frac{(5.7513 \text{ ft})}{2 \times (8.25 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (9.5475 \text{ ft})}{(8.25 \text{ ft})} + 2 \right) \times \left(\frac{(5.7513 \text{ ft})}{2 \times (8.25 \text{ ft})} \right)^4 \right] \right]$$

		$M_{max} = 40.247 \text{ kipft}$	
Table 22.4.2.1	22.4.2.2, 10.6.1.1	Minimum Reinforcement Check (LRFD) Parameters: $f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength, $f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength, $\phi = 0.65$ - Reduction factor for axial strength, $\alpha = 0.85$ - Alpha factor for axial strength, $A_g = 1017.9 \text{ in}^2$ - Gross area of concrete, Longitudinal reinforcement: Required reinforcement due to axial load, $A_{st,required}$ $A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$ $A_{st,required} = \text{Min} \left[\frac{\frac{(4.577 \text{ kip})}{(0.65) \times (0.85)} - (0.85 \times (2.5 \text{ ksi}) \times (1017.9 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (1017.9 \text{ in}^2)) \right]$ $A_{st,required} = -37.23 \text{ in}^2$ A_{min} - Governing minimum reinforcement area, $A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$ $A_{min} = \text{Max} [(-37.23 \text{ in}^2), (0.0018 \times (1017.9 \text{ in}^2))]$ $A_{min} = 1.8322 \text{ in}^2$ n_{rebar} - Required number of reinforcement, $n_{rebar} = \frac{A_{min}}{A_{rebar}}$ $n_{rebar} = \frac{(1.8322 \text{ in}^2)}{(0.3068 \text{ in}^2)}$ $n_{rebar} = 6$ A_{st} - Actual total reinforcement area, $A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$ $A_{st} = (6) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$ $A_{st} = 1.8408 \text{ in}^2$ Ratio - Capacity $\text{Ratio} = \frac{A_{min}}{A_{st}}$ $\text{Ratio} = \frac{(1.8322 \text{ in}^2)}{(1.8408 \text{ in}^2)}$ $\text{Ratio} = 0.99533$ 25.2.3 s_{rebar} - Minimum spacing of reinforcement, $s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$ $s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$ $s_{rebar} = 1.5 \text{ in}$ Ties: 25.7.2.2 Since longitudinal reinforcement is $\leq \text{No. } 10\emptyset$: Use #3(0.375 in) 25.7.2.1 s_{ties} - Maximum center-to-center spacing of ties, $s_{ties} = \text{Min} [(16 d_{bar}), (48 d_{ties}), D]$ $s_{ties} = \text{Min} [(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), (36 \text{ in})]$ $s_{ties} = 10 \text{ in}$ Summary:	Status: PASS Ratio: 1.000

	Main reinforcement: 6 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in	
22.4.2.2	Axial Compression Strength (ACI 318-19, LRFD) ϕP_N - Allowable axial compressive strength $\phi P_N = \phi 0.85 \left[(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st}) \right]$ $\phi P_N = (0.65) \times 0.85 \times \left[(0.85 \times (2.5 \text{ ksi}) \times [(1017.9 \text{ in}^2) - (1.8408 \text{ in}^2)]) + ((60 \text{ ksi}) \times (1.8408 \text{ in}^2)) \right]$ $\phi P_N = 1253.9 \text{ kip}$ Ratio - Capacity $Ratio = \frac{P}{\phi P_N}$ $Ratio = \frac{(4.577 \text{ kip})}{(1253.9 \text{ kip})}$ $Ratio = 0.0036502$	Status: PASS Ratio: 0.000
22.5.2.2	Shear Strength (ACI 318-19, LRFD) Parameters: $b_w = 36 \text{ in}$ - Effective width, d - Effective depth $d = 0.80 D$ $d = 0.80 \times (36 \text{ in})$ $d = 28.8 \text{ in}$	
22.5.5.1.3	λ_s - size effect modification factor $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$ $\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(28.8 \text{ in})}{10}}}, 1 \right]$ $\lambda_s = 0.71796$	
22.5.5.1.1	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,max}$ - Max shear strength of concrete $V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$ $V_{c,max} = 5 \times (0.71796) \times \sqrt{(2500 \text{ psi})} \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,max} = 186.09 \text{ kip}$	
22.5.5.1.1(a)	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 4.577 \text{ kip} \rightarrow 4577 \text{ lbf}$, $V_{c,a}$ - Shear strength of concrete (a) $V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$ $V_{c,a} = \left[2 \times (0.71796) \times \sqrt{(2500 \text{ psi})} + \frac{(4577 \text{ lbf})}{6 \times (1017.9 \text{ in}^2)} \right] \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,a} = 75.215 \text{ kip}$	
22.5.5.1.2	The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{c,b}$ - Shear strength of concrete (b) $V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$ $V_{c,b} = \left[2 \times (0.71796) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{c,b} = 204.04 \text{ kip}$ V_c - Governing shear strength of concrete $V_c = Min [V_{c,max}, V_{c,a}, V_{c,b}]$ $V_c = Min [(186.09 \text{ kip}), (75.215 \text{ kip}), (204.04 \text{ kip})]$	

22.5.1.2	$V_c = 75.215 \text{ kip}$ The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $V_{s,a}$ - Shear strength of steel (a) $V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$ $V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (36 \text{ in}) \times (28.8 \text{ in})$ $V_{s,a} = 414.72 \text{ kip}$ A_v - Ties rebar area, $A_v = \frac{\pi d_{ties}^2}{4}$ $A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$ $A_v = 0.11045 \text{ in}^2$ 22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b) $V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$ $V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (28.8 \text{ in})}{(10 \text{ in})}$ $V_{s,b} = 38.17 \text{ kip}$ V_s - Governing shear strength of steel $V_s = MIN[V_{s,a}, V_{s,b}]$ $V_s = MIN[(414.72 \text{ kip}), (38.17 \text{ kip})]$ $V_s = 38.17 \text{ kip}$ 22.5.1.1 ϕV_n - Allowable shear strength $\phi V_n = \phi (V_c + V_s)$ $\phi V_n = (0.65) \times ((75.215 \text{ kip}) + (38.17 \text{ kip}))$ $\phi V_n = 73.7 \text{ kip}$ Considering x-direction: $V_{max} = 10.454 \text{ kip}$ - Maximum shear force in the x-direction, $Ratio$ - Capacity $Ratio = \frac{V_{max}}{\phi V_n}$ $Ratio = \frac{(10.454 \text{ kip})}{(73.7 \text{ kip})}$ $Ratio = 0.14185$ Status: PASS Ratio: 0.140	
14.5.2.1b	Flexural Strength (ACI 318-19, LRFD) S_m - Section modulus $S_m = \frac{\pi D^3}{32}$ $S_m = \frac{\pi \times (36 \text{ in})^3}{32}$ $S_m = 4580.4 \text{ in}^3$ $\lambda = 1$ - Concrete modification factor (Normal concrete), Allowable flexural strength: M_n shall be the lesser of: $\phi M_{n,1}$ $\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$ $\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 4580.442 \text{ in}^3$ $\phi M_{n,1} = 62.027 \text{ kipft}$ $\phi M_{n,2}$	

$$\phi M_{n,2} = \phi 0.85 f'_{ck} S_m$$

$$\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (4580.4 \text{ in}^3)$$

$$\phi M_{n,2} = 527.23 \text{ kipft}$$

Therefore,

ϕM_n - Allowable flexural strength,

$$\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$$

$$\phi M_n = \text{MIN}[(62.027 \text{ kipft}), (527.23 \text{ kipft})]$$

$$\phi M_n = 62.027 \text{ kipft}$$

Considering x-direction:

$M_{max} = 40.247 \text{ kipft}$ - Maximum moment in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{M_{max}}{\phi M_n}$$

$$\text{Ratio} = \frac{(40.247 \text{ kipft})}{(62.027 \text{ kipft})}$$

$$\text{Ratio} = 0.64887$$

Status: **PASS**
Ratio: **0.650**