

Project Name: Autobase Tampa **Date:** Wed Jul 23 2025
Location: 5305 Garden Ln, Tampa, FL 33610, USA **Number of Modules:** 68
Unique ID: 5P-19.75-6TOP-SD-57-L-4Hx17W-J1D6 **Number of Poles:** 5
Dealer: _____ **Date Sold:** _____



Array Dimensions N/S	15.05 ft
Array Dimensions E/W	97.45 ft
Winter Tilt Angle	5
Front Edge Clearance	10 ft


MT Solar Bill of Materials (5P-19.75-6TOP-SD-57-L-4Hx17W-J1D6)

Part	Short Description	BOM Qty
MTS-PC-6	6IN Pole Cap Assembly	5
MTS-HF-SD	H-Frame Assembly-SD	5
MTS-SD-Wing-57	57IN SD Wing	4
MTS-SD-Splice-90	90IN SD Splice	8
MTS-SD-Splice-57	57IN SD Splice	8
MTS-CLAMP-HOOK-4PK	Hook Clamp	17

Rail Bill of Materials

Part	Qty
Rails (181in)	34
Rail Attachment	68
Module Mid Clamp	102
Module End Clamp	68
Ground Lug	17

Site Details:

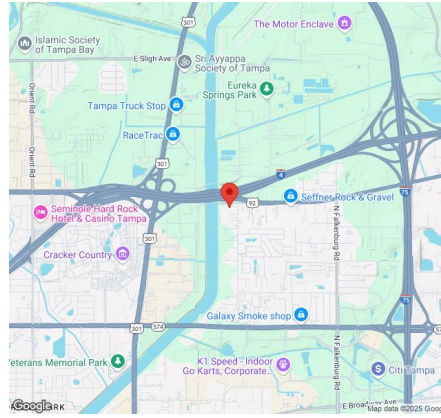

Site Address: 5305 Garden Ln, Tampa, FL 33610, USA

Array Specification

Duty Classification:	SD
Module Width:	44.65 in
Module Length:	67.79in
Number of Rows:	4
Number of Columns:	17
Total Number of Modules:	68
Winter Tilt Angle:	5
Front Edge Clearance:	10
Total Array Height at Tilt:	11.31 ft
Total Frame Length:	96.00 ft
Module Info/Notes:	JKM430N-54HL4-B
Array Dimensions N/S:	15.05 ft
Array Dimensions E/W:	97.45 ft
Rail Length:	180.60 in
Rail Spacing:	2.87 ft

Support Specifications

Pole Size:	6in Pipe Sch 40
Pole Length above Grade:	10.66 ft
Number of Poles:	5
Pole Spacing:	19.75 ft

Foundation Specifications

Foundation Type:	Square
Foundation Dimensions:	48 x 48 in
Foundation Depth (below grade):	Pile 1: 4.75 ft Pile 2: 5.00 ft Pile 3: 5.00 ft Pile 4: 5.00 ft Pile 5: 4.75 ft
Foundation Volume:	14.519 y ³

Site Info

Risk Category:	I
Exposure:	B
Soil Classification:	sand
Site Location:	5305 Garden Ln, Tampa, FL 33610, USA
Wind Speed:	130 mph

Snow Load:

0 psf

Design Disclaimer



This software should be used for preliminary designs and should not be used as a final design unless reviewed, verified and designed by a qualified structural engineer.



AutoDesigner Input

```
{ "wind_speed_override": null, "snow_load_override": null, "direct_snow_load": false, "add_angle_brace": false, "product_type": "Beam", "designer_name": "Jaime", "designer_email": "jaime@gosolarpower.com", "designer_phone": "5614031089", "project_id": "Autobase Tampa", "site_address": "5305 Garden Ln, Tampa, FL 33610, USA", "module_info": "JKM430N-54HL4-B", "module_width": 44.65, "module_length": 67.79, "number_rows": 4, "number_columns": 17, "pole_mount_section": "4_40", "core_pipe_width": 65, "core_pipe_section": "2_40", "adjuster_section": "2_40", "core_beam_height": 65, "core_beam_section": "HSS3x2x1/8", "main_pipe_section": "2_12GA", "pole_spacing": 15, "tilt_angle": 5, "ground_clearance": 10, "risk_category": "I", "exposure_category": "B", "frame_duty_override": "auto", "pole_override": "auto", "soil_type": "sand", "customer_foundation_override": "48_Square", "foundation_type": "Square", "foundation_size": 48, "check_rails": false }
```

Design Notes:



- AISC Deflection checks are set to L/1 due to structure design intent
- Foundation Soil Parameters used in this Autodesign are all estimates, proper geotechnical reports are required to confirm soil profiles
- Wind speeds, snow loads and other site specific results are based on ASCE 7 2016
- Steel frame design checks are based on AISC 360 2016 (LRFD)
- Foundation Design and Sizing is approximate only

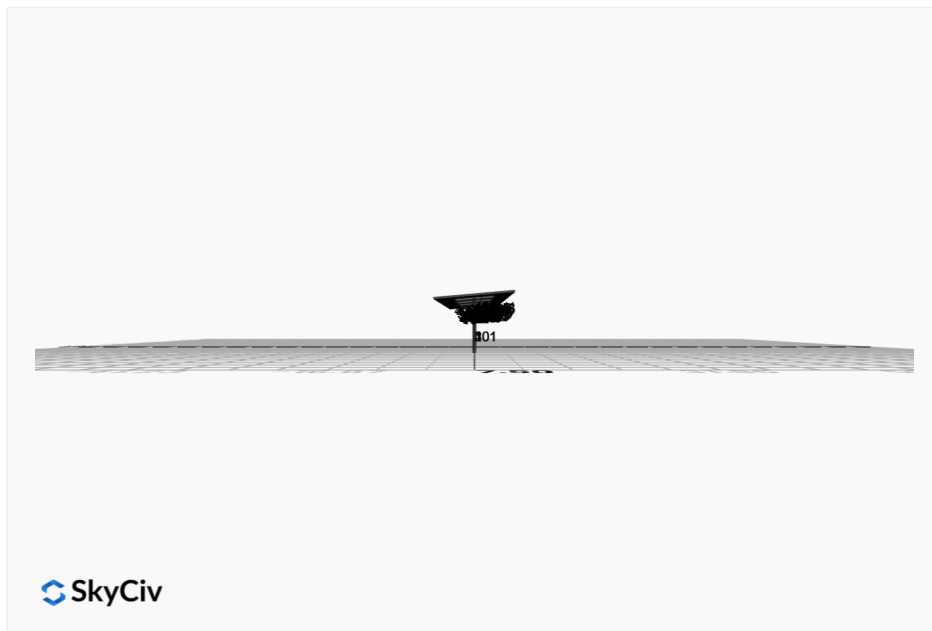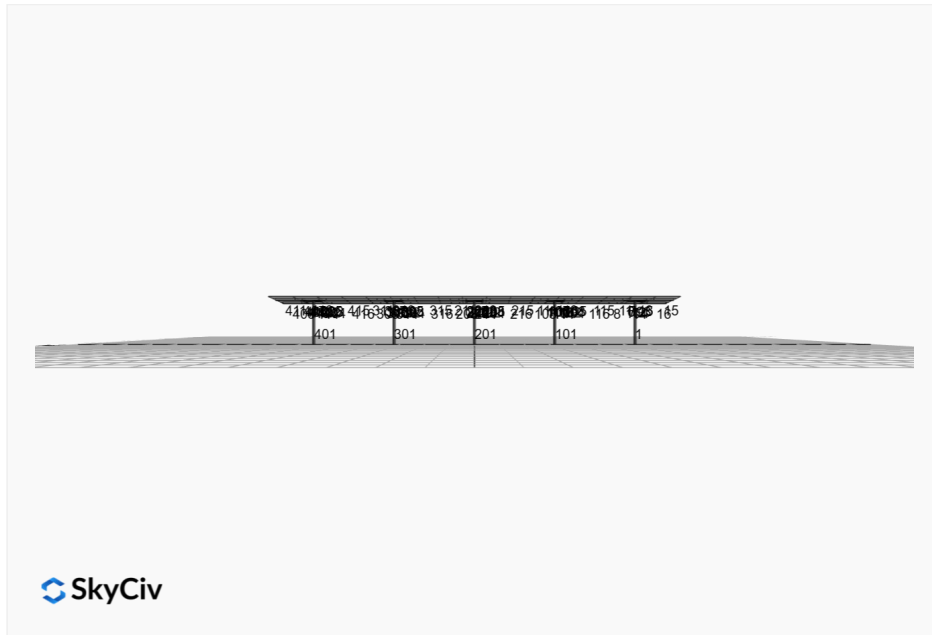


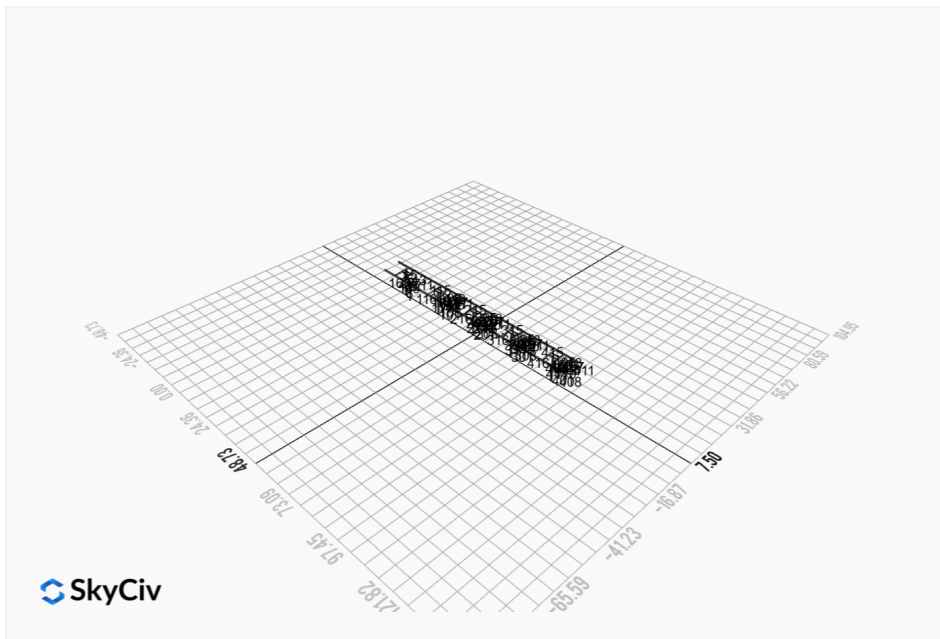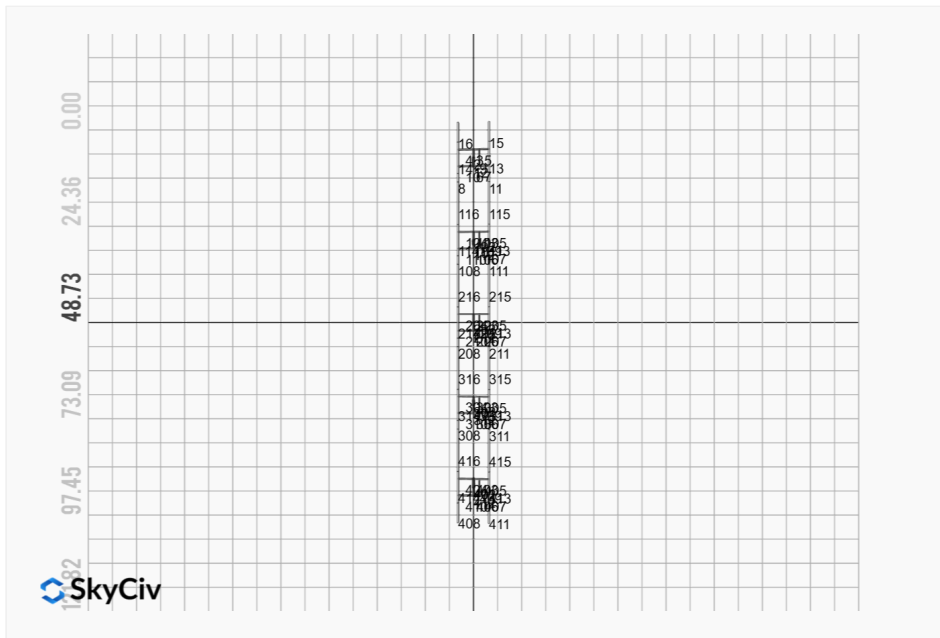

FEM Results (Envelope Worst Case for each member)



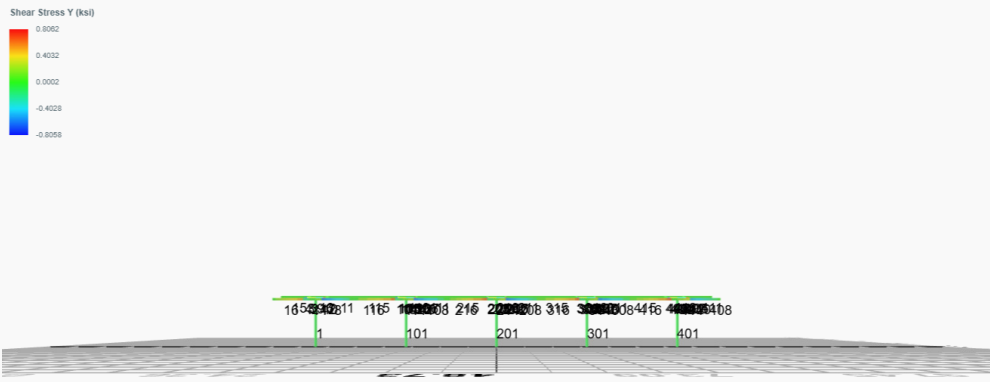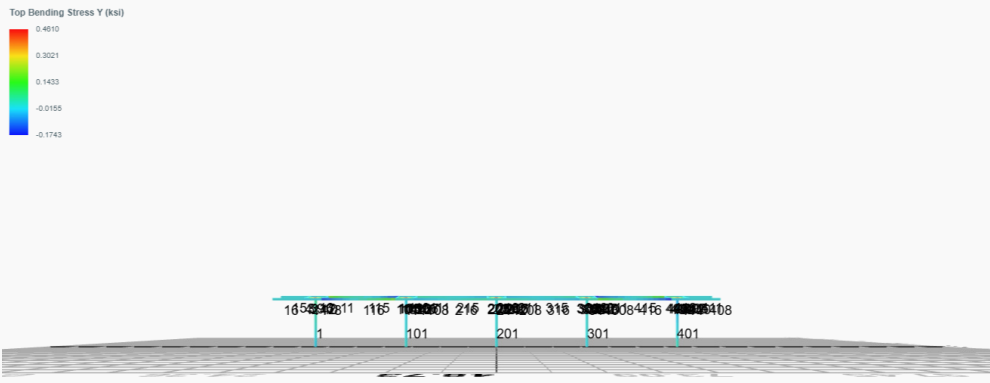

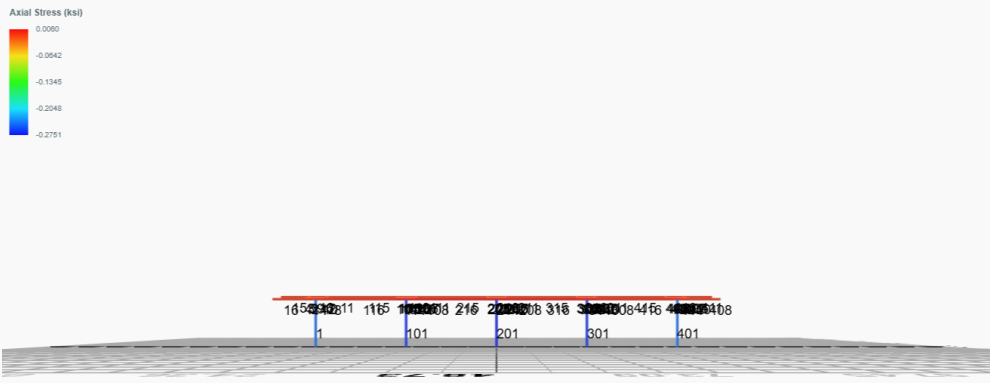

Reaction Forces for Foundation 1 (Node ID#1), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 2. D + L	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 3. D + (S or Lr or R)	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 3. D + (S or Lr or R)	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 5b. D + 0.7E	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0006	2.0132	-0.0073	-0.0239	0.0027	0.0268
ULS: 8. 0.6D + 0.7E	-0.0004	1.2079	-0.0044	-0.0144	0.0016	0.0161
ULS: 5a. D + 0.6W_Wind downforce Case A only	-0.2817	5.1939	-0.0209	-0.0691	0.0047	3.7424
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.2817	5.1939	-0.0209	-0.0691	0.0047	3.7424
ULS: 5a. D + 0.6W_Wind uplift Case A only	0.0720	1.1550	-0.0032	-0.0105	-0.0001	2.4608
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.1838	-0.0065	0.0005	0.0021	0.0056	-8.9188
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2114	4.3987	-0.0175	-0.0578	0.0042	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2114	4.3987	-0.0175	-0.0578	0.0042	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0539	1.3695	-0.0042	-0.0139	0.0006	1.8523
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1377	0.4985	-0.0015	-0.0044	0.0048	-6.6824
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2114	4.3987	-0.0175	-0.0578	0.0042	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2114	4.3987	-0.0175	-0.0578	0.0042	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0539	1.3695	-0.0042	-0.0139	0.0006	1.8523
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1377	0.4985	-0.0015	-0.0044	0.0048	-6.6824
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-0.2814	4.3887	-0.0180	-0.0595	0.0036	3.7317
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.2814	4.3887	-0.0180	-0.0595	0.0036	3.7317
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	0.0723	0.3497	-0.0003	-0.0009	-0.0012	2.4501
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.1841	-0.8117	0.0034	0.0117	0.0045	-8.9295

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	7.7171
Shear X	-0.4693
Shear Z	-0.0315
Moment X	-0.1044
Moment Y (Twist)	0.0083
Moment Z	15.2187

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	5.1939
Shear X	-0.2817
Shear Z	-0.0209
Moment X	-0.0691
Moment Y (Twist)	0.0056
Moment Z	8.9295

Reaction Forces for Foundation 2 (Node ID#101), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 2. D + L	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 3. D + (S or Lr or R)	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 3. D + (S or Lr or R)	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 5b. D + 0.7E	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0008	2.1146	0.0029	0.0091	-0.0013	0.0144
ULS: 8. 0.6D + 0.7E	0.0005	1.2688	0.0017	0.0055	-0.0008	0.0086
ULS: 5a. D + 0.6W_Wind downforce Case A only	-0.2925	5.4891	0.0086	0.0273	-0.0051	3.8981
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.2925	5.4891	0.0086	0.0273	-0.0051	3.8981
ULS: 5a. D + 0.6W_Wind uplift Case A only	0.0821	1.2039	0.0017	0.0053	-0.0030	2.5262
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.1831	-0.0278	-0.0014	-0.0039	0.0063	-9.2600
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2191	4.6455	0.0072	0.0228	-0.0042	2.9272
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2191	4.6455	0.0072	0.0228	-0.0042	2.9272
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0618	1.4315	0.0020	0.0063	-0.0026	1.8983
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1376	0.5078	-0.0003	-0.0006	0.0044	-6.9414
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2191	4.6455	0.0072	0.0228	-0.0042	2.9272
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2191	4.6455	0.0072	0.0228	-0.0042	2.9272
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0618	1.4315	0.0020	0.0063	-0.0026	1.8983
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1376	0.5078	-0.0003	-0.0006	0.0044	-6.9414
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-0.2928	4.6433	0.0075	0.0237	-0.0046	3.8924
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.2928	4.6433	0.0075	0.0237	-0.0046	3.8924
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	0.0818	0.3580	0.0006	0.0017	-0.0025	2.5205
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.1828	-0.8736	-0.0025	-0.0076	0.0068	-9.2658

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	8.1617
Shear X	-0.4888
Shear Z	0.0131
Moment X	0.0415
Moment Y (Twist)	0.0126
Moment Z	15.8032

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	5.4891
Shear X	-0.2928
Shear Z	0.0086
Moment X	0.0273
Moment Y (Twist)	0.0068
Moment Z	9.2658

Reaction Forces for Foundation 3 (Node ID#201), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 2. D + L	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 3. D + (S or Lr or R)	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 3. D + (S or Lr or R)	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 5b. D + 0.7E	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0005	2.1349	0.0000	-0.0002	-0.0001	0.0249
ULS: 8. 0.6D + 0.7E	-0.0003	1.2809	0.0000	-0.0001	-0.0000	0.0150
ULS: 5a. D + 0.6W_Wind downforce Case A only	-0.2974	5.5486	0.0001	-0.0006	-0.0002	3.9612
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.2974	5.5486	0.0001	-0.0006	-0.0002	3.9612
ULS: 5a. D + 0.6W_Wind uplift Case A only	0.0818	1.2138	0.0000	-0.0001	-0.0001	2.5714
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.1840	-0.0328	-0.0000	0.0000	0.0001	-9.3714

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2232	4.6952	0.0001	-0.0005	-0.0001	2.9771
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2232	4.6952	0.0001	-0.0005	-0.0001	2.9771
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0613	1.4440	0.0000	-0.0001	-0.0001	1.9348
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1379	0.5091	0.0000	-0.0000	0.0000	-7.0223
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2232	4.6952	0.0001	-0.0005	-0.0001	2.9771
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2232	4.6952	0.0001	-0.0005	-0.0001	2.9771
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0613	1.4440	0.0000	-0.0001	-0.0001	1.9348
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1379	0.5091	0.0000	-0.0000	0.0000	-7.0223
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-0.2972	4.6947	0.0001	-0.0005	-0.0001	3.9512
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.2972	4.6947	0.0001	-0.0005	-0.0001	3.9512
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	0.0820	0.3598	0.0000	-0.0000	-0.0001	2.5615
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.1842	-0.8867	-0.0000	0.0001	0.0001	-9.3813

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	8.2515
Shear X	-0.4954
Shear Z	0.0002
Moment X	-0.0009
Moment Y (Twist)	0.0003
Moment Z	16.0020

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	5.5486
Shear X	-0.2974
Shear Z	0.0001
Moment X	-0.0006
Moment Y (Twist)	0.0002
Moment Z	9.3813

Reaction Forces for Foundation 4 (Node ID#301), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 2. D + L	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 3. D + (S or Lr or R)	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 3. D + (S or Lr or R)	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 5b. D + 0.7E	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	0.0008	2.1146	-0.0030	-0.0101	0.0014	0.0143
ULS: 8. 0.6D + 0.7E	0.0005	1.2687	-0.0018	-0.0061	0.0008	0.0086
ULS: 5a. D + 0.6W_Wind downforce Case A only	-0.2925	5.4890	-0.0089	-0.0303	0.0051	3.8981
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.2925	5.4890	-0.0089	-0.0303	0.0051	3.8981
ULS: 5a. D + 0.6W_Wind uplift Case A only	0.0821	1.2038	-0.0018	-0.0058	0.0030	2.5264
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.1831	-0.0278	0.0014	0.0041	-0.0060	-9.2605
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2191	4.6454	-0.0075	-0.0252	0.0042	2.9271
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2191	4.6454	-0.0075	-0.0252	0.0042	2.9271
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0618	1.4315	-0.0021	-0.0069	0.0026	1.8984
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1376	0.5078	0.0003	0.0006	-0.0042	-6.9418
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2191	4.6454	-0.0075	-0.0252	0.0042	2.9271
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2191	4.6454	-0.0075	-0.0252	0.0042	2.9271
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0618	1.4315	-0.0021	-0.0069	0.0026	1.8984
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1376	0.5078	0.0003	0.0006	-0.0042	-6.9418

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-0.2928	4.6432	-0.0078	-0.0262	0.0046	3.8924
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.2928	4.6432	-0.0078	-0.0262	0.0046	3.8924
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	0.0818	0.3580	-0.0006	-0.0018	0.0025	2.5207
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.1828	-0.8736	0.0026	0.0082	-0.0066	-9.2662

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	8.1616
Shear X	-0.4888
Shear Z	-0.0136
Moment X	-0.0460
Moment Y (Twist)	0.0123
Moment Z	15.8039

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	5.4890
Shear X	-0.2928
Shear Z	-0.0089
Moment X	-0.0303
Moment Y (Twist)	0.0066
Moment Z	9.2662

Reaction Forces for Foundation 5 (Node ID#401), (kip, kip-ft)

ASD Load Combination Results

Name	Fx	Fy	Fz	Mx	My	Mz
ULS: 1. D	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 2. D + L	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 3. D + (S or Lr or R)	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 3. D + (S or Lr or R)	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 4. D + 0.75L + 0.75(S or Lr or R)	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 5b. D + 0.7E	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 6b. D + 0.75L + 0.75(0.7)E + 0.75S	-0.0006	2.0132	0.0074	0.0235	-0.0028	0.0268
ULS: 8. 0.6D + 0.7E	-0.0004	1.2079	0.0044	0.0141	-0.0017	0.0161
ULS: 5a. D + 0.6W_Wind downforce Case A only	-0.2817	5.1938	0.0211	0.0678	-0.0050	3.7425
ULS: 5a. D + 0.6W_Wind downforce Case B only	-0.2817	5.1938	0.0211	0.0678	-0.0050	3.7425
ULS: 5a. D + 0.6W_Wind uplift Case A only	0.0720	1.1550	0.0032	0.0103	-0.0001	2.4613
ULS: 5a. D + 0.6W_Wind uplift Case B only	0.1838	-0.0064	-0.0005	-0.0021	-0.0056	-8.9197
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2114	4.3987	0.0177	0.0567	-0.0044	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2114	4.3987	0.0177	0.0567	-0.0044	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0539	1.3695	0.0043	0.0136	-0.0008	1.8526
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1377	0.4985	0.0015	0.0043	-0.0049	-6.6831
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case A only	-0.2114	4.3987	0.0177	0.0567	-0.0044	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind downforce Case B only	-0.2114	4.3987	0.0177	0.0567	-0.0044	2.8135
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case A only	0.0539	1.3695	0.0043	0.0136	-0.0008	1.8526
ULS: 6a. D + 0.75L + 0.75(0.6)W + 0.75(S or Lr or R)_Wind uplift Case B only	0.1377	0.4985	0.0015	0.0043	-0.0049	-6.6831
ULS: 7. 0.6D + 0.6W_Wind downforce Case A only	-0.2814	4.3886	0.0182	0.0584	-0.0038	3.7317
ULS: 7. 0.6D + 0.6W_Wind downforce Case B only	-0.2814	4.3886	0.0182	0.0584	-0.0038	3.7317
ULS: 7. 0.6D + 0.6W_Wind uplift Case A only	0.0723	0.3497	0.0003	0.0009	0.0011	2.4505
ULS: 7. 0.6D + 0.6W_Wind uplift Case B only	0.1840	-0.8117	-0.0034	-0.0115	-0.0045	-8.9304

Worst Case Reactions LRFD

These calculations are taken directly from the FEA via SkyCiv and are used in the Concrete Checks of the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Worst Case Reactions ASD

These results are taken from the worst case values in the above table and are used in the Soil Checks in the Foundation Module.
Note: Worst case values are assumed as downforce wind load cases.

Result	Value (kip, kip-ft)
Axial	7.7170
Shear X	-0.4693
Shear Z	0.0318
Moment X	0.1024
Moment Y (Twist)	0.0083
Moment Z	15.2202

Result	Value (kip, kip-ft)
Axial	5.1938
Shear X	-0.2817
Shear Z	0.0211
Moment X	0.0678
Moment Y (Twist)	0.0056
Moment Z	8.9304

Project Details

Design Code: AISC 360-16 LRFD
 Provision: LRFD
 Country: United States
 User Name: sales@mtsolar.us
 Unit System: imperial




Design Input Information


Design Factors			
Φ_t	Φ_c	Φ_b	Φ_v
0.9	0.9	0.9	0.9

Design Materials			
ID	E (ksi)	F_y (ksi)	F_u (ksi)
1	29000	50	65


Section Dimensions



ID	Name	d (in)	t_w (in)				
1	2in Pipe Sch 40	2.38	0.15				
4	4in Pipe Sch 40	4.50	0.24				
7	6in Pipe Sch 40	6.63	0.28				



ID	Name	d (in)	b (in)	t_w (in)	t_b (in)	r (in)	
15	HSS5x3x1/8	5.00	3.00	0.12	0.12	0.12	



ID	Name	d (in)	t_w (in)	b_t (in)	b_b (in)	t_t (in)	t_b (in)	r (in)
18	W6x9	5.90	0.17	3.94	3.94	0.21	0.21	0.25

Section Properties

ID	Name	A (in ²)	J (in ⁴)	I_{yp} (in ⁴)	I_{zp} (in ⁴)	I_w (in ⁶)	S_{yp} (in ³)	S_{zp} (in ³)

104	79.65	72.84	10.99	6.26	29.14	16.61
105	79.65	74.30	10.99	6.26	29.14	16.61
106	79.65	74.89	10.99	6.26	29.14	16.61
107	79.65	74.30	10.99	6.26	29.14	16.61
108	120.60	115.40	23.36	6.45	30.09	45.74
109	48.35	43.11	2.85	2.85	14.51	14.51
110	79.65	72.84	10.99	6.26	29.14	16.61
111	120.60	115.40	23.36	6.45	30.09	45.74
112	142.83	141.72	16.17	16.17	42.85	42.85
113	120.60	84.02	18.36	6.45	30.09	45.74
114	120.60	84.02	18.23	6.45	30.09	45.74
115	120.60	33.17	16.04	6.45	30.09	45.74
116	120.60	33.17	16.02	6.45	30.09	45.74
201	251.16	88.17	42.30	42.30	75.35	75.35
202	142.83	141.72	16.17	16.17	42.85	42.85
203	79.65	74.89	10.99	6.26	29.14	16.61
204	79.65	72.84	10.99	6.26	29.14	16.61
205	79.65	74.30	10.99	6.26	29.14	16.61
206	79.65	74.89	10.99	6.26	29.14	16.61
207	79.65	74.30	10.99	6.26	29.14	16.61
208	120.60	115.40	23.36	6.45	30.09	45.74
209	48.35	43.11	2.85	2.85	14.51	14.51
210	79.65	72.84	10.99	6.26	29.14	16.61
211	120.60	115.40	23.36	6.45	30.09	45.74
212	142.83	141.72	16.17	16.17	42.85	42.85
213	120.60	84.03	18.27	6.45	30.09	45.74
214	120.60	84.03	18.15	6.45	30.09	45.74
215	120.60	33.17	15.94	6.45	30.09	45.74
216	120.60	33.17	15.87	6.45	30.09	45.74
301	251.16	88.17	42.30	42.30	75.35	75.35
302	142.83	141.72	16.17	16.17	42.85	42.85
303	79.65	74.89	10.99	6.26	29.14	16.61
304	79.65	72.84	10.99	6.26	29.14	16.61
305	79.65	74.30	10.99	6.26	29.14	16.61
306	79.65	74.89	10.99	6.26	29.14	16.61
307	79.65	74.30	10.99	6.26	29.14	16.61
308	120.60	115.40	23.36	6.45	30.09	45.74
309	48.35	43.11	2.85	2.85	14.51	14.51
310	79.65	72.84	10.99	6.26	29.14	16.61
311	120.60	115.40	23.36	6.45	30.09	45.74
312	142.83	131.65	16.17	16.17	42.85	42.85
313	120.60	84.02	18.35	6.45	30.09	45.74
314	120.60	84.02	18.23	6.45	30.09	45.74
315	120.60	33.17	15.90	6.45	30.09	45.74
316	120.60	33.17	15.80	6.45	30.09	45.74
401	251.16	88.17	42.30	42.30	75.35	75.35
402	142.83	141.72	16.17	16.17	42.85	42.85
403	79.65	74.89	10.99	6.26	29.14	16.61
404	79.65	72.84	10.99	6.26	29.14	16.61
405	79.65	74.30	10.99	6.26	29.14	16.61
406	79.65	74.89	10.99	6.26	29.14	16.61
407	79.65	74.30	10.99	6.26	29.14	16.61

407	79.03	74.30	10.99	0.20	29.14	10.01
408	120.60	34.69	23.36	6.45	30.09	45.74
409	48.35	43.11	2.85	2.85	14.51	14.51
410	79.65	72.84	10.99	6.26	29.14	16.61
411	120.60	34.69	23.36	6.45	30.09	45.74
412	142.83	141.72	16.17	16.17	42.85	42.85
413	120.60	84.03	19.35	6.45	30.09	45.74
414	120.60	84.03	19.26	6.45	30.09	45.74
415	120.60	33.17	16.10	6.45	30.09	45.74
416	120.60	33.17	15.93	6.45	30.09	45.74

Design Ratio

Member ID	P	M _z	M _y	V _y	V _z	(P,M _z ,M _y)	Worst LC	KL/r	δ	Status
1	0.088	0.360	0.005	0.006	0.000	0.362	#16	0.598	Not Required	Pass
2	0.000	0.428	0.030	0.088	0.005	0.459	#13	0.052	Not Required	Pass
3	0.001	0.657	0.007	0.067	0.001	0.665	#13	0.044	Not Required	Pass
4	0.001	0.613	0.012	0.062	0.002	0.618	#13	0.078	Not Required	Pass
5	0.001	0.407	0.013	0.066	0.003	0.410	#13	0.073	Not Required	Pass
6	0.001	0.646	0.006	0.065	0.001	0.648	#13	0.044	Not Required	Pass
7	0.001	0.401	0.018	0.065	0.004	0.402	#13	0.073	Not Required	Pass
8	0.000	0.046	0.012	0.039	0.001	0.049	#13	0.088	Not Required	Pass
9	0.001	0.079	0.009	0.001	0.000	0.088	#13	0.198	Not Required	Pass
10	0.001	0.600	0.017	0.061	0.003	0.610	#13	0.078	Not Required	Pass
11	0.000	0.048	0.012	0.042	0.001	0.052	#13	0.088	Not Required	Pass
12	0.000	0.414	0.030	0.086	0.005	0.444	#13	0.034	Not Required	Pass
13	0.000	0.231	0.023	0.054	0.001	0.239	#13	0.265	Not Required	Pass
14	0.000	0.221	0.022	0.051	0.001	0.228	#13	0.177	Not Required	Pass
15	0.000	0.099	0.010	0.032	0.001	0.107	#13	Not Required	Not Required	Pass
16	0.000	0.092	0.010	0.030	0.001	0.100	#13	Not Required	Not Required	Pass
101	0.093	0.374	0.002	0.006	0.000	0.376	#16	0.598	Not Required	Pass
102	0.000	0.439	0.031	0.092	0.006	0.470	#13	0.111	Not Required	Pass
103	0.001	0.688	0.005	0.070	0.001	0.693	#13	0.044	Not Required	Pass
104	0.001	0.642	0.013	0.065	0.002	0.652	#13	0.078	Not Required	Pass
105	0.001	0.427	0.012	0.069	0.002	0.429	#13	0.073	Not Required	Pass
106	0.001	0.695	0.007	0.070	0.002	0.700	#13	0.044	Not Required	Pass
107	0.001	0.431	0.013	0.070	0.003	0.434	#13	0.073	Not Required	Pass
108	0.000	0.053	0.007	0.039	0.001	0.056	#13	0.088	Not Required	Pass
109	0.001	0.076	0.007	0.001	0.000	0.083	#13	0.198	Not Required	Pass
110	0.001	0.647	0.013	0.065	0.002	0.653	#13	0.078	Not Required	Pass
111	0.000	0.057	0.007	0.041	0.001	0.059	#13	0.088	Not Required	Pass
112	0.000	0.445	0.031	0.093	0.006	0.476	#13	0.034	Not Required	Pass
113	0.000	0.191	0.017	0.053	0.001	0.195	#13	0.265	Not Required	Pass
114	0.000	0.183	0.017	0.050	0.001	0.188	#13	0.265	Not Required	Pass
115	0.001	0.181	0.010	0.041	0.001	0.189	#13	0.675	Not Required	Pass
116	0.000	0.169	0.010	0.038	0.001	0.178	#13	0.675	Not Required	Pass
201	0.094	0.378	0.000	0.007	0.000	0.380	#16	0.598	Not Required	Pass
202	0.000	0.447	0.031	0.093	0.006	0.478	#13	0.034	Not Required	Pass
203	0.001	0.699	0.006	0.071	0.001	0.704	#13	0.044	Not Required	Pass
204	0.001	0.652	0.012	0.066	0.002	0.660	#13	0.078	Not Required	Pass
205	0.001	0.434	0.013	0.070	0.002	0.436	#13	0.073	Not Required	Pass

206	0.001	0.699	0.006	0.071	0.001	0.704	#13	0.044	Not Required	Pass
207	0.001	0.433	0.013	0.070	0.002	0.436	#13	0.073	Not Required	Pass
208	0.000	0.051	0.006	0.039	0.001	0.052	#13	0.088	Not Required	Pass
209	0.001	0.075	0.007	0.001	0.000	0.083	#13	0.198	Not Required	Pass
210	0.001	0.652	0.012	0.066	0.002	0.659	#13	0.078	Not Required	Pass
211	0.000	0.054	0.006	0.042	0.001	0.056	#13	0.088	Not Required	Pass
212	0.000	0.447	0.031	0.093	0.006	0.478	#13	0.034	Not Required	Pass
213	0.000	0.199	0.017	0.054	0.001	0.204	#13	0.265	Not Required	Pass
214	0.000	0.192	0.017	0.050	0.001	0.196	#13	0.265	Not Required	Pass
215	0.001	0.188	0.010	0.042	0.001	0.196	#13	0.675	Not Required	Pass
216	0.000	0.176	0.010	0.039	0.001	0.184	#13	0.675	Not Required	Pass
301	0.093	0.374	0.002	0.006	0.000	0.376	#16	0.598	Not Required	Pass
302	0.000	0.445	0.031	0.093	0.006	0.476	#13	0.034	Not Required	Pass
303	0.001	0.695	0.007	0.070	0.002	0.701	#13	0.044	Not Required	Pass
304	0.001	0.647	0.013	0.065	0.002	0.653	#13	0.078	Not Required	Pass
305	0.001	0.432	0.013	0.070	0.003	0.435	#13	0.073	Not Required	Pass
306	0.001	0.687	0.005	0.070	0.001	0.692	#13	0.044	Not Required	Pass
307	0.001	0.426	0.012	0.069	0.002	0.429	#13	0.073	Not Required	Pass
308	0.000	0.052	0.007	0.038	0.001	0.053	#13	0.088	Not Required	Pass
309	0.001	0.076	0.007	0.001	0.000	0.083	#13	0.198	Not Required	Pass
310	0.001	0.642	0.013	0.065	0.002	0.652	#13	0.078	Not Required	Pass
311	0.000	0.056	0.008	0.041	0.001	0.057	#13	0.088	Not Required	Pass
312	0.000	0.439	0.031	0.092	0.006	0.470	#13	0.111	Not Required	Pass
313	0.000	0.190	0.017	0.053	0.001	0.195	#13	0.265	Not Required	Pass
314	0.000	0.183	0.017	0.050	0.001	0.188	#13	0.265	Not Required	Pass
315	0.001	0.186	0.009	0.041	0.001	0.194	#13	0.675	Not Required	Pass
316	0.000	0.174	0.010	0.039	0.001	0.183	#13	0.675	Not Required	Pass
401	0.088	0.360	0.006	0.006	0.000	0.362	#16	0.598	Not Required	Pass
402	0.000	0.414	0.030	0.086	0.005	0.444	#13	0.034	Not Required	Pass
403	0.001	0.646	0.006	0.065	0.001	0.649	#13	0.044	Not Required	Pass
404	0.001	0.600	0.017	0.061	0.003	0.610	#13	0.078	Not Required	Pass
405	0.001	0.401	0.018	0.065	0.004	0.402	#13	0.073	Not Required	Pass
406	0.001	0.658	0.007	0.067	0.001	0.665	#13	0.044	Not Required	Pass
407	0.001	0.407	0.013	0.066	0.003	0.411	#13	0.073	Not Required	Pass
408	0.000	0.092	0.010	0.030	0.001	0.100	#13	Not Required	Not Required	Pass
409	0.001	0.079	0.009	0.001	0.000	0.088	#13	0.198	Not Required	Pass
410	0.001	0.614	0.012	0.062	0.002	0.618	#13	0.078	Not Required	Pass
411	0.000	0.099	0.010	0.032	0.001	0.107	#13	Not Required	Not Required	Pass
412	0.000	0.429	0.030	0.088	0.005	0.459	#13	0.052	Not Required	Pass
413	0.000	0.231	0.023	0.054	0.001	0.239	#13	0.177	Not Required	Pass
414	0.000	0.220	0.022	0.051	0.001	0.228	#13	0.265	Not Required	Pass
415	0.001	0.179	0.012	0.042	0.001	0.188	#13	0.675	Not Required	Pass
416	0.000	0.168	0.012	0.039	0.001	0.177	#13	0.675	Not Required	Pass

Definitions

Φ_t	Safety factor for tensile
Φ_c	Safety factor for compression
Φ_b	Safety factor for flexure
Φ_v	Safety factor for shear
E	Modulus of elasticity
F_y	Specified minimum yield stress
F_u	Specified minimum tensile strength

A	Cross-sectional area
J	Torsional constant
I_{yp}	Moment of inertia about the Y axes
I_{zp}	Moment of inertia about the Z axes
I_w	Warping constant
S_{yp}	Plastic section modulus about the Y axis
S_{zp}	Plastic section modulus about the Z axis
KL	Effective length
C_b	Buckling modification factor (from all load combinations)
L_b	Length between braced points
LST	Limited slenderness for tension
LSC	Limited slenderness for compression
LD	Limited deflection
P_n	Nominal axial strength (tension/compression)
M_n	Nominal flexural strength (about Z/Y axis)
V_n	Nominal shear strength (along Z/Y axis)
P	Design ratio in case of axial force
M_z	Design ratio in case of bending about Z axis
M_y	Design ratio in case of bending about Y axis
V_y	Design ratio in case of shear along Y axis
V_z	Design ratio in case of shear along Z axis
(P, M_z, M_y)	Design ratio in case of axial force and bending action
KL/r	Design ratio in case of section slenderness
δ	Design ratio in case of member deflection
OK	Capacity is provided
NG	Capacity is not provided

REFERENCES	CALCULATIONS	RESULTS
------------	--------------	---------


SkyCiv Foundation Design

Pile Foundation

Design Information :

Design code : IBC 2021 (International Building Code)
Unit System : Imperial

Pile Input

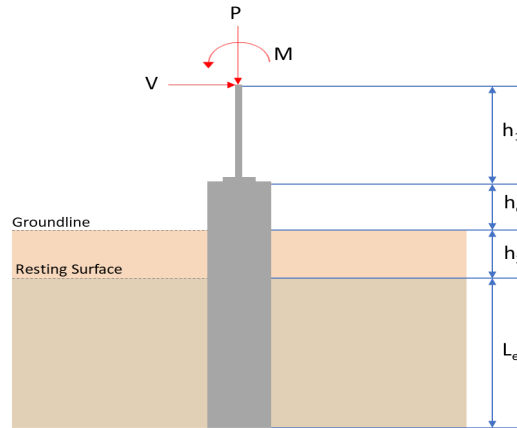

Geometry

Pile shape: rectangular

$b = 48$ in - Pile width

$D = 48$ in - Pile depth

$L = 4.75$ ft - Total pile length

$h_1 = 0$ ft - Lateral load height from the top of the pile,

$h_2 = 0$ ft - Depth to resisting surface

$h_e = 0$ ft - Length of pile above the ground

Tabulation of Soil Parameters

Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000

Tabulation of Loads

Load Component	ASD	LRFD
P (kip)	5.194	7.717
V_x (kip)	-0.282	-0.469
V_z (kip)	-0.021	-0.032
M_x (kipft)	-0.069	-0.104
M_z (kipft)	8.930	15.219

Material Properties

$f'_{ck} = 2.5$ ksi - Concrete strength.

Required depth to resist lateral loads (ASD)

H - Point of application of the lateral load

$$H = h_1 + h_2 + h_e$$

$$H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$$

$$H = 0 \text{ ft}$$

Considering x-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.282 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.044904 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(8.93 \text{ kipft}) + ((-0.282 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 1.422 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,x} = 4.6601 \text{ ft}$ - Required depth in x-direction,

Considering z-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.021 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.0033439 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.069 \text{ kipft}) + ((-0.021 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.010987 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,z} = 0.8884 \text{ ft}$ - Required depth in z-direction,

Minimum embedded depth required:

$L_{e,req}$ - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$$

$$L_{e,req} = \text{MAX}[(4.6601 \text{ ft}), (0.8884 \text{ ft})]$$

$$L_{e,req} = 4.66 \text{ ft}$$

L_e - Actual embedded length of pile,

$$L_e = L - h_e - h_2$$

$$L_e = (4.75 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 4.75 \text{ ft}$$

Ratio - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(4.66 \text{ ft})}{(4.75 \text{ ft})}$$

$$\text{Ratio} = 0.98105$$

Status: **PASS**
Ratio: **0.980**

End-bearing Capacity (ASD)

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_v}{A}$$

$$q = \frac{(5.194 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.32463 \text{ kip/ft}^2$$

Check bearing capacity ratio:

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.32463 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.16231$$

Status: **PASS**
Ratio: **0.160**

Czerniak

Lateral Soil Pressure (ASD):

L/D - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(4.75 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.1875$$

Since $L/D \leq 10$,

Pile is short.

Considering x-direction:

$H_o = -0.044904 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 1.422 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (1.422 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (1.422 \text{ kipft/ft})) + (4 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = 3.2027 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (1.422 \text{ kipft/ft})) + (3 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))]^2}{(4.75 \text{ ft})^2 \times [(3 \times (1.422 \text{ kipft/ft})) + (2 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))]}$$

$$p = 0.22063 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (1.422 \text{ kipft/ft})) + ((-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))]}{(4.75 \text{ ft})^2}$$

$$s = 0.69956 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.2027 \text{ ft})}{2}$$

$$p_a = 0.2402 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.22063 \text{ kip/ft}^2)}{(0.2402 \text{ kip/ft}^2)}$$

$$Ratio = 0.91852$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (4.75 \text{ ft})$$

$$p_s = 0.7125 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.69956 \text{ kip/ft}^2)}{(0.7125 \text{ kip/ft}^2)}$$

$$Ratio = 0.98184$$

Status: **PASS**
Ratio: **0.920**

Status: **PASS**
Ratio: **0.980**

Considering z-direction:

$H_o = -0.0033439 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 0.010987 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.010987 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (-0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (0.010987 \text{ kipft/ft})) + (4 \times (-0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = 3.3609 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (0.010987 \text{ kipft/ft})) + (3 \times (-0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))]^2}{(4.75 \text{ ft})^2 \times [(3 \times (0.010987 \text{ kipft/ft})) + (2 \times (-0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))]}$$

$$p = 0.0003815 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (0.010987 \text{ kipft/ft})) + ((-0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))]}{(4.75 \text{ ft})^2}$$

$$s = 0.0016197 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.3609 \text{ ft})}{2}$$

$$p_a = 0.25207 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.0003815 \text{ kip/ft}^2)}{(0.25207 \text{ kip/ft}^2)}$$

$$Ratio = 0.0015135$$

p_s - Allowable lateral soil pressure at depth L_e .

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (4.75 \text{ ft})$$

$$p_s = 0.7125 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity


$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.0016197 \text{ kip/ft}^2)}{(0.7125 \text{ kip/ft}^2)}$$

$$Ratio = 0.0022733$$

Status: **PASS**
Ratio: **0.000**

Status: **PASS**
Ratio: **0.000**

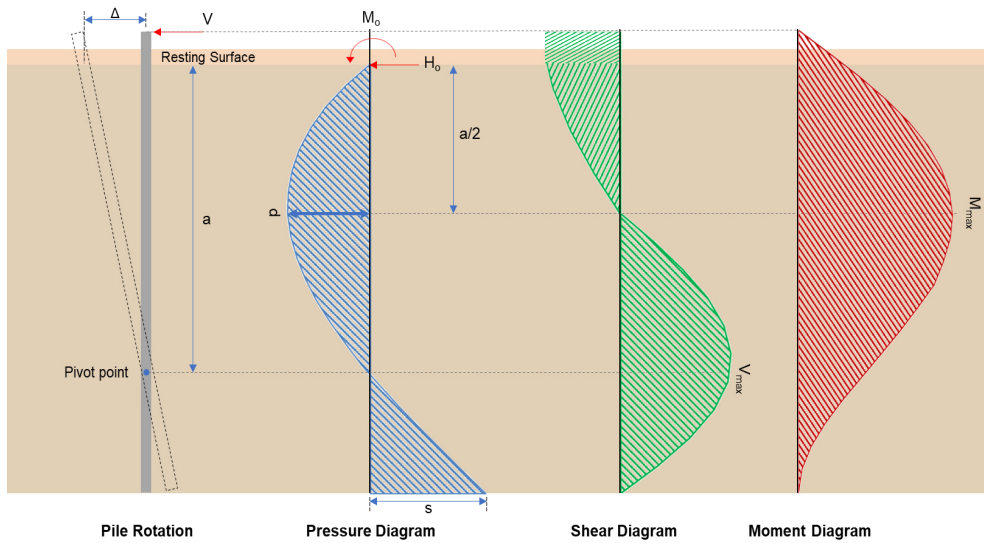

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.469 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.074682 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(15.219 \text{ kipft}) + ((-0.469 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 2.4234 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(2.4234 \text{ kipft/ft})}{(-0.074682 \text{ kip/ft})}$$

$$E = 32.45 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (2.4234 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (-0.074682 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (2.4234 \text{ kipft/ft})) + (4 \times (-0.074682 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = \frac{(6 \times (2.4234 \text{ kipft/ft})) + (4 \times (-0.074682 \text{ kip/ft}) \times (4.75 \text{ ft}))}{}$$

$$a = 3.2019 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.074682 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (32.45 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.2019 \text{ ft})}{(4.75 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (32.45 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.2019 \text{ ft})}{(4.75 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 3.8176 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.074682 \text{ kip/ft}) \times (48 \text{ in}) \times (4.75 \text{ ft})) \times \left[\left(\frac{(32.45 \text{ ft})}{(4.75 \text{ ft})} + \frac{(3.2019 \text{ ft})}{2 \times (4.75 \text{ ft})} \right) - \left[\left(\frac{4 \times (32.45 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.2019 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (32.45 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.2019 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 8.9363 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.032 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.0050955 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.104 \text{ kipft}) + ((-0.032 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.016561 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.016561 \text{ kipft/ft})}{(-0.0050955 \text{ kip/ft})}$$

$$E = 3.25 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.016561 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (-0.0050955 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (0.016561 \text{ kipft/ft})) + (4 \times (-0.0050955 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = 3.362 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.0050955 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.25 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.362 \text{ ft})}{(4.75 \text{ ft})} \right)^2 \right] \right. \\ \left. + \left[4 \times \left(\frac{3 \times (3.25 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.362 \text{ ft})}{(4.75 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.038196 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o \cdot b \cdot L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) \right. \\ \left. - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.0050955 \text{ kip/ft}) \times (48 \text{ in}) \times (4.75 \text{ ft})) \times \left[\left(\frac{(3.25 \text{ ft})}{(4.75 \text{ ft})} + \frac{(3.362 \text{ ft})}{2 \times (4.75 \text{ ft})} \right) \right. \\ \left. - \left[\left(\frac{4 \times (3.25 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.362 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.25 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.362 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 0.082041 \text{ kipft}$$

Minimum Reinforcement Check (LRFD)

Parameters:

$f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength,

$f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength,

$\phi = 0.65$ - Reduction factor for axial strength,

$\alpha = 0.8$ - Alpha factor for axial strength,

$A_g = 2304 \text{ in}^2$ - Gross area of concrete,

Longitudinal reinforcement:

Required reinforcement due to axial load, $A_{st,required}$

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[\frac{\frac{(7.717 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.34 \text{ in}^2$$

A_{min} - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.34 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

n_{rebar} - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

A_{st} - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

Table 22.4.2.1

22.4.2.2, 10.6.1.1

<p>25.2.3</p> <p>25.7.2.2</p> <p>25.7.2.1</p>	<p style="text-align: center;">$Ratio = 0.96556$</p> <p>$s_{rebar} = Max[1.5, (1.5 d_{bar})]$</p> <p>$s_{rebar} = Max[1.5, (1.5 \times (0.625 \text{ in}))]$</p> <p>$s_{rebar} = 1.5 \text{ in}$</p> <p>Ties:</p> <p>Since longitudinal reinforcement is \leq No. 10: Use #3(0.375 in)</p> <p>$s_{ties} = Min[(16 d_{bar}), (48 d_{ties}), Min(D, b)]$</p> <p>$s_{ties} = Min[(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), Min((48 \text{ in}), (48 \text{ in}))]$</p> <p>$s_{ties} = 10 \text{ in}$</p> <p>Summary:</p> <p style="text-align: center;">Main reinforcement: 14 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in</p>	<p>Status: PASS Ratio: 0.970</p>
<p>22.4.2.2</p>	<p>Axial Compression Strength (ACI 318-19, LRFD)</p> <p>ϕP_N - Allowable axial compressive strength</p> <p style="text-align: center;">$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_y A_{st})]$</p> <p style="text-align: center;">$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$</p> <p style="text-align: center;">$\phi P_N = 2675.2 \text{ kip}$</p> <p>Ratio - Capacity</p> <p style="text-align: center;">$Ratio = \frac{P}{\phi P_N}$</p> <p style="text-align: center;">$Ratio = \frac{(7.717 \text{ kip})}{(2675.2 \text{ kip})}$</p> <p style="text-align: center;">$Ratio = 0.0028847$</p>	<p>Status: PASS Ratio: 0.000</p>
<p>22.5.2.2</p> <p>22.5.5.1.3</p> <p>22.5.5.1.1</p>	<p>Shear Strength (ACI 318-19, LRFD)</p> <p>Parameters:</p> <p>$b_w = 48 \text{ in}$ - Effective width, d - Effective depth</p> <p style="text-align: center;">$d = 0.80 D$</p> <p style="text-align: center;">$d = 0.80 \times (48 \text{ in})$</p> <p style="text-align: center;">$d = 38.4 \text{ in}$</p> <p>λ_s - size effect modification factor</p> <p style="text-align: center;">$\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = 0.64282$</p> <p>The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,</p> <p>$V_{c,max}$ - Max shear strength of concrete</p> <p style="text-align: center;">$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$</p> <p style="text-align: center;">$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$</p>	

$$V_{c,max} = 296.21 \text{ kip}$$

22.5.5.1.1(a) The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 7.717 \text{ kip} \rightarrow 7717 \text{ lbf}$,
 $V_{c,a}$ - Shear strength of concrete (a)

$$V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck} + \frac{P}{6 A_g}} \right] b_w d$$

$$V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + \frac{(7717 \text{ lbf})}{6 \times (2304 \text{ in}^2)}} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.51 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{c,b}$ - Shear strength of concrete (b)

$$V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck} + (0.05 f'_{ck})} \right] b_w d$$

$$V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + (0.05 \times (2500 \text{ psi}))} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

V_c - Governing shear strength of concrete

$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.51 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.51 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{s,a}$ - Shear strength of steel (a)

$$V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$$

$$V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{s,a} = 737.28 \text{ kip}$$

A_v - Ties rebar area,

$$A_v = \frac{\pi d_{ties}^2}{4}$$

$$A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$$

$$A_v = 0.11045 \text{ in}^2$$

22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b)

$$V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$$

$$V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$$

$$V_{s,b} = 50.894 \text{ kip}$$

V_s - Governing shear strength of steel

$$V_s = \text{MIN}[V_{s,a}, V_{s,b}]$$

$$V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$$

$$V_s = 50.894 \text{ kip}$$

22.5.1.1 ϕV_n - Allowable shear strength

$$\phi V_n = \phi (V_c + V_s)$$

$$\phi V_n = (0.65) \times ((119.51 \text{ kip}) + (50.894 \text{ kip}))$$

$$\phi V_n = 110.77 \text{ kip}$$

Considering x-direction:

$V_{max} = 3.8176 \text{ kip}$ - Maximum shear force in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(3.8176 \text{ kip})}{(110.77 \text{ kip})}$$

$$Ratio = 0.034466$$

Considering z-direction:

$V_{max} = 0.038196 \text{ kip}$ - Maximum shear force in the z-direction,

Ratio - Capacity

$$Ratio = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(0.038196 \text{ kip})}{(110.77 \text{ kip})}$$

$$Ratio = 0.00034484$$

Status: **PASS**
Ratio: **0.030**

Status: **PASS**
Ratio: **0.000**

Flexural Strength (ACI 318-19, LRFD)

S_m - Section modulus

$$S_m = \frac{b D^2}{6}$$

$$S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$$

$$S_m = 18432 \text{ in}^3$$

$\lambda = 1$ - Concrete modification factor (Normal concrete),

Allowable flexural strength:

M_n shall be the lesser of:

$\phi M_{n,1}$

$$\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$$

$$\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 18432.001 \text{ in}^3$$

$$\phi M_{n,1} = 249.600 \text{ kipft}$$

14.5.2.1b

$\phi M_{n,2}$

$$\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$$

$$\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$$

$$\phi M_{n,2} = 2121.6 \text{ kipft}$$

Therefore,

ϕM_n - Allowable flexural strength,

$$\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$$

$$\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$$

$$\phi M_n = 249.6 \text{ kipft}$$

Considering x-direction:

$M_{max} = 8.9363 \text{ kipft}$ - Maximum moment in the x-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$Ratio = \frac{(8.9363 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$Ratio = 0.035802$$

Status: **PASS**
Ratio: **0.040**

Considering z-direction:

$M_{max} = 0.082041 \text{ kipft}$ - Maximum moment in the z-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$\text{Ratio} = \frac{(0.082041 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$\text{Ratio} = 0.00032869$$

Status: **PASS**
Ratio: **0.000**

REFERENCES	CALCULATIONS	RESULTS
------------	--------------	---------


SkyCiv Foundation Design

Pile Foundation

Design Information :

Design code : IBC 2021 (International Building Code)
Unit System : Imperial

Pile Input

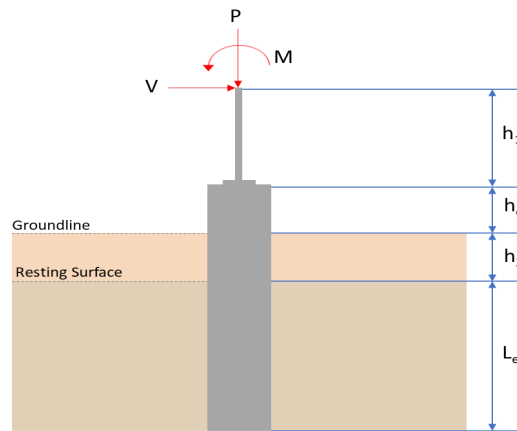

Geometry

Pile shape: rectangular

$b = 48$ in - Pile width

$D = 48$ in - Pile depth

$L = 4.75$ ft - Total pile length

$h_1 = 0$ ft - Lateral load height from the top of the pile,

$h_2 = 0$ ft - Depth to resisting surface

$h_e = 0$ ft - Length of pile above the ground

Tabulation of Soil Parameters

Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000

Tabulation of Loads

Load Component	ASD	LRFD
P (kip)	5.194	7.717
V_x (kip)	-0.282	-0.469
V_z (kip)	0.021	0.032
M_x (kipft)	0.068	0.102
M_z (kipft)	8.930	15.220

Material Properties

$f'_{ck} = 2.5$ ksi - Concrete strength.

Required depth to resist lateral loads (ASD)

H - Point of application of the lateral load

$$H = h_1 + h_2 + h_e$$

$$H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$$

$$H = 0 \text{ ft}$$

Considering x-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.282 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.044904 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(8.93 \text{ kipft}) + ((-0.282 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 1.422 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_x^3 - \left(14.14 \times \frac{H_o \times L_x}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,x} = 4.6601 \text{ ft}$ - Required depth in x-direction,

Considering z-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.021 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.0033439 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.068 \text{ kipft}) + ((0.021 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.010828 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_z^3 - \left(14.14 \times \frac{H_o \times L_z}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,z} = 1.0233 \text{ ft}$ - Required depth in z-direction,

Minimum embedded depth required:

$L_{e,req}$ - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$$

$$L_{e,req} = \text{MAX}[(4.6601 \text{ ft}), (1.0233 \text{ ft})]$$

$$L_{e,req} = 4.66 \text{ ft}$$

L_e - Actual embedded length of pile,

$$L_e = L - h_e - h_2$$

$$L_e = (4.75 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 4.75 \text{ ft}$$

Ratio - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(4.66 \text{ ft})}{(4.75 \text{ ft})}$$

$$\text{Ratio} = 0.98105$$

Status: **PASS**
Ratio: **0.980**

End-bearing Capacity (ASD)

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_v}{A}$$

$$q = \frac{(5.194 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.32463 \text{ kip/ft}^2$$

Check bearing capacity ratio:

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.32463 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.16231$$

Status: **PASS**
Ratio: **0.160**

Czerniak

Lateral Soil Pressure (ASD):

L/D - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(4.75 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.1875$$

Since $L/D \leq 10$,

Pile is short.

Considering x-direction:

$H_o = -0.044904 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 1.422 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (1.422 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (1.422 \text{ kipft/ft})) + (4 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = 3.2027 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (1.422 \text{ kipft/ft})) + (3 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))]^2}{(4.75 \text{ ft})^2 \times [(3 \times (1.422 \text{ kipft/ft})) + (2 \times (-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))]}$$

$$p = 0.22063 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (1.422 \text{ kipft/ft})) + ((-0.044904 \text{ kip/ft}) \times (4.75 \text{ ft}))]}{(4.75 \text{ ft})^2}$$

$$s = 0.69956 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.2027 \text{ ft})}{2}$$

$$p_a = 0.2402 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.22063 \text{ kip/ft}^2)}{(0.2402 \text{ kip/ft}^2)}$$

$$Ratio = 0.91852$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (4.75 \text{ ft})$$

$$p_s = 0.7125 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.69956 \text{ kip/ft}^2)}{(0.7125 \text{ kip/ft}^2)}$$

$$Ratio = 0.98184$$

Status: **PASS**
Ratio: **0.920**

Status: **PASS**
Ratio: **0.980**

Considering z-direction:

$H_o = 0.0033439 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 0.010828 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.010828 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (0.010828 \text{ kipft/ft})) + (4 \times (0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = 3.3624 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (0.010828 \text{ kipft/ft})) + (3 \times (0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))]^2}{(4.75 \text{ ft})^2 \times [(3 \times (0.010828 \text{ kipft/ft})) + (2 \times (0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))]}$$

$$p = 0.0042808 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (0.010828 \text{ kipft/ft})) + ((0.0033439 \text{ kip/ft}) \times (4.75 \text{ ft}))]}{(4.75 \text{ ft})^2}$$

$$s = 0.009983 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.3624 \text{ ft})}{2}$$

$$p_a = 0.25218 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.0042808 \text{ kip/ft}^2)}{(0.25218 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.016975$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (4.75 \text{ ft})$$

$$p_s = 0.7125 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity


$$\text{Ratio} = \frac{s}{p_s}$$

$$\text{Ratio} = \frac{(0.009983 \text{ kip/ft}^2)}{(0.7125 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.014011$$

Status: **PASS**
Ratio: **0.020**

Status: **PASS**
Ratio: **0.010**

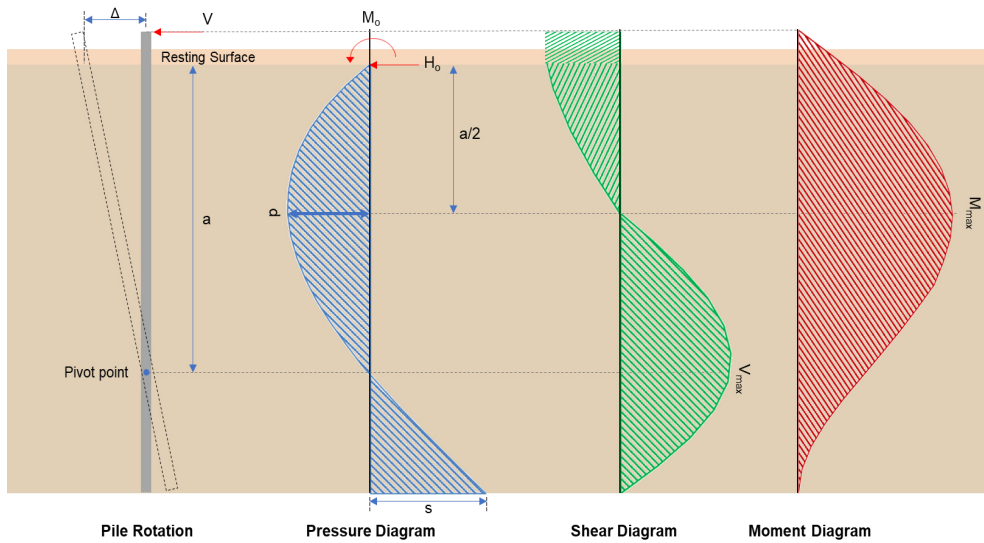

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.469 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.074682 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(15.22 \text{ kipft}) + ((-0.469 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 2.4236 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(2.4236 \text{ kipft/ft})}{(-0.074682 \text{ kip/ft})}$$

$$E = 32.452 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (2.4236 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (-0.074682 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (2.4236 \text{ kipft/ft})) + (4 \times (-0.074682 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = \frac{(6 \times (2.4236 \text{ kipft/ft})) + (4 \times (-0.074682 \text{ kip/ft}) \times (4.75 \text{ ft}))}{}$$

$$a = 3.2019 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.074682 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (32.452 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.2019 \text{ ft})}{(4.75 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (32.452 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.2019 \text{ ft})}{(4.75 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 3.8178 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.074682 \text{ kip/ft}) \times (48 \text{ in}) \times (4.75 \text{ ft})) \times \left[\left(\frac{(32.452 \text{ ft})}{(4.75 \text{ ft})} + \frac{(3.2019 \text{ ft})}{2 \times (4.75 \text{ ft})} \right) - \left[\left(\frac{4 \times (32.452 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.2019 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (32.452 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.2019 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 8.9368 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.032 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.0050955 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.102 \text{ kipft}) + ((0.032 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.016242 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.016242 \text{ kipft/ft})}{(0.0050955 \text{ kip/ft})}$$

$$E = 3.1875 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.016242 \text{ kipft/ft}) \times (4.75 \text{ ft})) + (3 \times (0.0050955 \text{ kip/ft}) \times (4.75 \text{ ft})^2)}{(6 \times (0.016242 \text{ kipft/ft})) + (4 \times (0.0050955 \text{ kip/ft}) \times (4.75 \text{ ft}))}$$

$$a = 3.3639 \text{ ft}$$

V_{max} - Max shear force located at depth a ,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((0.0050955 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.1875 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.3639 \text{ ft})}{(4.75 \text{ ft})} \right)^2 \right] \right. \\ \left. + \left[4 \times \left(\frac{3 \times (3.1875 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.3639 \text{ ft})}{(4.75 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.037725 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o \cdot b \cdot L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) \right. \\ \left. - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((0.0050955 \text{ kip/ft}) \times (48 \text{ in}) \times (4.75 \text{ ft})) \times \left[\left(\frac{(3.1875 \text{ ft})}{(4.75 \text{ ft})} + \frac{(3.3639 \text{ ft})}{2 \times (4.75 \text{ ft})} \right) \right. \\ \left. - \left[\left(\frac{4 \times (3.1875 \text{ ft})}{(4.75 \text{ ft})} + 3 \right) \times \left(\frac{(3.3639 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.1875 \text{ ft})}{(4.75 \text{ ft})} + 2 \right) \times \left(\frac{(3.3639 \text{ ft})}{2 \times (4.75 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 0.080925 \text{ kipft}$$

Minimum Reinforcement Check (LRFD)

Parameters:

$f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength,

$f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength,

$\phi = 0.65$ - Reduction factor for axial strength,

$\alpha = 0.8$ - Alpha factor for axial strength,

$A_g = 2304 \text{ in}^2$ - Gross area of concrete,

Longitudinal reinforcement:

Required reinforcement due to axial load, $A_{st,required}$

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[\frac{\frac{(7.717 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.34 \text{ in}^2$$

A_{min} - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.34 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

n_{rebar} - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

A_{st} - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

Table 22.4.2.1

22.4.2.2, 10.6.1.1

<p>25.2.3</p> <p>25.7.2.2</p> <p>25.7.2.1</p>	<p style="text-align: center;">$Ratio = 0.96556$</p> <p>$s_{rebar} = \text{Max}[1.5, (1.5 d_{bar})]$</p> <p>$s_{rebar} = \text{Max}[1.5, (1.5 \times (0.625 \text{ in}))]$</p> <p>$s_{rebar} = 1.5 \text{ in}$</p> <p>Ties:</p> <p>Since longitudinal reinforcement is \leq No. 10ø: Use #3(0.375 in)</p> <p>$s_{ties} = \text{Min}[(16 d_{bar}), (48 d_{ties}), \text{Min}(D, b)]$</p> <p>$s_{ties} = \text{Min}[(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), \text{Min}((48 \text{ in}), (48 \text{ in}))]$</p> <p>$s_{ties} = 10 \text{ in}$</p> <p>Summary:</p> <p style="text-align: center;">Main reinforcement: 14 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in</p>	<p>Status: PASS Ratio: 0.970</p>
<p>22.4.2.2</p>	<p>Axial Compression Strength (ACI 318-19, LRFD)</p> <p>ϕP_N - Allowable axial compressive strength</p> <p style="text-align: center;">$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_y k A_{st})]$</p> <p style="text-align: center;">$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$</p> <p style="text-align: center;">$\phi P_N = 2675.2 \text{ kip}$</p> <p>Ratio - Capacity</p> <p style="text-align: center;">$Ratio = \frac{P}{\phi P_N}$</p> <p style="text-align: center;">$Ratio = \frac{(7.717 \text{ kip})}{(2675.2 \text{ kip})}$</p> <p style="text-align: center;">$Ratio = 0.0028847$</p>	<p>Status: PASS Ratio: 0.000</p>
<p>22.5.2.2</p> <p>22.5.5.1.3</p> <p>22.5.5.1.1</p>	<p>Shear Strength (ACI 318-19, LRFD)</p> <p>Parameters:</p> <p>$b_w = 48 \text{ in}$ - Effective width, d - Effective depth</p> <p style="text-align: center;">$d = 0.80 D$</p> <p style="text-align: center;">$d = 0.80 \times (48 \text{ in})$</p> <p style="text-align: center;">$d = 38.4 \text{ in}$</p> <p>λ_s - size effect modification factor</p> <p style="text-align: center;">$\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = 0.64282$</p> <p>The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,</p> <p>$V_{c,max}$ - Max shear strength of concrete</p> <p style="text-align: center;">$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$</p> <p style="text-align: center;">$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$</p>	

$$V_{c,max} = 296.21 \text{ kip}$$

22.5.5.1.1(a) The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 7.717 \text{ kip} \rightarrow 7717 \text{ lbf}$,
 $V_{c,a}$ - Shear strength of concrete (a)

$$V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck} + \frac{P}{6 A_g}} \right] b_w d$$

$$V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + \frac{(7717 \text{ lbf})}{6 \times (2304 \text{ in}^2)}} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.51 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{c,b}$ - Shear strength of concrete (b)

$$V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck} + (0.05 f'_{ck})} \right] b_w d$$

$$V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + (0.05 \times (2500 \text{ psi}))} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

V_c - Governing shear strength of concrete

$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.51 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.51 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{s,a}$ - Shear strength of steel (a)

$$V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$$

$$V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{s,a} = 737.28 \text{ kip}$$

A_v - Ties rebar area,

$$A_v = \frac{\pi d_{ties}^2}{4}$$

$$A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$$

$$A_v = 0.11045 \text{ in}^2$$

22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b)

$$V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$$

$$V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$$

$$V_{s,b} = 50.894 \text{ kip}$$

V_s - Governing shear strength of steel

$$V_s = \text{MIN}[V_{s,a}, V_{s,b}]$$

$$V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$$

$$V_s = 50.894 \text{ kip}$$

22.5.1.1 ϕV_n - Allowable shear strength

$$\phi V_n = \phi (V_c + V_s)$$

$$\phi V_n = (0.65) \times ((119.51 \text{ kip}) + (50.894 \text{ kip}))$$

$$\phi V_n = 110.77 \text{ kip}$$

Considering x-direction:

$V_{max} = 3.8178 \text{ kip}$ - Maximum shear force in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(3.8178 \text{ kip})}{(110.77 \text{ kip})}$$

$$Ratio = 0.034468$$

Considering z-direction:

$V_{max} = 0.037725 \text{ kip}$ - Maximum shear force in the z-direction,

Ratio - Capacity

$$Ratio = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(0.037725 \text{ kip})}{(110.77 \text{ kip})}$$

$$Ratio = 0.00034058$$

Status: **PASS**
Ratio: **0.030**

Status: **PASS**
Ratio: **0.000**

Flexural Strength (ACI 318-19, LRFD)

S_m - Section modulus

$$S_m = \frac{b D^2}{6}$$

$$S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$$

$$S_m = 18432 \text{ in}^3$$

$\lambda = 1$ - Concrete modification factor (Normal concrete),

Allowable flexural strength:

M_n shall be the lesser of:

$\phi M_{n,1}$

$$\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$$

$$\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 18432.001 \text{ in}^3$$

$$\phi M_{n,1} = 249.600 \text{ kipft}$$

14.5.2.1b

$\phi M_{n,2}$

$$\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$$

$$\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$$

$$\phi M_{n,2} = 2121.6 \text{ kipft}$$

Therefore,

ϕM_n - Allowable flexural strength,

$$\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$$

$$\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$$

$$\phi M_n = 249.6 \text{ kipft}$$

Considering x-direction:

$M_{max} = 8.9368 \text{ kipft}$ - Maximum moment in the x-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$Ratio = \frac{(8.9368 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$Ratio = 0.035805$$

Status: **PASS**
Ratio: **0.040**

Considering z-direction:

$M_{max} = 0.080925 \text{ kipft}$ - Maximum moment in the z-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$\text{Ratio} = \frac{(0.080925 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$\text{Ratio} = 0.00032422$$

Status: **PASS**
Ratio: **0.000**

REFERENCES	CALCULATIONS	RESULTS
------------	--------------	---------


SkyCiv Foundation Design

Pile Foundation

Design Information :

Design code : IBC 2021 (International Building Code)
Unit System : Imperial

Pile Input

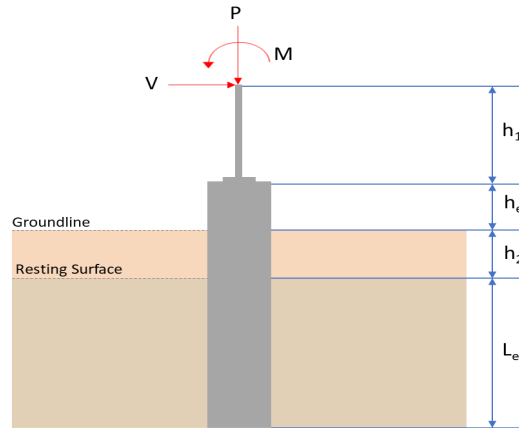

Geometry

Pile shape: rectangular

$b = 48$ in - Pile width

$D = 48$ in - Pile depth

$L = 5$ ft - Total pile length

$h_1 = 0$ ft - Lateral load height from the top of the pile,

$h_2 = 0$ ft - Depth to resisting surface

$h_e = 0$ ft - Length of pile above the ground

Tabulation of Soil Parameters

Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000

Tabulation of Loads

Load Component	ASD	LRFD
P (kip)	5.489	8.162
V_x (kip)	-0.293	-0.489
V_z (kip)	0.009	0.013
M_x (kipft)	0.027	0.041
M_z (kipft)	9.266	15.803

Material Properties

$f'_{ck} = 2.5$ ksi - Concrete strength.

Required depth to resist lateral loads (ASD)

H - Point of application of the lateral load

$$H = h_1 + h_2 + h_e$$

$$H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$$

$$H = 0 \text{ ft}$$

Considering x-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.293 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.046656 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(9.266 \text{ kipft}) + ((-0.293 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 1.4755 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_e^3 - \left(14.14 \times \frac{H_o \times L_x}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,x} = 4.7153 \text{ ft}$ - Required depth in x-direction,

Considering z-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.009 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.0014331 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.027 \text{ kipft}) + ((0.009 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.0042994 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_e^3 - \left(14.14 \times \frac{H_o \times L_z}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,z} = 0.74145 \text{ ft}$ - Required depth in z-direction,

Minimum embedded depth required:

$L_{e,req}$ - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$$

$$L_{e,req} = \text{MAX}[(4.7153 \text{ ft}), (0.74145 \text{ ft})]$$

$$L_{e,req} = 4.715 \text{ ft}$$

L_e - Actual embedded length of pile,

$$L_e = L - h_e - h_2$$

$$L_e = (5 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 5 \text{ ft}$$

Ratio - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(4.715 \text{ ft})}{(5 \text{ ft})}$$

$$\text{Ratio} = 0.943$$

Status: **PASS**
Ratio: **0.940**

End-bearing Capacity (ASD)

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_v}{A}$$

$$q = \frac{(5.489 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.34306 \text{ kip/ft}^2$$

Check bearing capacity ratio:

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.34306 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.17153$$

Status: **PASS**
Ratio: **0.170**

Czerniak

Lateral Soil Pressure (ASD):

L/D - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(5 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.25$$

Since $L/D \leq 10$,

Pile is short.

Considering x-direction:

$H_o = -0.046656 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 1.4755 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (1.4755 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (1.4755 \text{ kipft/ft})) + (4 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3731 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (1.4755 \text{ kipft/ft})) + (3 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))]^2}{(5 \text{ ft})^2 \times [(3 \times (1.4755 \text{ kipft/ft})) + (2 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))]}$$

$$p = 0.20502 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (1.4755 \text{ kipft/ft})) + ((-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))]}{(5 \text{ ft})^2}$$

$$s = 0.65224 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.3731 \text{ ft})}{2}$$

$$p_a = 0.25298 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.20502 \text{ kip/ft}^2)}{(0.25298 \text{ kip/ft}^2)}$$

$$Ratio = 0.81041$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (5 \text{ ft})$$

$$p_s = 0.75 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.65224 \text{ kip/ft}^2)}{(0.75 \text{ kip/ft}^2)}$$

$$Ratio = 0.86966$$

Status: **PASS**
Ratio: **0.810**

Status: **PASS**
Ratio: **0.870**

Considering z-direction:

$H_o = 0.0014331 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 0.0042994 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.0042994 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (0.0014331 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (0.0042994 \text{ kipft/ft})) + (4 \times (0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.5526 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (0.0042994 \text{ kipft/ft})) + (3 \times (0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))]^2}{(5 \text{ ft})^2 \times [(3 \times (0.0042994 \text{ kipft/ft})) + (2 \times (0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))]}$$

$$p = 0.0016496 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (0.0042994 \text{ kipft/ft})) + ((0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))]}{(5 \text{ ft})^2}$$

$$s = 0.0037834 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.5526 \text{ ft})}{2}$$

$$p_a = 0.26645 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.0016496 \text{ kip/ft}^2)}{(0.26645 \text{ kip/ft}^2)}$$

$$Ratio = 0.0061911$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (5 \text{ ft})$$

$$p_s = 0.75 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity


$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.0037834 \text{ kip/ft}^2)}{(0.75 \text{ kip/ft}^2)}$$

$$Ratio = 0.0050446$$

Status: **PASS**
Ratio: **0.010**

Status: **PASS**
Ratio: **0.010**

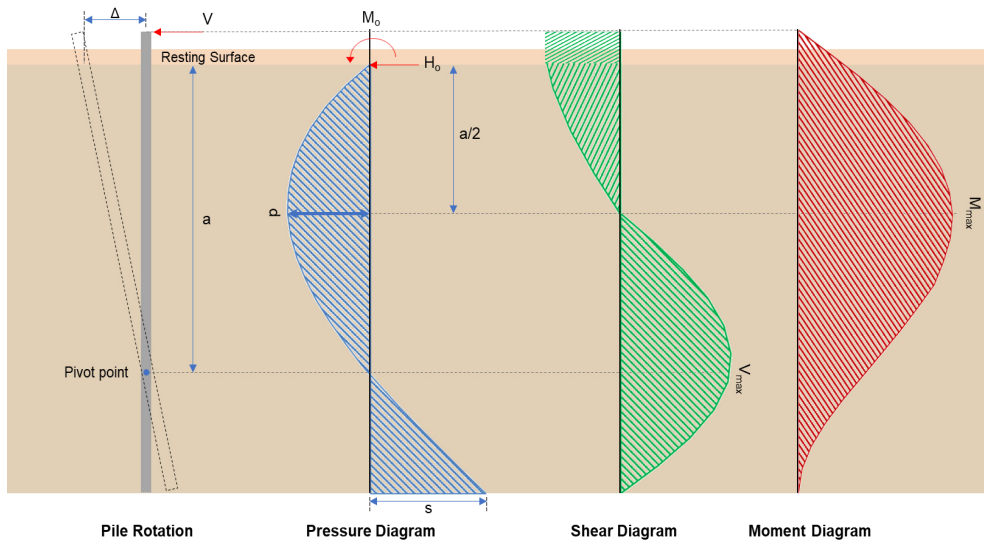

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.489 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.077866 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(15.803 \text{ kipft}) + ((-0.489 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 2.5164 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(2.5164 \text{ kipft/ft})}{(-0.077866 \text{ kip/ft})}$$

$$E = 32.317 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (2.5164 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft})^2)}{6 \times (2.5164 \text{ kipft/ft}) + 4 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft})}$$

$$a = \frac{(6 \times (2.5164 \text{ kipft/ft})) + (4 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft}))}{(6 \times (2.5164 \text{ kipft/ft})) + (4 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3723 \text{ ft}$$

V_{max} - Max shear force located at depth a,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.077866 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (32.317 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.3723 \text{ ft})}{(5 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (32.317 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.3723 \text{ ft})}{(5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 3.7766 \text{ kip}$$

M_{max} - Max bending moment located at depth a/2,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.077866 \text{ kip/ft}) \times (48 \text{ in}) \times (5 \text{ ft})) \times \left[\left(\frac{(32.317 \text{ ft})}{(5 \text{ ft})} + \frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right) - \left[\left(\frac{4 \times (32.317 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (32.317 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 9.2983 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0.013 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0.0020701 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.041 \text{ kipft}) + ((0.013 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.0065287 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.0065287 \text{ kipft/ft})}{(0.0020701 \text{ kip/ft})}$$

$$E = 3.1538 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.0065287 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (0.0020701 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (0.0065287 \text{ kipft/ft})) + (4 \times (0.0020701 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.5474 \text{ ft}$$

V_{max} - Max shear force located at depth a,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((0.0020701 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.1538 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.5474 \text{ ft})}{(5 \text{ ft})} \right)^2 \right] \right. \\ \left. + \left[4 \times \left(\frac{3 \times (3.1538 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.5474 \text{ ft})}{(5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.01474 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o \ b \ L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) \right. \\ \left. - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((0.0020701 \text{ kip/ft}) \times (48 \text{ in}) \times (5 \text{ ft})) \times \left[\left(\frac{(3.1538 \text{ ft})}{(5 \text{ ft})} + \frac{(3.5474 \text{ ft})}{2 \times (5 \text{ ft})} \right) \right. \\ \left. - \left[\left(\frac{4 \times (3.1538 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.5474 \text{ ft})}{2 \times (5 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.1538 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.5474 \text{ ft})}{2 \times (5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 0.033146 \text{ kipft}$$

Minimum Reinforcement Check (LRFD)

Parameters:

$f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength,

$f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength,

$\phi = 0.65$ - Reduction factor for axial strength,

$\alpha = 0.8$ - Alpha factor for axial strength,

$A_g = 2304 \text{ in}^2$ - Gross area of concrete,

Longitudinal reinforcement:

Required reinforcement due to axial load, $A_{st,required}$

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[\frac{\frac{(8.162 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.325 \text{ in}^2$$

A_{min} - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.325 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

n_{rebar} - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

A_{st} - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

Table 22.4.2.1

22.4.2.2, 10.6.1.1

<p>25.2.3</p> <p>25.7.2.2</p> <p>25.7.2.1</p>	<p style="text-align: center;">$Ratio = 0.96556$</p> <p>$s_{rebar} = Max[1.5, (1.5 d_{bar})]$</p> <p>$s_{rebar} = Max[1.5, (1.5 \times (0.625 \text{ in}))]$</p> <p>$s_{rebar} = 1.5 \text{ in}$</p> <p>Ties:</p> <p>Since longitudinal reinforcement is \leq No. 10: Use #3(0.375 in)</p> <p>$s_{ties} = Min[(16 d_{bar}), (48 d_{ties}), Min(D, b)]$</p> <p>$s_{ties} = Min[(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), Min((48 \text{ in}), (48 \text{ in}))]$</p> <p>$s_{ties} = 10 \text{ in}$</p> <p>Summary:</p> <p style="text-align: center;">Main reinforcement: 14 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in</p>	<p>Status: PASS Ratio: 0.970</p>
<p>22.4.2.2</p>	<p>Axial Compression Strength (ACI 318-19, LRFD)</p> <p>ϕP_N - Allowable axial compressive strength</p> <p style="text-align: center;">$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_y A_{st})]$</p> <p style="text-align: center;">$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$</p> <p style="text-align: center;">$\phi P_N = 2675.2 \text{ kip}$</p> <p>Ratio - Capacity</p> <p style="text-align: center;">$Ratio = \frac{P}{\phi P_N}$</p> <p style="text-align: center;">$Ratio = \frac{(8.162 \text{ kip})}{(2675.2 \text{ kip})}$</p> <p style="text-align: center;">$Ratio = 0.003051$</p>	<p>Status: PASS Ratio: 0.000</p>
<p>22.5.2.2</p> <p>22.5.5.1.3</p> <p>22.5.5.1.1</p>	<p>Shear Strength (ACI 318-19, LRFD)</p> <p>Parameters:</p> <p>$b_w = 48 \text{ in}$ - Effective width, d - Effective depth</p> <p style="text-align: center;">$d = 0.80 D$</p> <p style="text-align: center;">$d = 0.80 \times (48 \text{ in})$</p> <p style="text-align: center;">$d = 38.4 \text{ in}$</p> <p>λ_s - size effect modification factor</p> <p style="text-align: center;">$\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = 0.64282$</p> <p>The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,</p> <p>$V_{c,max}$ - Max shear strength of concrete</p> <p style="text-align: center;">$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$</p> <p style="text-align: center;">$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$</p>	

$$V_{c,max} = 296.21 \text{ kip}$$

22.5.5.1.1(a) The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 8.162 \text{ kip} \rightarrow 8162 \text{ lbf}$,
 $V_{c,a}$ - Shear strength of concrete (a)

$$V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck} + \frac{P}{6 A_g}} \right] b_w d$$

$$V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + \frac{(8162 \text{ lbf})}{6 \times (2304 \text{ in}^2)}} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.57 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{c,b}$ - Shear strength of concrete (b)

$$V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck} + (0.05 f'_{ck})} \right] b_w d$$

$$V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + (0.05 \times (2500 \text{ psi}))} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

V_c - Governing shear strength of concrete

$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.57 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.57 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{s,a}$ - Shear strength of steel (a)

$$V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$$

$$V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{s,a} = 737.28 \text{ kip}$$

A_v - Ties rebar area,

$$A_v = \frac{\pi d_{ties}^2}{4}$$

$$A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$$

$$A_v = 0.11045 \text{ in}^2$$

22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b)

$$V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$$

$$V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$$

$$V_{s,b} = 50.894 \text{ kip}$$

V_s - Governing shear strength of steel

$$V_s = \text{MIN}[V_{s,a}, V_{s,b}]$$

$$V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$$

$$V_s = 50.894 \text{ kip}$$

22.5.1.1 ϕV_n - Allowable shear strength

$$\phi V_n = \phi (V_c + V_s)$$

$$\phi V_n = (0.65) \times ((119.57 \text{ kip}) + (50.894 \text{ kip}))$$

$$\phi V_n = 110.8 \text{ kip}$$

Considering x-direction:

$V_{max} = 3.7766 \text{ kip}$ - Maximum shear force in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(3.7766 \text{ kip})}{(110.8 \text{ kip})}$$

$$Ratio = 0.034084$$

Status: **PASS**
Ratio: **0.030**

Considering z-direction:

$V_{max} = 0.01474 \text{ kip}$ - Maximum shear force in the z-direction,
Ratio - Capacity

$$Ratio = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(0.01474 \text{ kip})}{(110.8 \text{ kip})}$$

$$Ratio = 0.00013303$$

Status: **PASS**
Ratio: **0.000**

Flexural Strength (ACI 318-19, LRFD)

S_m - Section modulus

$$S_m = \frac{b D^2}{6}$$

$$S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$$

$$S_m = 18432 \text{ in}^3$$

$\lambda = 1$ - Concrete modification factor (Normal concrete),

Allowable flexural strength:

M_n shall be the lesser of:

$\phi M_{n,1}$

$$\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$$

$$\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 18432.001 \text{ in}^3$$

$$\phi M_{n,1} = 249.600 \text{ kipft}$$

14.5.2.1b

$\phi M_{n,2}$

$$\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$$

$$\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$$

$$\phi M_{n,2} = 2121.6 \text{ kipft}$$

Therefore,

ϕM_n - Allowable flexural strength,

$$\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$$

$$\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$$

$$\phi M_n = 249.6 \text{ kipft}$$

Considering x-direction:

$M_{max} = 9.2983 \text{ kipft}$ - Maximum moment in the x-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$Ratio = \frac{(9.2983 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$Ratio = 0.037253$$

Status: **PASS**
Ratio: **0.040**

Considering z-direction:

$M_{max} = 0.033146 \text{ kipft}$ - Maximum moment in the z-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$Ratio = \frac{(0.033146 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$Ratio = 0.00013279$$

Status: **PASS**
Ratio: **0.000**

REFERENCES	CALCULATIONS	RESULTS
------------	--------------	---------


SkyCiv Foundation Design

Pile Foundation

Design Information :

Design code : IBC 2021 (International Building Code)
Unit System : Imperial

Pile Input

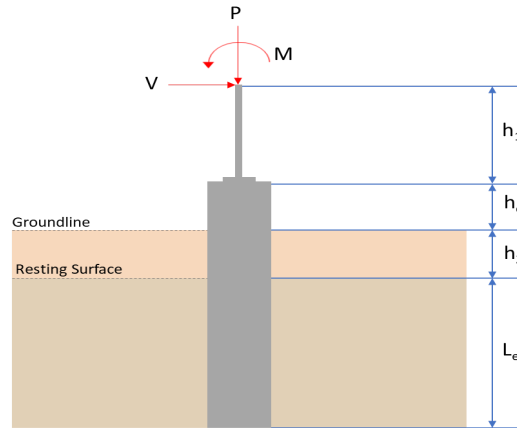

Geometry

Pile shape: rectangular

$b = 48$ in - Pile width

$D = 48$ in - Pile depth

$L = 5$ ft - Total pile length

$h_1 = 0$ ft - Lateral load height from the top of the pile,

$h_2 = 0$ ft - Depth to resisting surface

$h_e = 0$ ft - Length of pile above the ground

Tabulation of Soil Parameters

Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000

Tabulation of Loads

Load Component	ASD	LRFD
P (kip)	5.549	8.251
V_x (kip)	-0.297	-0.495
V_z (kip)	0.000	0.000
M_x (kipft)	-0.001	-0.001
M_z (kipft)	9.381	16.002

Material Properties

$f'_{ck} = 2.5$ ksi - Concrete strength.

Required depth to resist lateral loads (ASD)

H - Point of application of the lateral load

$$H = h_1 + h_2 + h_e$$

$$H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$$

$$H = 0 \text{ ft}$$

Considering x-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.297 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.047293 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(9.381 \text{ kipft}) + ((-0.297 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 1.4938 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_e^3 - \left(14.14 \times \frac{H_o \times L_x}{R}\right) - \left(18.85 \times \frac{M_o}{R}\right) = 0$$

Solving the cubic equation:

$L_{e,x} = 4.7337 \text{ ft}$ - Required depth in x-direction,

Considering z-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.001 \text{ kipft}) + ((0 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.00015924 \text{ kipft/ft}$$

L_e - Required depth of embedment in earth,

$$L_e = 2.29 \sqrt[3]{\frac{M_o}{R}}$$

$$L_e = 2.29 \times \sqrt[3]{\frac{(0.00015924 \text{ kipft/ft})}{(150 \text{ psf/ft})}}$$

$$L_e = 0.23361 \text{ ft}$$

Minimum embedded depth required:

$L_{e,req}$ - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_e]$$

$$L_{e,req} = \text{MAX}[(4.7337 \text{ ft}), (0.23361 \text{ ft})]$$

$$L_{e,req} = 4.734 \text{ ft}$$

L_e - Actual embedded length of pile,

$$L_e = L - h_e - h_2$$

$$L_e = (5 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 5 \text{ ft}$$

Ratio - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(4.734 \text{ ft})}{(5 \text{ ft})}$$

$$\text{Ratio} = 0.9468$$

Status: **PASS**
Ratio: **0.950**

End-bearing Capacity (ASD)

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_v}{A}$$

$$q = \frac{(5.549 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.34681 \text{ kip/ft}^2$$

Check bearing capacity ratio:

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.34681 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.17341$$

Status: **PASS**
Ratio: **0.170**

Czerniak

Lateral Soil Pressure (ASD):

L/D - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(5 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.25$$

Since $L/D \leq 10$,

Pile is short.

Considering x-direction:

$H_o = -0.047293 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 1.4938 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (1.4938 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.047293 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (1.4938 \text{ kipft/ft})) + (4 \times (-0.047293 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3731 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (1.4938 \text{ kipft/ft})) + (3 \times (-0.047293 \text{ kip/ft}) \times (5 \text{ ft}))]^2}{(5 \text{ ft})^2 \times [(3 \times (1.4938 \text{ kipft/ft})) + (2 \times (-0.047293 \text{ kip/ft}) \times (5 \text{ ft}))]}$$

$$p = 0.20752 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (1.4938 \text{ kipft/ft})) + ((-0.047293 \text{ kip/ft}) \times (5 \text{ ft}))]}{(5 \text{ ft})^2}$$

$$s = 0.66027 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.3731 \text{ ft})}{2}$$

$$p_a = 0.25298 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{p}{p_a}$$

$$\text{Ratio} = \frac{(0.20752 \text{ kip/ft}^2)}{(0.25298 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.82031$$

Status: **PASS**
Ratio: **0.820**

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (5 \text{ ft})$$

$$p_s = 0.75 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{s}{p_s}$$

$$\text{Ratio} = \frac{(0.66027 \text{ kip/ft}^2)}{(0.75 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.88036$$

Status: **PASS**
Ratio: **0.880**

Considering z-direction:

$H_o = 0 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 0.00015924 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.00015924 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (0 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (0.00015924 \text{ kipft/ft})) + (4 \times (0 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3333 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (0.00015924 \text{ kipft/ft})) + (3 \times (0 \text{ kip/ft}) \times (5 \text{ ft}))]^2}{(5 \text{ ft})^2 \times [(3 \times (0.00015924 \text{ kipft/ft})) + (2 \times (0 \text{ kip/ft}) \times (5 \text{ ft}))]}$$

$$p = 0.000025478 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (0.00015924 \text{ kipft/ft})) + ((0 \text{ kip/ft}) \times (5 \text{ ft}))]}{(5 \text{ ft})^2}$$

$$s = 0.000076433 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.3333 \text{ ft})}{2}$$

$$p_a = 0.25 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$\text{Ratio} = \frac{p}{p_a}$$

$$\text{Ratio} = \frac{(0.000025478 \text{ kip/ft}^2)}{(0.25 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.00010191$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (5 \text{ ft})$$

$$p_s = 0.75 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity


$$\text{Ratio} = \frac{s}{p_s}$$

$$\text{Ratio} = \frac{(0.000076433 \text{ kip/ft}^2)}{(0.75 \text{ kip/ft}^2)}$$

$$\text{Ratio} = 0.00010191$$

Status: **PASS**
Ratio: **0.000**

Status: **PASS**
Ratio: **0.000**

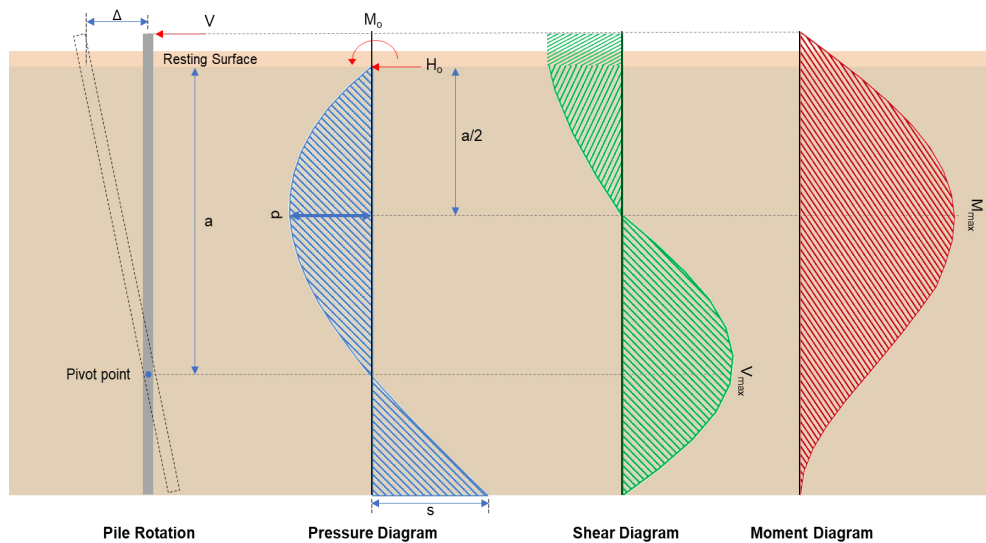

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.495 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.078822 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(16.002 \text{ kipft}) + ((-0.495 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 2.5481 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(2.5481 \text{ kipft/ft})}{(-0.078822 \text{ kip/ft})}$$

$$E = 32.327 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{}$$

$$= (6 M_o) + (4 H_o L_e)$$

$$a = \frac{(4 \times (2.5481 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.078822 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (2.5481 \text{ kipft/ft})) + (4 \times (-0.078822 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3723 \text{ ft}$$

V_{max} - Max shear force located at depth a,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.078822 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (32.327 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.3723 \text{ ft})}{(5 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (32.327 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.3723 \text{ ft})}{(5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 3.8241 \text{ kip}$$

M_{max} - Max bending moment located at depth a/2,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.078822 \text{ kip/ft}) \times (48 \text{ in}) \times (5 \text{ ft})) \times \left[\left(\frac{(32.327 \text{ ft})}{(5 \text{ ft})} + \frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right) - \left[\left(\frac{4 \times (32.327 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (32.327 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 9.4153 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(0 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = 0 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.001 \text{ kipft}) + ((0 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.00015924 \text{ kipft/ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.00015924 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (0 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (0.00015924 \text{ kipft/ft})) + (4 \times (0 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3333 \text{ ft}$$

V_{max} - Max shear force located at depth a,

$$V_{max} = 12 \left(\frac{M_o b}{L_e} \right) \left(\frac{a}{L_e} - 1 \right) \left(\frac{a}{L_e} \right)^2$$

$$V_{max} = 12 \times \left(\frac{(0.00015924 \text{ kipft/ft}) \times (48 \text{ in})}{(5 \text{ ft})} \right) \times \left(\frac{(3.3333 \text{ ft})}{(5 \text{ ft})} - 1 \right) \times \left(\frac{(3.3333 \text{ ft})}{(5 \text{ ft})} \right)^2$$

$$V_{max} = 0.00022647 \text{ kip}$$

M_{max} - Max bending moment at depth a/2,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4 E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3 E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = (M_o) \left[1 - \left(\frac{4}{2 L_e} \right) + \left(\frac{3}{2 L_e} \right) \right]$$

$$M_{max} = ((0.00015924 \text{ kipft/ft}) \times (48 \text{ in})) \times \left[1 - \left(4 \times \frac{(3.3333 \text{ ft})^3}{2 \times (5 \text{ ft})} \right) + \left(3 \times \frac{(3.3333 \text{ ft})^4}{2 \times (5 \text{ ft})} \right) \right]$$

$$M_{max} = 0.00056617 \text{ kipft}$$

Minimum Reinforcement Check (LRFD)

Parameters:

$f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength,

$f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength,

$\phi = 0.65$ - Reduction factor for axial strength,

$\alpha = 0.8$ - Alpha factor for axial strength,

$A_g = 2304 \text{ in}^2$ - Gross area of concrete,

Longitudinal reinforcement:

Required reinforcement due to axial load, $A_{st,required}$

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[\frac{\left(\frac{8.251 \text{ kip}}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2)) \right)}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.322 \text{ in}^2$$

A_{min} - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.322 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

n_{rebar} - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

A_{st} - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

$$\text{Ratio} = 0.96556$$

25.2.3 s_{rebar} - Minimum spacing of reinforcement,

$$s_{rebar} = \text{Max} [1.5, (1.5 d_{bar})]$$

$$s_{rebar} = \text{Max} [1.5, (1.5 \times (0.625 \text{ in}))]$$

$$s_{rebar} = 1.5 \text{ in}$$

Ties:

25.7.2.2 Since longitudinal reinforcement is \leq No. 10a: Use #3(0.375 in)

25.7.2.1 s_{ties} - Maximum spacing of ties,

Status: **PASS**
Ratio: **0.970**

$$s_{ties} = \text{Min}[(16 d_{bar}), (48 d_{ties}), \text{Min}(D, b)]$$

$$s_{ties} = \text{Min}[(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), \text{Min}((48 \text{ in}), (48 \text{ in}))]$$

$$s_{ties} = 10 \text{ in}$$

Summary:

Main reinforcement: **14 - #5 (0.625 in)**

Ties: **#3(0.375 in) - 10 in**

Axial Compression Strength (ACI 318-19, LRFD)

22.4.2.2 ϕP_N - Allowable axial compressive strength

$$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st})]$$

$$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$$

$$\phi P_N = 2675.2 \text{ kip}$$

Ratio - Capacity

$$\text{Ratio} = \frac{P}{\phi P_N}$$

$$\text{Ratio} = \frac{(8.251 \text{ kip})}{(2675.2 \text{ kip})}$$

$$\text{Ratio} = 0.0030843$$

Status: **PASS**
Ratio: **0.000**

Shear Strength (ACI 318-19, LRFD)

Parameters:

22.5.2.2 $b_w = 48 \text{ in}$ - Effective width,
 d - Effective depth

$$d = 0.80 D$$

$$d = 0.80 \times (48 \text{ in})$$

$$d = 38.4 \text{ in}$$

22.5.5.1.3 λ_s - size effect modification factor

$$\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$$

$$\lambda_s = \text{MIN} \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$$

$$\lambda_s = 0.64282$$

The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,

22.5.5.1.1 $V_{c,max}$ - Max shear strength of concrete

$$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$$

$$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,max} = 296.21 \text{ kip}$$

The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 8.251 \text{ kip} \rightarrow 8251 \text{ lbf}$,

22.5.5.1.1(a) $V_{c,a}$ - Shear strength of concrete (a)

$$V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck}} + \frac{P}{6 A_g} \right] b_w d$$

$$V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + \frac{(8251 \text{ lbf})}{6 \times (2304 \text{ in}^2)} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.59 \text{ kip}$$

The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,

22.5.5.1.2 $V_{c,b}$ - Shear strength of concrete (b)

$$V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck}} + (0.05 f'_{ck}) \right] b_w d$$

$$V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi})} + (0.05 \times (2500 \text{ psi})) \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

V_c - Governing shear strength of concrete

$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.59 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.59 \text{ kip}$$

The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,

22.5.1.2 $V_{s,a}$ - Shear strength of steel (a)

$$V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$$

$$V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{s,a} = 737.28 \text{ kip}$$

A_v - Ties rebar area,

$$A_v = \frac{\pi d_{ties}^2}{4}$$

$$A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$$

$$A_v = 0.11045 \text{ in}^2$$

22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b)

$$V_{s,b} = \frac{2 A_v f_{ywk} d}{s_{ties}}$$

$$V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$$

$$V_{s,b} = 50.894 \text{ kip}$$

V_s - Governing shear strength of steel

$$V_s = \text{MIN}[V_{s,a}, V_{s,b}]$$

$$V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$$

$$V_s = 50.894 \text{ kip}$$

22.5.1.1 ϕV_n - Allowable shear strength

$$\phi V_n = \phi (V_c + V_s)$$

$$\phi V_n = (0.65) \times ((119.59 \text{ kip}) + (50.894 \text{ kip}))$$

$$\phi V_n = 110.81 \text{ kip}$$

Considering x-direction:

$V_{max} = 3.8241 \text{ kip}$ - Maximum shear force in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{V_{max}}{\phi V_n}$$

$$\text{Ratio} = \frac{(3.8241 \text{ kip})}{(110.81 \text{ kip})}$$

$$\text{Ratio} = 0.03451$$

Status: **PASS**
Ratio: **0.030**

Flexural Strength (ACI 318-19, LFRD)

S_m - Section modulus

$$S_m = \frac{b D^2}{6}$$

$$S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$$

$$S_m = 18432 \text{ in}^3$$

$\lambda = 1$ - Concrete modification factor (Normal concrete),

Allowable flexural strength:

M_n shall be the lesser of:

$\phi M_{n,1}$

$$\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$$

$$\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{2.5 \text{ ksi}} \times 18432.001 \text{ in}^3$$

$$\phi M_{n,1} = 249.600 \text{ kipft}$$

14.5.2.1b

$\phi M_{n,2}$

$$\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$$

$$\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$$

$$\phi M_{n,2} = 2121.6 \text{ kipft}$$

Therefore,

ϕM_n - Allowable flexural strength,

$$\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$$

$$\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$$

$$\phi M_n = 249.6 \text{ kipft}$$

Considering x-direction:

$M_{max} = 9.4153 \text{ kipft}$ - Maximum moment in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{M_{max}}{\phi M_n}$$

$$\text{Ratio} = \frac{(9.4153 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$\text{Ratio} = 0.037722$$

Status: **PASS**
Ratio: **0.040**

Considering z-direction:

$M_{max} = 0.00056617 \text{ kipft}$ - Maximum moment in the z-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{M_{max}}{\phi M_n}$$

$$\text{Ratio} = \frac{(0.00056617 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$\text{Ratio} = 2.2683 \times 10^{-6}$$

Status: **PASS**
Ratio: **0.000**

REFERENCES	CALCULATIONS	RESULTS
------------	--------------	---------


SkyCiv Foundation Design

Pile Foundation

Design Information :

Design code : IBC 2021 (International Building Code)
Unit System : Imperial

Pile Input

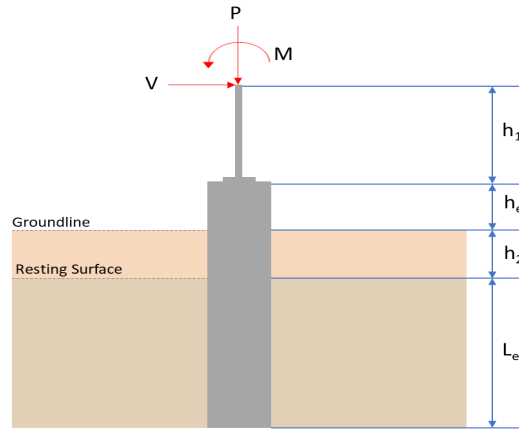

Geometry

Pile shape: rectangular

$b = 48$ in - Pile width

$D = 48$ in - Pile depth

$L = 5$ ft - Total pile length

$h_1 = 0$ ft - Lateral load height from the top of the pile,

$h_2 = 0$ ft - Depth to resisting surface

$h_e = 0$ ft - Length of pile above the ground

Tabulation of Soil Parameters

Layer	Label	Allowable Bearing Pressure (q_a) (psf)	Allowable Lateral Pressure (R) (psf/ft)
1	Sand, silty sand, clayey sand, silty gravel & clayey gravel	2000.000	150.000

Tabulation of Loads

Load Component	ASD	LRFD
P (kip)	5.489	8.162
V_x (kip)	-0.293	-0.489
V_z (kip)	-0.009	-0.014
M_x (kipft)	-0.030	-0.046
M_z (kipft)	9.266	15.804

Material Properties

$f'_{ck} = 2.5$ ksi - Concrete strength.

Required depth to resist lateral loads (ASD)

H - Point of application of the lateral load

$$H = h_1 + h_2 + h_e$$

$$H = (0 \text{ ft}) + (0 \text{ ft}) + (0 \text{ ft})$$

$$H = 0 \text{ ft}$$

Considering x-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.293 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.046656 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(9.266 \text{ kipft}) + ((-0.293 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 1.4755 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_e^3 - \left(14.14 \times \frac{H_o \times L_x}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,x} = 4.7153 \text{ ft}$ - Required depth in x-direction,

Considering z-direction:

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.009 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.0014331 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.03 \text{ kipft}) + ((-0.009 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.0047771 \text{ kipft/ft}$$

Required depth of embedment in earth:

$$L_e^3 - \left(14.14 \times \frac{H_o \times L_z}{R} \right) - \left(18.85 \times \frac{M_o}{R} \right) = 0$$

Solving the cubic equation:

$L_{e,z} = 0.68648 \text{ ft}$ - Required depth in z-direction,

Minimum embedded depth required:

$L_{e,req}$ - Depth of pile required,

$$L_{e,req} = \text{MAX}[L_{e,x}, L_{e,z}]$$

$$L_{e,req} = \text{MAX}[(4.7153 \text{ ft}), (0.68648 \text{ ft})]$$

$$L_{e,req} = 4.715 \text{ ft}$$

L_e - Actual embedded length of pile,

$$L_e = L - h_e - h_2$$

$$L_e = (5 \text{ ft}) - (0 \text{ ft}) - (0 \text{ ft})$$

$$L_e = 5 \text{ ft}$$

Ratio - Embedded depth

$$\text{Ratio} = \frac{L_{e,req}}{L_e}$$

$$\text{Ratio} = \frac{(4.715 \text{ ft})}{(5 \text{ ft})}$$

$$\text{Ratio} = 0.943$$

Status: **PASS**
Ratio: **0.940**

End-bearing Capacity (ASD)

A - Pile cross-section area

$$A = b D$$

$$A = (48 \text{ in}) \times (48 \text{ in})$$

$$A = 16 \text{ ft}^2$$

q - End-bearing pressure

$$q = \frac{P_v}{A}$$

$$q = \frac{(5.489 \text{ kip})}{(16 \text{ ft}^2)}$$

$$q = 0.34306 \text{ kip/ft}^2$$

Check bearing capacity ratio:

Ratio - Capacity

$$\text{Ratio} = \frac{q}{q_a}$$

$$\text{Ratio} = \frac{(0.34306 \text{ kip/ft}^2)}{(2000 \text{ psf})}$$

$$\text{Ratio} = 0.17153$$

Status: **PASS**
Ratio: **0.170**

Czerniak

Lateral Soil Pressure (ASD):

L/D - Length to least lateral dimension ratio,

$$L/D = \frac{L}{D}$$

$$L/D = \frac{(5 \text{ ft})}{(48 \text{ in})}$$

$$L/D = 1.25$$

Since $L/D \leq 10$,

Pile is short.

Considering x-direction:

$H_o = -0.046656 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 1.4755 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (1.4755 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (1.4755 \text{ kipft/ft})) + (4 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3731 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 \times [(4 \times (1.4755 \text{ kipft/ft})) + (3 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))]^2}{(5 \text{ ft})^2 \times [(3 \times (1.4755 \text{ kipft/ft})) + (2 \times (-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))]}$$

$$p = 0.20502 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (1.4755 \text{ kipft/ft})) + ((-0.046656 \text{ kip/ft}) \times (5 \text{ ft}))]}{(5 \text{ ft})^2}$$

$$s = 0.65224 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.3731 \text{ ft})}{2}$$

$$p_a = 0.25298 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(0.20502 \text{ kip/ft}^2)}{(0.25298 \text{ kip/ft}^2)}$$

$$Ratio = 0.81041$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (5 \text{ ft})$$

$$p_s = 0.75 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.65224 \text{ kip/ft}^2)}{(0.75 \text{ kip/ft}^2)}$$

$$Ratio = 0.86966$$

Status: **PASS**
Ratio: **0.810**

Status: **PASS**
Ratio: **0.870**

Considering z-direction:

$H_o = -0.0014331 \text{ kip/ft}$ - Lateral force per length of pile,

$M_o = 0.0047771 \text{ kipft/ft}$ - Overturning moment per length of pile,

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.0047771 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.0014331 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (0.0047771 \text{ kipft/ft})) + (4 \times (-0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.5417 \text{ ft}$$

p - Earth pressure against the pile at distance $a/2$ from resting surface,

$$p = \frac{0.75 [(4 M_o) + (3 H_o L_e)]^2}{L_e^2 [(3 M_o) + (2 H_o L_e)]}$$

$$p = \frac{0.75 [(4 \times (0.0047771 \text{ kipft/ft})) + (3 \times (-0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))]^2}{(5 \text{ ft})^2 \times [(3 \times (0.0047771 \text{ kipft/ft})) + (2 \times (-0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))]}$$

$$p = -550.67 \text{ kip/ft}^2$$

s - Earth pressure against the pile at distance L_e ,

$$s = \frac{6 [(2 M_o) + (H_o L_e)]}{L_e^2}$$

$$s = \frac{6 \times [(2 \times (0.0047771 \text{ kipft/ft})) + ((-0.0014331 \text{ kip/ft}) \times (5 \text{ ft}))]}{(5 \text{ ft})^2}$$

$$s = 0.00057325 \text{ kip/ft}^2$$

Check lateral soil pressure capacity:

p_a - Allowable lateral soil pressure at depth $a/2$,

$$p_a = R \frac{a}{2}$$

$$p_a = (150 \text{ psf/ft}) \times \frac{(3.5417 \text{ ft})}{2}$$

$$p_a = 0.26563 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity

$$Ratio = \frac{p}{p_a}$$

$$Ratio = \frac{(-550.67 \text{ kip/ft}^2)}{(0.26563 \text{ kip/ft}^2)}$$

$$Ratio = -2073.1$$

p_s - Allowable lateral soil pressure at depth L_e ,

$$p_s = R L_e$$

$$p_s = (150 \text{ psf/ft}) \times (5 \text{ ft})$$

$$p_s = 0.75 \text{ kip/ft}^2$$

Ratio - Lateral soil capacity


$$Ratio = \frac{s}{p_s}$$

$$Ratio = \frac{(0.00057325 \text{ kip/ft}^2)}{(0.75 \text{ kip/ft}^2)}$$

$$Ratio = 0.00076433$$

Status: **PASS**
Ratio: **-2073.110**

Status: **PASS**
Ratio: **0.000**

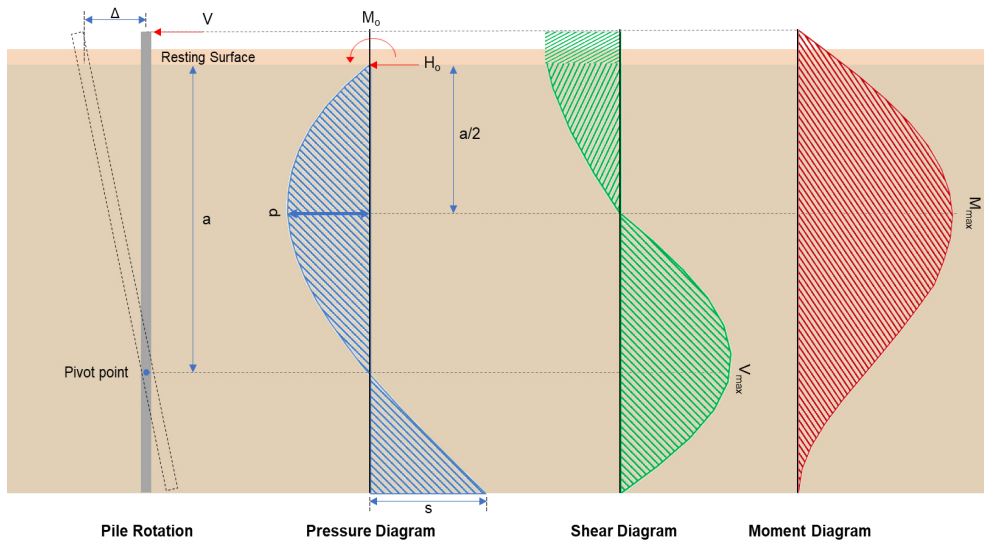

Shear force and Bending moment (x-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_x}{1.57 D}$$

$$H_o = \frac{(-0.489 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.077866 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_z + (V_x H)}{1.57 D}$$

$$M_o = \frac{(15.804 \text{ kipft}) + ((-0.489 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 2.5166 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(2.5166 \text{ kipft/ft})}{(-0.077866 \text{ kip/ft})}$$

$$E = 32.319 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (2.5166 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (2.5166 \text{ kipft/ft})) + (4 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = \frac{(-0.077866 \text{ kip/ft}) \times (48 \text{ in})}{(6 \times (2.5166 \text{ kipft/ft})) + (4 \times (-0.077866 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.3723 \text{ ft}$$

V_{max} - Max shear force located at depth a,

$$V_{max} = (H_o D) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.077866 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (32.319 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.3723 \text{ ft})}{(5 \text{ ft})} \right)^2 \right] + \left[4 \times \left(\frac{3 \times (32.319 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.3723 \text{ ft})}{(5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 3.7768 \text{ kip}$$

M_{max} - Max bending moment located at depth a/2,

$$M_{max} = (H_o D L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.077866 \text{ kip/ft}) \times (48 \text{ in}) \times (5 \text{ ft})) \times \left[\left(\frac{(32.319 \text{ ft})}{(5 \text{ ft})} + \frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right) - \left[\left(\frac{4 \times (32.319 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (32.319 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.3723 \text{ ft})}{2 \times (5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 9.299 \text{ kipft}$$

Shear force and Bending moment (z-direction, LRFD)

H_o - Lateral force per length of pile,

$$H_o = \frac{V_z}{1.57 b}$$

$$H_o = \frac{(-0.014 \text{ kip})}{1.57 \times (48 \text{ in})}$$

$$H_o = -0.0022293 \text{ kip/ft}$$

M_o - Moment per length of pile,

$$M_o = \frac{M_x + (V_z H)}{1.57 b}$$

$$M_o = \frac{(0.046 \text{ kipft}) + ((-0.014 \text{ kip}) \times (0 \text{ ft}))}{1.57 \times (48 \text{ in})}$$

$$M_o = 0.0073248 \text{ kipft/ft}$$

E - Distance from lateral load to resisting surface,

$$E = \frac{M_o}{H_o}$$

$$E = \frac{(0.0073248 \text{ kipft/ft})}{(-0.0022293 \text{ kip/ft})}$$

$$E = 3.2857 \text{ ft}$$

a - Distance from resting surface to pivot point,

$$a = \frac{(4 M_o L_e) + (3 H_o L_e^2)}{(6 M_o) + (4 H_o L_e)}$$

$$a = \frac{(4 \times (0.0073248 \text{ kipft/ft}) \times (5 \text{ ft})) + (3 \times (-0.0022293 \text{ kip/ft}) \times (5 \text{ ft})^2)}{(6 \times (0.0073248 \text{ kipft/ft})) + (4 \times (-0.0022293 \text{ kip/ft}) \times (5 \text{ ft}))}$$

$$a = 3.5432 \text{ ft}$$

V_{max} - Max shear force located at depth a,

$$V_{max} = (H_o b) \left[1 - \left[3 \left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{L_e} \right)^2 \right] + \left[4 \left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{L_e} \right)^3 \right] \right]$$

$$V_{max} = ((-0.0022293 \text{ kip/ft}) \times (48 \text{ in})) \times \left[1 - \left[3 \times \left(\frac{4 \times (3.2857 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.5432 \text{ ft})}{(5 \text{ ft})} \right)^2 \right] \right. \\ \left. + \left[4 \times \left(\frac{3 \times (3.2857 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.5432 \text{ ft})}{(5 \text{ ft})} \right)^3 \right] \right]$$

$$V_{max} = 0.016287 \text{ kip}$$

M_{max} - Max bending moment located at depth $a/2$,

$$M_{max} = (H_o \cdot b \cdot L_e) \left[\left(\frac{E}{L_e} + \frac{a}{2 L_e} \right) \right. \\ \left. - \left[\left(\frac{4E}{L_e} + 3 \right) \left(\frac{a}{2 L_e} \right)^3 \right] + \left[\left(\frac{3E}{L_e} + 2 \right) \left(\frac{a}{2 L_e} \right)^4 \right] \right]$$

$$M_{max} = ((-0.0022293 \text{ kip/ft}) \times (48 \text{ in}) \times (5 \text{ ft})) \times \left[\left(\frac{(3.2857 \text{ ft})}{(5 \text{ ft})} + \frac{(3.5432 \text{ ft})}{2 \times (5 \text{ ft})} \right) \right. \\ \left. - \left[\left(\frac{4 \times (3.2857 \text{ ft})}{(5 \text{ ft})} + 3 \right) \times \left(\frac{(3.5432 \text{ ft})}{2 \times (5 \text{ ft})} \right)^3 \right] + \left[\left(\frac{3 \times (3.2857 \text{ ft})}{(5 \text{ ft})} + 2 \right) \times \left(\frac{(3.5432 \text{ ft})}{2 \times (5 \text{ ft})} \right)^4 \right] \right]$$

$$M_{max} = 0.036725 \text{ kipft}$$

Minimum Reinforcement Check (LRFD)

Parameters:

$f'_{ck} = 2.5 \text{ ksi}$ - Concrete strength,

$f_{yk} = 60 \text{ ksi}$ - Longitudinal reinforcement strength,

$\phi = 0.65$ - Reduction factor for axial strength,

$\alpha = 0.8$ - Alpha factor for axial strength,

$A_g = 2304 \text{ in}^2$ - Gross area of concrete,

Longitudinal reinforcement:

Required reinforcement due to axial load, $A_{st,required}$

$A_{st,required}$

$$A_{st,required} = \text{Min} \left[\frac{\frac{P}{\phi \alpha} - (0.85 f'_{ck} A_g)}{f_{yk} - (0.85 f'_{ck})}, (0.08 A_g) \right]$$

$$A_{st,required} = \text{Min} \left[\frac{\frac{(8.162 \text{ kip})}{(0.65) \times (0.8)} - (0.85 \times (2.5 \text{ ksi}) \times (2304 \text{ in}^2))}{(60 \text{ ksi}) - (0.85 \times (2.5 \text{ ksi}))}, (0.08 \times (2304 \text{ in}^2)) \right]$$

$$A_{st,required} = -84.325 \text{ in}^2$$

A_{min} - Governing minimum reinforcement area,

$$A_{min} = \text{Max} [A_{st,required}, (0.0018 A_g)]$$

$$A_{min} = \text{Max} [(-84.325 \text{ in}^2), (0.0018 \times (2304 \text{ in}^2))]$$

$$A_{min} = 4.1472 \text{ in}^2$$

n_{rebar} - Required number of reinforcement,

$$n_{rebar} = \frac{A_{min}}{A_{rebar}}$$

$$n_{rebar} = \frac{(4.1472 \text{ in}^2)}{(0.3068 \text{ in}^2)}$$

$$n_{rebar} = 14$$

A_{st} - Actual total reinforcement area,

$$A_{st} = n_{rebar} \frac{\pi d_{bar}^2}{4}$$

$$A_{st} = (14) \times \frac{\pi \times (0.625 \text{ in})^2}{4}$$

$$A_{st} = 4.2951 \text{ in}^2$$

Ratio - Capacity

$$\text{Ratio} = \frac{A_{min}}{A_{st}}$$

$$\text{Ratio} = \frac{(4.1472 \text{ in}^2)}{(4.2951 \text{ in}^2)}$$

Table 22.4.2.1

22.4.2.2, 10.6.1.1

<p>25.2.3 s_{rebar} - Minimum spacing of reinforcement,</p> <p>25.7.2.2 Since longitudinal reinforcement is \leq No. 10ø: Use #3(0.375 in)</p> <p>25.7.2.1 s_{ties} - Maximum spacing of ties,</p>	<p style="text-align: center;">$Ratio = 0.96556$</p> <p style="text-align: center;">$s_{rebar} = Max[1.5, (1.5 d_{bar})]$</p> <p style="text-align: center;">$s_{rebar} = Max[1.5, (1.5 \times (0.625 \text{ in}))]$</p> <p style="text-align: center;">$s_{rebar} = 1.5 \text{ in}$</p> <p>Ties:</p> <p style="text-align: center;">$s_{ties} = Min[(16 d_{bar}), (48 d_{ties}), Min(D, b)]$</p> <p style="text-align: center;">$s_{ties} = Min[(16 \times (0.625 \text{ in})), (48 \times (0.375 \text{ in})), Min((48 \text{ in}), (48 \text{ in}))]$</p> <p style="text-align: center;">$s_{ties} = 10 \text{ in}$</p> <p>Summary:</p> <p style="text-align: center;">Main reinforcement: 14 - #5 (0.625 in) Ties: #3(0.375 in) - 10 in</p>	<p>Status: PASS Ratio: 0.970</p>
<p>22.4.2.2 ϕP_N - Allowable axial compressive strength</p>	<p style="text-align: center;">Axial Compression Strength (ACI 318-19, LRFD)</p> <p style="text-align: center;">$\phi P_N = \phi 0.80 [(0.85 f'_{ck} [A_g - A_{st}]) + (f_{yk} A_{st})]$</p> <p style="text-align: center;">$\phi P_N = (0.65) \times 0.80 \times [(0.85 \times (2.5 \text{ ksi}) \times [(2304 \text{ in}^2) - (4.2951 \text{ in}^2)]) + ((60 \text{ ksi}) \times (4.2951 \text{ in}^2))]$</p> <p style="text-align: center;">$\phi P_N = 2675.2 \text{ kip}$</p> <p><i>Ratio - Capacity</i></p> <p style="text-align: center;">$Ratio = \frac{P}{\phi P_N}$</p> <p style="text-align: center;">$Ratio = \frac{(8.162 \text{ kip})}{(2675.2 \text{ kip})}$</p> <p style="text-align: center;">$Ratio = 0.003051$</p>	<p>Status: PASS Ratio: 0.000</p>
<p>22.5.2.2 b_w = 48 in - Effective width, d - Effective depth</p> <p>22.5.5.1.3 λ_s - size effect modification factor</p> <p>22.5.5.1.1 $V_{c,max}$ - Max shear strength of concrete</p>	<p style="text-align: center;">Shear Strength (ACI 318-19, LRFD)</p> <p>Parameters:</p> <p style="text-align: center;">$d = 0.80 D$</p> <p style="text-align: center;">$d = 0.80 \times (48 \text{ in})$</p> <p style="text-align: center;">$d = 38.4 \text{ in}$</p> <p style="text-align: center;">$\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{d}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = MIN \left[\sqrt{\frac{2}{1 + \frac{(38.4 \text{ in})}{10}}}, 1 \right]$</p> <p style="text-align: center;">$\lambda_s = 0.64282$</p> <p>The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,</p> <p style="text-align: center;">$V_{c,max} = 5 \lambda_s \sqrt{f'_{ck}} b_w d$</p> <p style="text-align: center;">$V_{c,max} = 5 \times (0.64282) \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$</p>	

$$V_{c,max} = 296.21 \text{ kip}$$

22.5.5.1.1(a) The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$, $P = 8.162 \text{ kip} \rightarrow 8162 \text{ lbf}$,
 $V_{c,a}$ - Shear strength of concrete (a)

$$V_{c,a} = \left[2 \lambda_s \sqrt{f'_{ck} + \frac{P}{6 A_g}} \right] b_w d$$

$$V_{c,a} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + \frac{(8162 \text{ lbf})}{6 \times (2304 \text{ in}^2)}} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,a} = 119.57 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{c,b}$ - Shear strength of concrete (b)

$$V_{c,b} = \left[2 \lambda_s \sqrt{f'_{ck} + (0.05 f'_{ck})} \right] b_w d$$

$$V_{c,b} = \left[2 \times (0.64282) \times \sqrt{(2500 \text{ psi}) + (0.05 \times (2500 \text{ psi}))} \right] \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{c,b} = 348.89 \text{ kip}$$

V_c - Governing shear strength of concrete

$$V_c = \text{Min}[V_{c,max}, V_{c,a}, V_{c,b}]$$

$$V_c = \text{Min}[(296.21 \text{ kip}), (119.57 \text{ kip}), (348.89 \text{ kip})]$$

$$V_c = 119.57 \text{ kip}$$

22.5.5.1.2 The following variables were converted to be consistent with empirical formula $f'_{ck} = 2.5 \text{ ksi} \rightarrow 2500 \text{ psi}$,
 $V_{s,a}$ - Shear strength of steel (a)

$$V_{s,a} = 8 \sqrt{f'_{ck}} b_w d$$

$$V_{s,a} = 8 \times \sqrt{(2500 \text{ psi})} \times (48 \text{ in}) \times (38.4 \text{ in})$$

$$V_{s,a} = 737.28 \text{ kip}$$

A_v - Ties rebar area,

$$A_v = \frac{\pi d_{ties}^2}{4}$$

$$A_v = \frac{\pi \times (0.375 \text{ in})^2}{4}$$

$$A_v = 0.11045 \text{ in}^2$$

22.5.8.5.3 $V_{s,b}$ - Shear strength of steel (b)

$$V_{s,b} = \frac{2 A_v f_{yw} d}{s_{ties}}$$

$$V_{s,b} = \frac{2 \times (0.11045 \text{ in}^2) \times (60 \text{ ksi}) \times (38.4 \text{ in})}{(10 \text{ in})}$$

$$V_{s,b} = 50.894 \text{ kip}$$

V_s - Governing shear strength of steel

$$V_s = \text{MIN}[V_{s,a}, V_{s,b}]$$

$$V_s = \text{MIN}[(737.28 \text{ kip}), (50.894 \text{ kip})]$$

$$V_s = 50.894 \text{ kip}$$

22.5.1.1 ϕV_n - Allowable shear strength

$$\phi V_n = \phi (V_c + V_s)$$

$$\phi V_n = (0.65) \times ((119.57 \text{ kip}) + (50.894 \text{ kip}))$$

$$\phi V_n = 110.8 \text{ kip}$$

Considering x-direction:

$V_{max} = 3.7768 \text{ kip}$ - Maximum shear force in the x-direction,

Ratio - Capacity

$$\text{Ratio} = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(3.7768 \text{ kip})}{(110.8 \text{ kip})}$$

$$Ratio = 0.034086$$

Status: **PASS**
Ratio: **0.030**

Considering z-direction:

$V_{max} = 0.016287 \text{ kip}$ - Maximum shear force in the z-direction,

Ratio - Capacity

$$Ratio = \frac{V_{max}}{\phi V_n}$$

$$Ratio = \frac{(0.016287 \text{ kip})}{(110.8 \text{ kip})}$$

$$Ratio = 0.00014699$$

Status: **PASS**
Ratio: **0.000**

Flexural Strength (ACI 318-19, LRFD)

S_m - Section modulus

$$S_m = \frac{b D^2}{6}$$

$$S_m = \frac{(48 \text{ in}) \times (48 \text{ in})^2}{6}$$

$$S_m = 18432 \text{ in}^3$$

$\lambda = 1$ - Concrete modification factor (Normal concrete),

Allowable flexural strength:

M_n shall be the lesser of:

$\phi M_{n,1}$

$$\phi M_{n,1} = \phi \times 5 \times \lambda \times \sqrt{f'_c} \times S_m$$

$$\phi M_{n,1} = 0.65 \times 5 \times 1 \times \sqrt{(2.5 \text{ ksi})} \times 18432.001 \text{ in}^3$$

$$\phi M_{n,1} = 249.600 \text{ kipft}$$

14.5.2.1b

$\phi M_{n,2}$

$$\phi M_{n,2} = \phi \times 0.85 \times f'_c \times S_m$$

$$\phi M_{n,2} = (0.65) \times 0.85 \times (2.5 \text{ ksi}) \times (18432 \text{ in}^3)$$

$$\phi M_{n,2} = 2121.6 \text{ kipft}$$

Therefore,

ϕM_n - Allowable flexural strength,

$$\phi M_n = \text{MIN}[\phi M_{n,1}, \phi M_{n,2}]$$

$$\phi M_n = \text{MIN}[(249.6 \text{ kipft}), (2121.6 \text{ kipft})]$$

$$\phi M_n = 249.6 \text{ kipft}$$

Considering x-direction:

$M_{max} = 9.299 \text{ kipft}$ - Maximum moment in the x-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$Ratio = \frac{(9.299 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$Ratio = 0.037255$$

Status: **PASS**
Ratio: **0.040**

Considering z-direction:

$M_{max} = 0.036725 \text{ kipft}$ - Maximum moment in the z-direction,

Ratio - Capacity

$$Ratio = \frac{M_{max}}{\phi M_n}$$

$$\text{Ratio} = \frac{(0.036725 \text{ kipft})}{(249.6 \text{ kipft})}$$

$$\text{Ratio} = 0.00014713$$

Status: **PASS**
Ratio: **0.000**